

NO-A682 040


ARMY ENGINEER DISTRICT, PHILADELPHIA PA F/G 8/8
BLUE MARSH LAKE PROJECT, WATER QUALITY DATA REPORT (RCS-DAEN-CW--ETC(U)
SEP 79

UNCLASSIFIED

NL

102



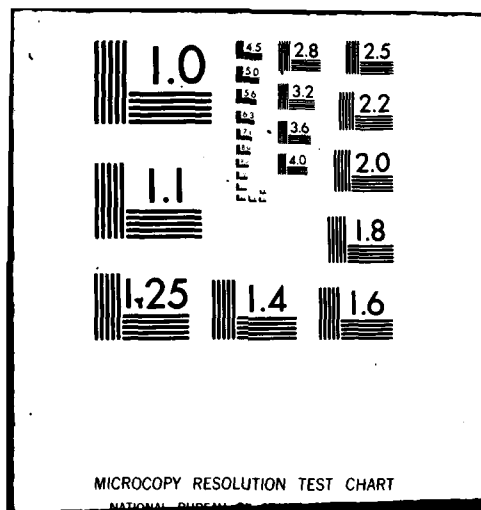

AD A 082040

LEVEL 4

(15)
p.1

APPROVED FOR PUBLIC RELEASE;
DISTRIBUTION UNLIMITED.

1130 Sep '77

6
BLUE MARSH LAKE PROJECT,

12
128

WATER QUALITY DATA REPORT (RCS-DAEN-CWE-15)

Rept. for 1 Oct '78 - 30 Sep '77.

FOR THE PERIOD

OCTOBER 1, 1978 TO SEPTEMBER 30, 1979

APPROVED FOR PUBLIC RELEASE;
DISTRIBUTION UNLIMITED.

DTIC
ELECTE
MAR 20 1980
S A

Prepared by

U. S. Army Corps of Engineers
Philadelphia District

THIS DOCUMENT IS BEST QUALITY PRACTICABLE.
THE COPY FURNISHED TO DDC CONTAINED A
SIGNIFICANT NUMBER OF PAGES WHICH DO NOT
REPRODUCE LEGIBLY.

DDC FILE COPY

80 3 17 011

410 358

COE / NAP / BNL / WQDR / 78-79

DISCLAIMER NOTICE

**THIS DOCUMENT IS BEST QUALITY
PRACTICABLE. THE COPY FURNISHED
TO DTIC CONTAINED A SIGNIFICANT
NUMBER OF PAGES WHICH DO NOT
REPRODUCE LEGIBLY.**

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

The lake exhibits a nutrient rich environment. Nitrogen and phosphate levels were only moderately elevated. The testing program revealed zero dissolved oxygen levels throughout the lake from approximately four meters below the surface to fourteen meters in the deepest areas. The anerobic condition existed until Oct. 1979. Close monitoring of the proliferation of algae and pond weeds is necessary to apply control measures. According to bacteriological data recorded from waters in the beach area, the coliform counts were within the limits establish by Pennsylvania (DER) for public bathing areas.

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

INSTRUCTIONS FOR PREPARATION OF REPORT DOCUMENTATION PAGE

RESPONSIBILITY. The controlling DoD office will be responsible for completion of the Report Documentation Page, DD Form 1473, in all technical reports prepared by or for DoD organizations.

CLASSIFICATION. Since this Report Documentation Page, DD Form 1473, is used in preparing announcements, bibliographies, and data banks, it should be unclassified if possible. If a classification is required, identify the classified items on the page by the appropriate symbol.

COMPLETION GUIDE

General. Make Blocks 1, 4, 5, 6, 7, 11, 13, 15, and 16 agree with the corresponding information on the report cover. Leave Blocks 2 and 3 blank.

Block 1. Report Number. Enter the unique alphanumeric report number shown on the cover.

Block 2. Government Accession No. Leave blank. This space is for use by the Defense Documentation Center.

Block 3. Recipient's Catalog Number. Leave blank. This space is for the use of the report recipient to assist in future retrieval of the document.

Block 4. Title and Subtitle. Enter the title in all capital letters exactly as it appears on the publication. Titles should be unclassified whenever possible. Write out the English equivalent for Greek letters and mathematical symbols in the title (see "Abstracting Scientific and Technical Reports of Defense-sponsored RDT/E," AD-667 000). If the report has a subtitle, this subtitle should follow the main title, be separated by a comma or semicolon if appropriate, and be initially capitalized. If a publication has a title in a foreign language, translate the title into English and follow the English translation with the title in the original language. Make every effort to simplify the title before publication.

Block 5. Type of Report and Period Covered. Indicate here whether report is interim, final, etc., and, if applicable, inclusive dates of period covered, such as the life of a contract covered in a final contractor report.

Block 6. Performing Organization Report Number. Only numbers other than the official report number shown in Block 1, such as series numbers for in-house reports or a contractor/grantee number assigned by him, will be placed in this space. If no such numbers are used, leave this space blank.

Block 7. Author(s). Include corresponding information from the report cover. Give the name(s) of the author(s) in conventional order (for example, John R. Doe or, if author prefers, J. Robert Doe). In addition, list the affiliation of an author if it differs from that of the performing organization.

Block 8. Contract or Grant Number(s). For a contractor or grantee report, enter the complete contract or grant number(s) under which the work reported was accomplished. Leave blank in in-house reports.

Block 9. Performing Organization Name and Address. For in-house reports enter the name and address, including office symbol, of the performing activity. For contractor or grantee reports enter the name and address of the contractor or grantee who prepared the report and identify the appropriate corporate division, school, laboratory, etc., of the author. List city, state, and ZIP Code.

Block 10. Program Element, Project, Task Area, and Work Unit Numbers. Enter here the number code from the applicable Department of Defense form, such as the DD Form 1498, "Research and Technology Work Unit Summary" or the DD Form 1634, "Research and Development Planning Summary," which identifies the program element, project, task area, and work unit or equivalent under which the work was authorized.

Block 11. Controlling Office Name and Address. Enter the full, official name and address, including office symbol, of the controlling office. (Equates to funding/sponsoring agency. For definition see DoD Directive 5200.20, "Distribution Statements on Technical Documents.")

Block 12. Report Date. Enter here the day, month, and year or month and year as shown on the cover.

Block 13. Number of Pages. Enter the total number of pages.

Block 14. Monitoring Agency Name and Address (if different from Controlling Office). For use when the controlling or funding office does not directly administer a project, contract, or grant, but delegates the administrative responsibility to another organization.

Blocks 15 & 15a. Security Classification of the Report: Declassification/Downgrading Schedule of the Report. Enter in 15 the highest classification of the report. If appropriate, enter in 15a the declassification/downgrading schedule of the report, using the abbreviations for declassification/downgrading schedules listed in paragraph 4-207 of DoD 5200.1-R.

Block 16. Distribution Statement of the Report. Insert here the applicable distribution statement of the report from DoD Directive 5200.20, "Distribution Statements on Technical Documents."

Block 17. Distribution Statement (of the abstract entered in Block 20, if different from the distribution statement of the report). Insert here the applicable distribution statement of the abstract from DoD Directive 5200.20, "Distribution Statements on Technical Documents."

Block 18. Supplementary Notes. Enter information not included elsewhere but useful, such as: Prepared in cooperation with . . . Translation of (or by) . . . Presented at conference of . . . To be published in . . .

Block 19. Key Words. Select terms or short phrases that identify the principal subjects covered in the report, and are sufficiently specific and precise to be used as index entries for cataloging, conforming to standard terminology. The DoD "Thesaurus Engineering and Scientific Terms" (TEST), AD-672 000, can be helpful.

Block 20. Abstract. The abstract should be a brief (not to exceed 200 words) factual summary of the most significant information contained in the report. If possible, the abstract of a classified report should be unclassified and the abstract to an unclassified report should consist of publicly-releasable information. If the report contains a significant bibliography or literature survey, mention it. For information on preparing abstracts see "Abstracting Scientific and Technical Reports of Defense-Sponsored RDT&E," 7 000.

TABLE OF CONTENTS

<u>Paragraph</u>		<u>Page</u>
SECTION I - SUMMARY AND CONCLUSIONS		
1-01	Summary.....	1
SECTION II - INFORMATION		
2-01	Purpose and Scope.....	3
2-02	Authority.....	3
2-03	Background Information.....	3
2-04	Pertinent Reference.....	4
SECTION III - AREA AND PROJECT DESCRIPTION		
3-01	River Basin Characteristics.....	5
3-02	Project Description.....	6
3-03	Climate.....	7
3-04	Dam and Lake Characteristics.....	9
3-05	Geological Patterns.....	10
3-06	Soils.....	11
3-07	Vegetation.....	11
3-08	Land Use.....	11
SECTION IV - WATER QUALITY DATA		
4-01	Purpose of Sampling Program.....	13
4-02	Testing Procedures and Equipment.....	13
4-03	Data Available.....	14
4-04	Water Chemistry.....	15
4-05	Coliform Sampling.....	18
4-06	Algae Bloom.....	19
SECTION V - INTERPRETATION OF DATA		
5-01	General Post-impoundment Conditions.....	20
5-02	Fishery.....	20
5-03	Coordination Efforts with Other Federal and State Agencies.....	21
SECTION VI - RECOMMENDATIONS AND PROPOSED STUDIES		
6-01	General.....	23
6-02	Findings and Conclusions.....	24

TABLE OF CONTENTS (Cont'd)

APPENDICES

APPENDIX A	Blue Marsh Lake Stratification Testing - Philadelphia District
APPENDIX B	Blue Marsh Lake Secchi Disc Readings - Philadelphia District
PLATE 1	Blue Marsh Dam and Reservoir Location
PLATE 2	Blue Marsh Lake Sampling Points
TABLE 1	Blue Marsh Lake Climatological Data, 1979
FIGURE 1	Nitrate--Nitrogen Concentrations in the Tulpehocken Creek basin
FIGURE 2	Total Phosphorous Concentrations in the Tulpehocken Creek basin
FIGURE 3	Relation between Discharge and Total Nitrogen in the Tulpehocken basin
FIGURE 4	Dissolved Oxygen Concentrations in the Tulpehocken Creek Basin
FIGURE 5	Graph showing Relation between Discharge and Total Phosphorous in Tulpehocken Creek basin near Blue Marsh Dam Site.

SECTION I - SUMMARY

1-01. Summary. The Blue Marsh Dam and Reservoir ^{1/} is located on Tulpehocken Creek, a tributary of the Schuylkill River in Berks County about six miles northwest of Reading, Pennsylvania. The primary purposes of the project are flood control, emergency water supply storage, water quality control and recreation. This report deals with the water quality aspect of the project.

The drainage basin above Blue Marsh Lake consists principally of farmland and woodland with scattered housing located along the rural roads and small villages. Stream valleys, within the watershed have moderate to steep slopes, mostly wooded, with adjacent open fields devoted principally to agricultural pursuits. Pollution control in the Watershed is problematic, due to septic tank overflows, lack of sewage systems and drainage from farmlands within the basin.

The pH range for the maintenance of good fish production should be between 6.5 and 8.5. The State pH standards of 6.0 to 8.5 are being met at all tributaries and the main stream. Bicarbonate derived from limestone of the upper Tulpehocken and Spring Creek basin provides for a high buffering capacity of the water for maintaining a pH on the main stem generally between 7.5 and 8.5 Northkill and Licking Creeks, which flow over shale of the Martinsburg Formation, have a lower buffering capacity and a pH between 7 and 8.

^{1/} Blue Marsh Dam and Reservoir Location (Plate 1).

Blue Marsh Lake has a wide variety of fish, ranging from bass to game fish such as Tiger muskellunge. Prior to the official opening of the Blue Marsh project, on 15 July 1979, the Pennsylvania Fish Commission began stocking the lake in May and June with 400,000 largemouth bass fry, 25,000 walleyes, 15,000 crappies and 75,000 channel catfish fry. During August, another 5,000 largemouth bass was stocked.

Finally, 7,000 Tiger muskellunge were stocked during October of 1979. The Fish Commission reported that there was a very low fish mortality rate and a prolific growth exhibited in largemouth bass and other fish. Fishing in lake waters was reportedly excellent with similar expectations for 1980. Most fishermen contacted expressed deep satisfaction with the fishing provided by Blue Marsh Lake.

Monitoring of lake waters began in June 1979 by U. S. Geological Service and the Corps in September of the same year. The results of that report can be found in (Appendix A). In addition to Corps' testing for pH, dissolved oxygen, temperature, and specific conductance, the U. S. Geological Survey tests for bacteria, arsenic, chlorophyll a, and nutrient levels. Algae infestation did not manifest itself to the point of a problem. Since the lake is less than a year old, it is difficult to postulate future lake conditions as to algae infestation.

SECTION II - INTRODUCTION

2-01. Purpose and Scope. The purpose of the report is to present and briefly interpret the water quality data collected to date at Blue Marsh Lake. The analyzed data (Appendix A), meets the standards established by the U. S. Environmental Protection Agency and the Commonwealth of Pennsylvania as outlined in Chapter 93, Water Quality Criteria.

The fecal coliform standards for swimming beaches is 200 fecal coliforms per 100 ml of sample and this was not exceeded during the current year.

The report characterizes the general design areas as to land use, potential pollution sources contributing to the lake, the project itself and the relationship between potential water quality problems that may occur and possible effects of the lake on the water quality.

2-02. Authority. This report is submitted in accordance with the Corps of Engineers policy authorized in ER 1110-2-334, "Water Quality Management at Corps' Civil Works Facilities", 1 May 1974.

2-03. Background Information. Blue Marsh Lake is located on the Tulpehocken Creek about seven miles northwest of Reading. Blue Marsh Dam, spillway and outlet works was essentially completed in the fall of 1978, and dedicated on 15 July 1979. Flood and water quality gates were closed on 23 April 1979; with the water reaching the summer pool (EL 290) on 16 September 1979.

Lake monitoring began on 20 June 1979 by the U. S. Geological Survey, and the district instituted profile monitoring on 13 September 1979. The primary purposes of the reservoir are for flood control, future water supply, water quality and recreation. Blue Marsh Reservoir is one of four flood control structures in the Delaware River Basin.

2-04. Pertinent References. The following references are considered pertinent to this report.

- a. (ER 1110-2-1402)
- b. (ER 1130-2-415)
- c. U. S. Geological Survey, Water Resources Investigations, Water Quality Study of Tulpehocken, Prior to Impoundment of Blue Marsh Lake, (77.55).
- d. U. S. Geological Survey Water-Resources Investigations (78-53); Bacteriological Water-Quality of Tulpehocken Creek Basin, Berks and Lebanon Counties, Pennsylvania.
- e. Chemical, Bacteriological and Physical Data documented in Appendix A of this report.

SECTION III - AREA AND PROJECT DESCRIPTION

3-01. River Basin Characteristics. The Blue Marsh project is located in Berks County in southeastern Pennsylvania (see Plate 1). The project is on Tulpehocken Creek, which has its source near the city of Lebanon and flows generally eastward towards its confluence with the Schuylkill River, about seven miles below the dam site at Reading. The Tulpehocken Creek watershed covers approximately 215 square miles with more than 80 percent of the drainage area located above the dam site. The general topography of the basin is characterized by hills with rounded tops and steep slopes, mostly of which, are wooded.

The watershed is essentially rural and agriculturally oriented with approximately 24 percent of the project lands forested; primarily occurring on steep slopes and along the bottoms of narrow ravines. Urban and villages lands in Myerstown, Womelsdorf, Robesonia, Wernersville, and numerous smaller communities make up the remainder of the Blue Marsh Lake's drainage basin. Reading, which is the county seat, is located approximately 7 miles downstream of the Blue Marsh Dam at the confluence of the Schuylkill River and Tulpehocken Creek.

The project is located in the temperate northeast Atlantic Coast climatic zone, an area of frequent changing temperatures and moderate, year-round precipitation. Precipitation is relatively uniform throughout the year, averaging between about 6.4 and 10.3 percent per month of the yearly total

of 41.43 inches. Snowfall averages about 30 inches per year over the entire Tulpehocken watershed. Temperatures at Blue Marsh Lake area, during July and August have a daily maximum temperature above 80 degrees. From May through September, the daily average temperature approaches 70°F. These temperatures in conjunction with high humidity result in very hot summers.

3-02. Project Description. The principal features of the project are: a dam embankment, a spillway, an outlet works, a service building, an overlook, and two residences for the dam operator's use. Most of the Blue Marsh Lake projects approximately 5,500 acres of Federal land and water and 460 acres of state-owned land will be available for recreation and related uses. The dam is a rock-faced, earth-filled structure across the valley of the Tulpehocken Creek. The dam is about 1,775 feet long with a 30 foot graveled maintenance road along the entire length. The top of the dam is at elevation 332, twenty-five feet above the spillway crest, with 5.6 feet of freeboard above the peak spillway design flood pool. The spillway is an unlined channel through a natural saddle about 1,500 feet south of the dam. The channel is 300 feet wide and approximately 1,360 feet along the centerline. The sill is 300 feet wide, 30 feet long and extends from the crest elevation of 307 to elevation 323.

The outlet works consists of an approach channel, intake tower and service bridge, conduit, stilling basin and exit channel. The intake tower contains the operating house, intakes, gates to regulate intake flow and conduits to convey withdrawals through the dam embankment.

The reservoir, when filled to the recreation pool, elevation 290, is approximately 8.8 miles long and slightly over a mile at its widest point just north of the dam. The average depth is about 25 feet and a maximum depth of 56 feet (summer season pool) near the dam.

The recreation areas are located along the north bank of the reservoir which provide a bathing beach, change house with sanitary facilities, picnic areas and a boat launch area. A second boat launch area is located on the south bank near state hill. The recreation areas were built, maintained and operated by the Army Corps of Engineers. The service building, located on the east embankment near the dam structure, provides office space for management personnel and garage space for project vehicles and equipment.

3-03. Climate. ^{1/} The project is located in the temperate northeast Atlantic climatic zone, and is characterized by frequent changing temperatures and moderate amounts of precipitations. The area is subject to precipitation from normal rainfall, thunderstorms, and heavy rains associated

^{1/} Climatological Data, Blue Marsh Lake - 1979. TABLE 1.

TABLE 1
BLUE MARSH LAKE
CLIMATOLOGICAL DATA^{1/} - JAN - SEPT. 1979

MONTH	Precp. (inches)	Total Snow (inches)	Avg. Temp. (°F)	Highest Temp. (°F)	Lowest Temp. (°F)	Days With Precp.
JAN	10.27	9.1	27.6	61	6	21
FEB	5.01	4.2	20.5	49	-8	11
MAR	1.94	T	42.8	79	13	6
APR	4.12	0	49.5	79	26	11
MAY	5.04	0	62.1	91	34	14
JUNE	4.32	0	67.7	88	42	9
JULY	3.06	0	73.2	93	47	10
AUG	2.11	0	72.8	93	43	8
SEPT	6.30	0	64.7	89	38	10

^{1/} Extracted from the Monthly Summary Report- NOAA - Data collected at the Reading Station.

with hurricanes and snowfall. Based on records compiled by NOAA at Allentown, which is physiographically similar to the Blue Marsh Lake area; July and August have daily maximum temperatures above 80 degrees (F). From May through September average highs of 70°F have been recorded. Snowfall averages about 30 inches per year over the entire Tulpehocken watershed.

3-04. Dam and Lake Characteristics.

a. Embankment. The dam is a rock-faced, earth-filled structure across the valley of the Tulpehocken Creek, about 7 miles northwest of Reading. The top of the dam is surfaced with gravel to serve as a maintenance road. The top of the dam is at elevation 332 with the spillway located through a saddle about 1500 feet south of the dam. The spillway is an ungated structure with crest at elevation 307.

b. Outlet Works. The outlet works consists of an approach channel, intake tower and service bridge, conduit, stilling basin and exit channel. The intake tower contains the operating house, intakes, gates to regulate intake flow and conduits to convey withdrawals through the embankment.

c. Reservoir. The reservoir when filled to the recreation pool (El. 290), is approximately 8.8 miles long and slightly over a mile at the point of maximum width. The average depth is about 25 feet, and the maximum is 56 feet.

3-05. Geological Patterns. The rocks underlying the Blue Marsh Lake project were deposited as sediment nearly half a billion years ago. After consolidating into solid rock, they underwent folding, and in recent times, the folded strata was exposed by erosion.

Two major layers of sediment crop out beneath the soils of the Blue Marsh project. The Beekmantown limestone group is the older of the two, having been deposited during the lower Ordovician period some 480 to 500 million years ago. The younger rocks are collectively termed the Martinsburg Formation which were deposited during the middle and upper Ordovician period, about 480 to 440 million years ago.

The Beekmantown limestone has been exposed by the erosion of overlying shales in only one place within the project. At the crest of an anticline, the outcrop forms a 5,600 by 1,000 foot oval about 1,800 feet north of the dam. The bedrock in this exposure is encountered within 20 feet of the surface.

The Martinsburg Formation has two divisions; the lower shaly member which underlies most of the project, and the upper sandy member, which rests atop the lower section and underlies only the northwestern portion of the project. The rocks in both divisions occur in numerous layers. Most of the layers are composed of some kind of shale, but beds of sandstone, limestone and conglomerates also occur. The depth to Martinsburg bedrock varies, but generally averages only 2 to 3 feet. The overburden is somewhat thinner on the ridges and steep slopes but may reach depths as high as 6 feet or more in a few level areas.

3-06. Soils. ^{1/} The majority of the project's soils are of three series and types. Weikert-Berks shaly silt loam covers about 40 percent of project lands above elevation 290, Litz shaly silt loam covers about 20 percent, and Berks shaly silt loam, about 15 percent. All tend to be somewhat dry, to contain many shale fragments and to be relatively shallow over bedrock.

3-07. Vegetation. Nearly all relatively flat lands and slopes under 15 percent have been cleared and farmed - principally for grass, hay, grain and corn to sustain dairy operations. Woodlands presently account for about 1,400 acres or 24 percent of project lands. They occur primarily on steep slopes and along the bottoms of narrow ravines. The dominant tree species are red oak and white oak. Other major components include black oak, chestnut oak, several hickory species, beech, tulip, hemlock, flowering dogwood, black cherry, white ash, black locust, sassafras, juneberry and red maple.

3-08. Land Use. The Blue Marsh Lake Park comprising of 5,500 acres of Federal Land and water will provide public use areas to accommodate 250,000 recreationists annually. The public use areas presently in use are for picnicking, boating, swimming and hiking. The park and its public use areas were constructed by the U. S. Army Corps of Engineers in 1978 and dedicated in July 1979. The park is managed, operated and maintained by Corps personnel.

The Pennsylvania Fish Commission stocked the lake in 1979 with various types of game fish and is also responsible for lake management. Management of adjacent lands are under the jurisdiction of the Corps. Most of remaining lands in the watershed are devoted to farming and other closely related pursuits such as orcharding and timbering.

SECTION IV - WATER QUALITY DATA

4-01. Purpose of Sampling Program. The purpose of taking water samples is to establish a base line inventory of water quality parameters within the areas influencing and influenced by the lake.

The data that will be collected and documented will be useful in determining the kind of pollutants that may occur in the watershed and within the lake environment. From this date, the Corps through the Pennsylvania (DER), can initiate corrective action to control or minimize these sources of pollution. It is the Corps' intent to develop a meaningful water quality program and to conform with the Pennsylvania (DER) standards as outlined in Chapter 93, Water Quality Criteria.

4-02. Testing Procedures and Equipment. The U. S. Geological Survey has conducted pre-impoundment studies ^{1/} _{2/} at the Blue Marsh Project for the Corps. Those investigations dealt with the Biological, Chemical and Physical aspects of the proposed project.

Beginning with the spring of 1979, and filling of the lake, the U. S. Geological Survey initiated a program of collecting lake water samples at prescribed levels at four points within the lake and two points downstream of the dam. These samples were analyzed for chemical, biological, bacteriological constituents; - sediment and bed material, for heavy metals.

1/ Water-Quality Study of Tulpehocken Creek - Water Resources Investigations, 77-55, Bacteriological Water-Quality of Tulpehocken Creek Basin Water
2/ Resources Investigations, 78-53, April 1978.

The Philadelphia District initiated lake stratification testing in June 1979. The parameters tested for were dissolved oxygen, pH, temperature and specific conductance. The data results are tabulated in (Appendix A) of this report.

4-03. Data Available. ^{1/} Considerable data has been collected and documented for future use in project regulation, pollution detection and to initiate protective measures to stream inflows and lake waters to conform with Pennsylvania (DER) Regulations, Chapter 93. Beginning in June 1979, a water quality management program was initiated through contract services with lake stratification testing conducted by the Philadelphia District.

Stratification testing indicated anerobic conditions throughout the lake extending from 4 meters to 14 meters below the surface waters, with 0.0 dissolved oxygen readings observed. This condition improved with time and on 23 October 1979, a dissolved oxygen reading of 7.9 was recorded at the site in front of the dams. This condition is typical of new lakes and should stabilize with time. Extensive growth of pond weeds and algae were observed at the inlet with (upper lake) during the monitoring program. The analysis of water samples suggest the Tulpehocken Creek basin to be a highly fertile environment, evidently caused by runoff which contain large volumes of dissolved fertilizer and animal matter.

Major stream inflows will be included in future sampling and will be analyzed for dissolved oxygen, conductivity, pH, phosphorous, total dissolved solids, nitrate, nitrite, ammonia, temperature and bacteria.

On the basis of this accumulated data, the Philadelphia District will evaluate and apply this information in the future management of Blue Marsh Lake.

The Environmental Branch will continue coordination efforts with the Pennsylvania (DER) for the purpose of continuing their assistance in conducting Biological and Chemical Surveys of stream inflows and lake waters at the Blue Marsh Project.

Fecal coliform samples were collected at the beach waters by the U. S. Geological Survey and analyzed at their facilities. The current fecal coliform standards for swimming beaches is 200 fecal coliforms per 100/ml of sample and this was not exceeded during the 1979 testing period at Blue Marsh Lake.

Since Blue Marsh Lake is relatively new and the water quality data documented to date insufficient, it is problematic to draw precise conclusions regarding water quality conditions at this time. The indications are that minor problems were encountered in algae proliferation in the upper lake area and anerobic conditions were recorded at bottom depths.

4-04. WATER CHEMISTRY

a. Nitrogen and Phosphorous: The concentrations of nitrogen and phosphorous necessary at the beginning of the growing season to produce nuisance populations of algae were suggested by Sawyer (1974) to be 0.30 and 0.015 mg/l respectively.

In Tulpehocken Creek concentrations of nitrogen and phosphorous exceeded Sawyer's critical values in all of the samples collected within the lake site (fig. 1 and 2). Median concentrations of nitrate-nitrogen and total phosphorous near the dam site were 4.5 and 0.13 mg/l, respectively. Nutrient concentrations were higher during periods of runoff.

The load of nitrogen and phosphorous at various discharges is plotted in figures 3 and 5. Based upon flow duration, the annual input of nitrogen to the lake is about 1,400 tons (1,270 metric tons) or 8 tons (7.3 metric tons) per square mile, and the annual input of phosphorous is 46 tons (41.7 metric tons) or 0.26 tons (0.24 metric tons per square mile).

b. Dissolved Oxygen. The concentration of dissolved oxygen in water in equilibrium with the atmosphere, depends on temperature and dissolved-solids content of the water. The solubility of dissolved oxygen increases as temperature and dissolved solids decreases. The State has established the minimum dissolved-oxygen concentration necessary for maintaining healthy aquatic life in Tulpehocken Creek as 5.0 mg/l and a daily mean not less than 6.0 mg/l. Minimum values at all five stations (Figure 4) exceeded these standards, and although it is probable that the daylight sampling program has not disclosed the true minimum values, the criteria are undoubtedly met at all five sampling sites.

An analysis of the dissolved oxygen saturation curves for Tulpehocken near Blue Marsh Dam site discloses that saturation was succeeded 87 percent of the time, indicating a high rate of photosynthesis of aquatic plants and a low biochemical oxygen demand (BOD).

Stratification monitoring ^{1/} which began in June 1979 revealed that anerobic conditions existed from approximately 4 meters to lake bottom throughout the lake until the middle of October. This condition improved during October as indicated by a dissolved oxygen reading of 7.9 and better at the lake bottom near the dam and throughout the lake. Dissolved oxygen readings showed a marked improvement at all four test sites and met the standards as published in Chapter 93, Water Quality Criteria, Pennsylvania DER.

d. pH. The pH range for the maintenance of good game fish production should be between 6.5 and 8.5. Our testing program (Appendix A) indicated that the criteria established by Pennsylvania DER were met and slightly exceeded at all lake stations during 1979. This could be contributed by the bicarbonate derived from limestone of the upper Tulephocken and Spring Creek basin and is responsible for the high buffering capacity of the water and for maintaining a pH generally between 7.5 and 8.5 throughout the lake.

e. Total Dissolved Solids (TDS) and Specific Conductance

Specific conductance is a measure of the ability of a unit volume of material to conduct electric current. In water, this ability is directly related to the concentration of ions and therefore to the concentration of dissolved solids.

Water-quality criteria for Blue Marsh Lake, (Pennsylvania DER Standards, Chapter 93), require that the montly average must not exceed 500 mg/l dissolved solids and must not exceed 750 mg/l at any time. Specific conductance data (Appendix A) indicate that these criteria are being met at all four testing sites within the lake.

^{1/} APPENDIX A - Blue Marsh Lake Stratification Testing - Philadelphia District.

4-05. COLIFORM SAMPLING

The coliform counts at Blue Marsh remained within the limits established by the Pennsylvania (DER) of no more than a geometric mean of 200 colonies per 100 millimeters of sample for total coliform. The highest count follows a period of rain, particularly after a prolonged dry spell, indicating that runoff carries material into the water rather than from point sources. The following test results of bacteria were recorded on 18 September and 23 October 1979, at Blue Marsh Lake.

BLUE MARSH LAKE

Site	FE/100 ml	F.S./100 ml	Date
Beach (west)	26	40	18 Sep 79
Water Surface at Spillway	6	1	"
Middle Lake Surface	3	2	"
Spring Creek Surface	12	4	"
Inflow Surface	43	44	"
Sluice Gate Outlet	18	23	"
Spillway	3	2	23 Oct 79
Mid Lake	3	14	"
Spring Creek	5	1	"
Inflow	1100	1600	"

Fecal coliform standards of 200 per 100 ml for bathing waters was not exceeded at the beach area during 1979. However that standard was exceeded at the inflow (upper lake) on 23 October 1979. It appears that the Fecal and Fecal Strep data as cited above indicates that tremendous die off of bacteria occurs between the inflow and the beach area, a distance of approximately 8 miles.

4-06. ALGAE. The potential for algae bloom remains high particularly in the upper reaches of the lake.

Concentrations of nitrogen and phosphorous exceed minimum values suggested by Sawyer (1947) as critical for the nuisance growth of aquatic plants at all stations (Plate 2) and in all samples, and was highest after storm runoff. Based upon estimates from flow duration curves (Figures 3 and 5), the annual input of nitrogen and phosphorous to the lake is about 1,400 tons and 46 ton respectively.

SECTION V - INTERPRETATION OF DATA

5-01. General Post-Impoundment Conditions. Blue Marsh Lake does not have an acid problem. The bicarbonate derived from limestone of the upper Tulpehocken and Spring Creek basins, is responsible for the high buffering capacity of the water. As a result, pH readings between 7.5 and 8.5 are found throughout the lake at lower levels. However, for the most part, pH readings between 9.0 and 9.5 are found at the surface and 1 meter below the surface. Since the lake didn't fill till September 1979, it can be assumed that mixing hadn't occurred to the point where pH readings would stabilize.

Algae problems occurred in the upper reaches of the lake during August and September with green algae the dominant species. This condition was the result of excessive nutrient inflows and the hot weather which prevailed during this period. It was noted that the lake cleared in October 1979 and the algae infestation was reduced considerably.

Analysis of data ^{1/} collected by the Philadelphia District and U. S. Geological Survey indicates that the water quality of lake waters meets the standards as set forth in the Clean Streams Law, ref. Title 25, Chapter 93. Documented data indicates that generally throughout the summer season, water quality remained good and is acceptable for recreational pursuits.

5-02. Fishery. Blue Marsh Lake is expected to be primarily a walleye-bass lake with crappies, the principal forage fish.

^{1/} APPENDIX A - Stratification Testing

Tiger muskellunge, which were also stocked, will provide excellent future sport fishing opportunities throughout the lake. Both largemouth and smallmouth bass exhibited tremendous growth from May through September 1979, with very low mortality rates. Fishermen contacted expressed deep satisfaction with the quantity and size of fish that were taken.

The Pennsylvania Fish Commission is responsible for the stocking management and patrol of the Blue Marsh Lake. The Commission's fish stocking program began in May 1979 and has progressed quite satisfactorily this past year.

1979 - PENNSYLVANIA FISH STOCKING PROGRAM

Largemouth Bass Fry	400,000	May 1979
Walleye Fry	25,000	June 1979
Crappies, fry	15,000	July 1979
Channel Catfish, fry	75,000	July 1979
Largemouth Bass, fry	5,000	August 1979
Tiger muskellunge, fry	7,000	October 1979

5-03. Coordination Efforts With Other Federal and State Agencies.

The Philadelphia District requested the U. S. Geological Survey to perform Chemical, Biological, Bacteriological, Physical and Sedimentation Studies for Blue Marsh Lake for FY 1980. Partial data ^{1/} has been recorded and the balance of the study, in the form of a report, will be submitted to the Corps during September 1980.

1/ Appendix A - Stratification Data.

Pennsylvania (DER), Bureau of Water Quality, has been contacted in an attempt to secure their services to collect and analyze water samples from the major tributaries of the Blue Marsh Lake. An attempt will also be made to initiate a macroinvertebrate and benthic invertebrate study on these same streams.

SECTION VI - RECOMMENDATIONS AND PROPOSED STUDIES

6-01. General. The following recommendations and proposals are made relative to the water quality management and control at Blue Marsh Lake.

a. Maintain present sampling frequency to maintain a close surveillance over the water quality in the lake.

b. Establish tributary and downstream sampling and monitoring for dissolved oxygen, pH, nitrate, nitrite, ammonia, total dissolved solids, ions, total phosphate, specific conductance and bacteria.

c. Coordinate Corps Monitoring activities with Pennsylvania DER's and attempt to secure PA. DER's Water Quality Section to initiate Macro-invertebrate and Benthic Invertebrate studies in the tributaries of the Blue Marsh Lake.

d. Correlate data collected from other agencies and establish their sampling points, procedures and equipment used for testing.

e. Continue close cooperation with the Pennsylvania Fish Commission in the management of Blue Marsh Lake and initiate improvement of fish habitat both in the lakes and downstream from the dam sites.

f. Maintain a permanent record system of data on hand and other data obtained from all other sources. Such data will be used as a management tool and provide a means for evaluating water quality trends.

6-02. Findings and Conclusions. The water sampling program will be expanded to include tributary and downstream monitoring beginning in September 1981.

Bacteriological monitoring will be initiated in April 1980, particularly at the beach area, for compliance with Pennsylvania DER standards for public bathing areas.

Documented data ^{1/} collected on water quality for Blue Marsh Lake from June through October 1979 indicates that the quality of water remains within the standards established by Pennsylvania DER. During periods of heavy precipitation, there is slight increase in nutrient enrichment and bacteria counts, but this condition dissipates rather quickly with no apparent detrimental effect on water quality.

Previous studies indicate that bicarbonate derived from limestone of the upper Tulpehocken and Spring Creek basin is responsible for a high buffering capacity of the water and for monitoring a pH of 7.5 and 8.5 in the Blue Marsh Lake. In some cases, the Corps testing program indicated pH readings of 9.0 and better.

Secchi readings, (Appendix B) were below average indicated moderate growth of algae and weeds, apparently due to the nutrient enrichment of lake waters caused by runoff.

^{1/} Appendix A - Stratification Testing

6-02.(a). FUTURE TRENDS.

Blue Marsh is rather new, therefore, it is difficult to predict future water quality trends since the lake has not stabilized and there is insufficient recorded data for predictive analysis.

The Philadelphia District began its water quality testing program in June 1979. This program will continue and will be expanded to include other parameters presently not included. It is also planned to add bacteriological testing at the beach area and tributaries to the lake waters. Samples for chemical and bacteriological analysis will be collected from various depths at random times during the year and analyzed at Pennsylvania's (DER) laboratories in Harrisburg.

It appears, according to 1979 observations of lake water, that algae and pond weeds may become a future lake problem. Future management efforts should address this problem and recommend proper control methods to minimize these conditions.

6-02.(b). Water Supply. The Delaware River Basin Commission (DRBC) and the United States of America agreed to a contract for certain Water Storage space in the Blue Marsh Reservoir. Western Berks Water Authority is presently under contract with the DRBC to take water from the stream until such time as the Authority may elect to connect into the water supply system at the Blue Marsh Dam. The Authority is presently securing its water from the stream, which meets the quality standards as established by Pennsylvania DER, Chapter 93, Water Quality Criteria.

The forty-eight inch water supply pipe is presently not available for direct withdrawal. This unfavorable feature results in a partial water release tower capacity and can cause anoxic conditions at lower lake depths. To aid in limiting this condition, it is suggested to uncap the 48" water supply pipe, install a small auxiliary basin and an energy dissipation device. Either or both sides of the outlet works could then be used to meet reservoir regulation.

6-02.(c). Conclusion.

The data recorded from the 1979 water quality testing program at Blue Marsh Lake suggest that the lake exhibits a nutrient rich environment. Nitrogen and phosphate levels were moderately elevated; but the long term effect of this is not known since sufficient data is lacking at this time to draw predictive conclusions.

The testing program revealed zero dissolved oxygen levels throughout the lake from approximately four meters below the surface to fourteen meters in the deepest areas. This anerobic condition existed until October 1979. Lake turnover took place about this time as indicated by improved dissolved oxygen readings of 7.0 to 8.0.


The proliferation of algae and pond weeds may become a future problem with time. Close monitoring of this condition will be necessary to determine timing and the application of proper control measures. Any control measures will have to be coordinated with the Pennsylvania Fish Commission and the


Pennsylvania Bureau of Water Quality.


Limited testing for bacteria levels indicate a wide fluctuation of infestation undoubtedly caused by heavy runoff. It appears that the travel time of water from the upper reaches to the beach area was instrumental and the cause of bacterial dieoff. According to bacteriological data recorded from waters at the beach area; the coliform counts were within the limits established by Pennsylvania (DER) for public bathing areas.

APPENDIX A

BLUE MARSH LAKE STRATIFICATION TESTING

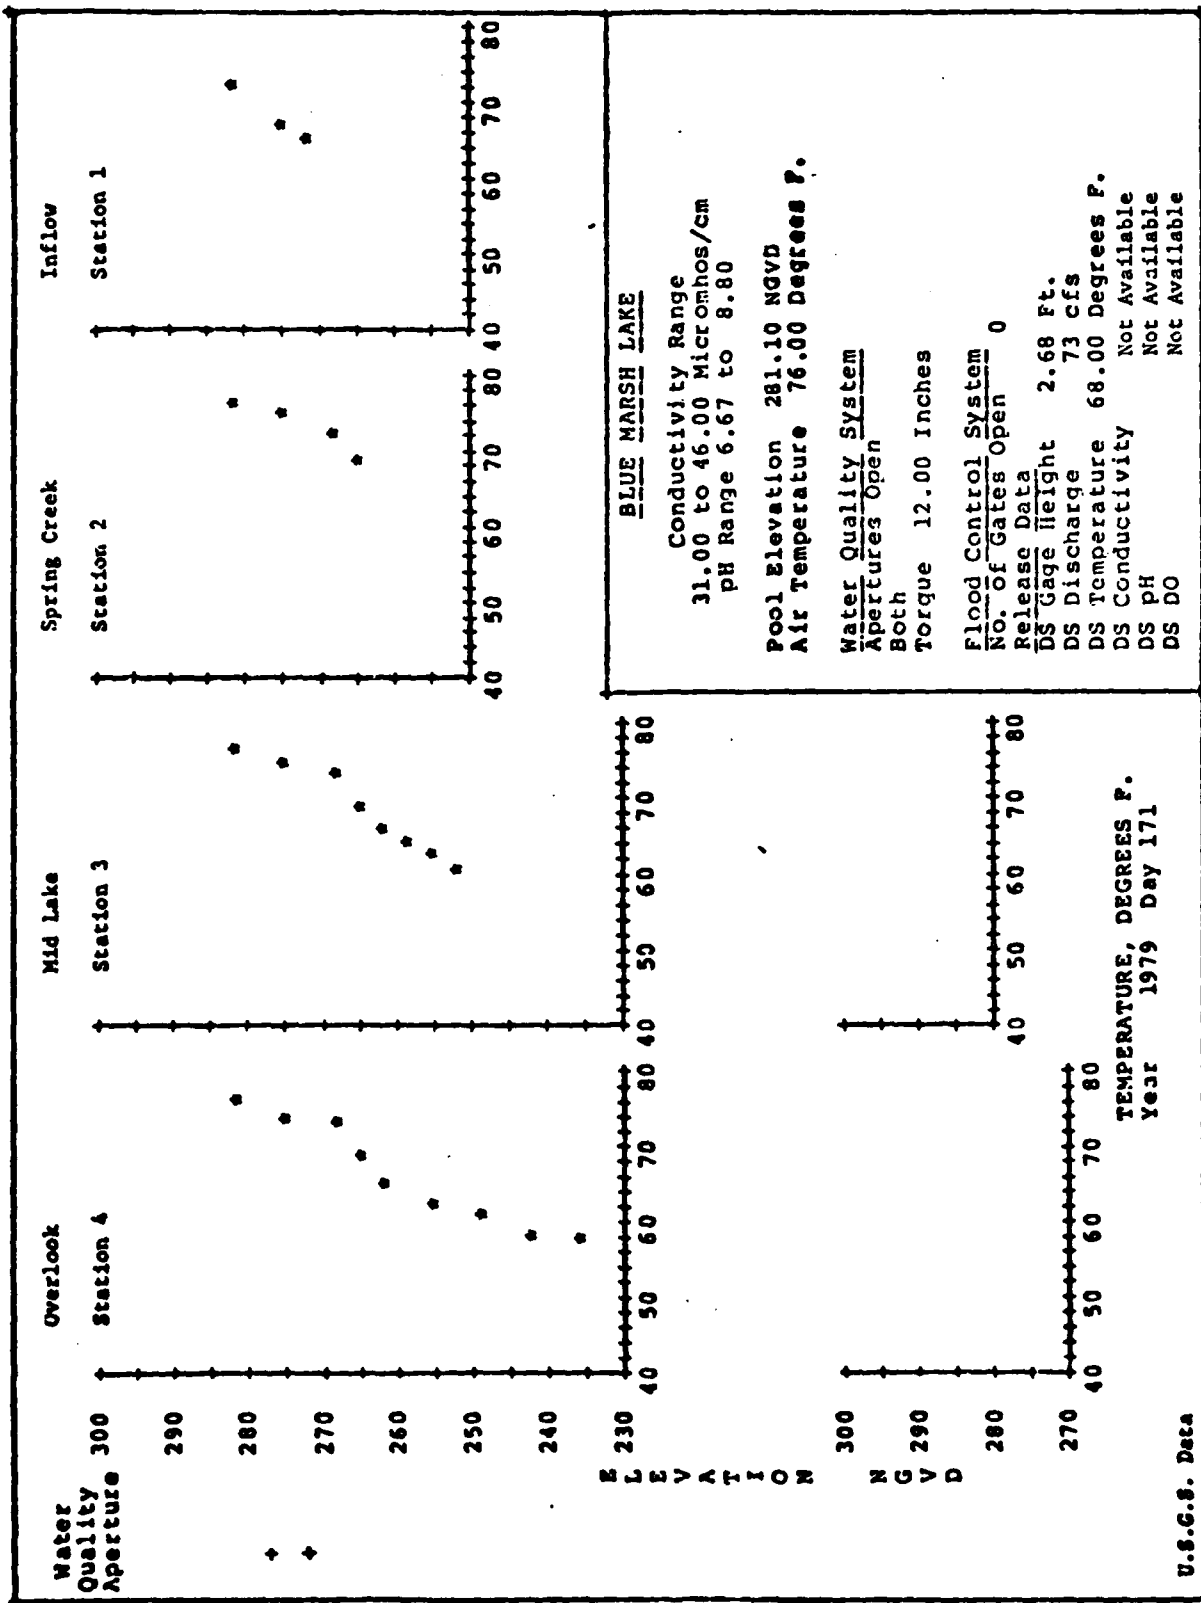

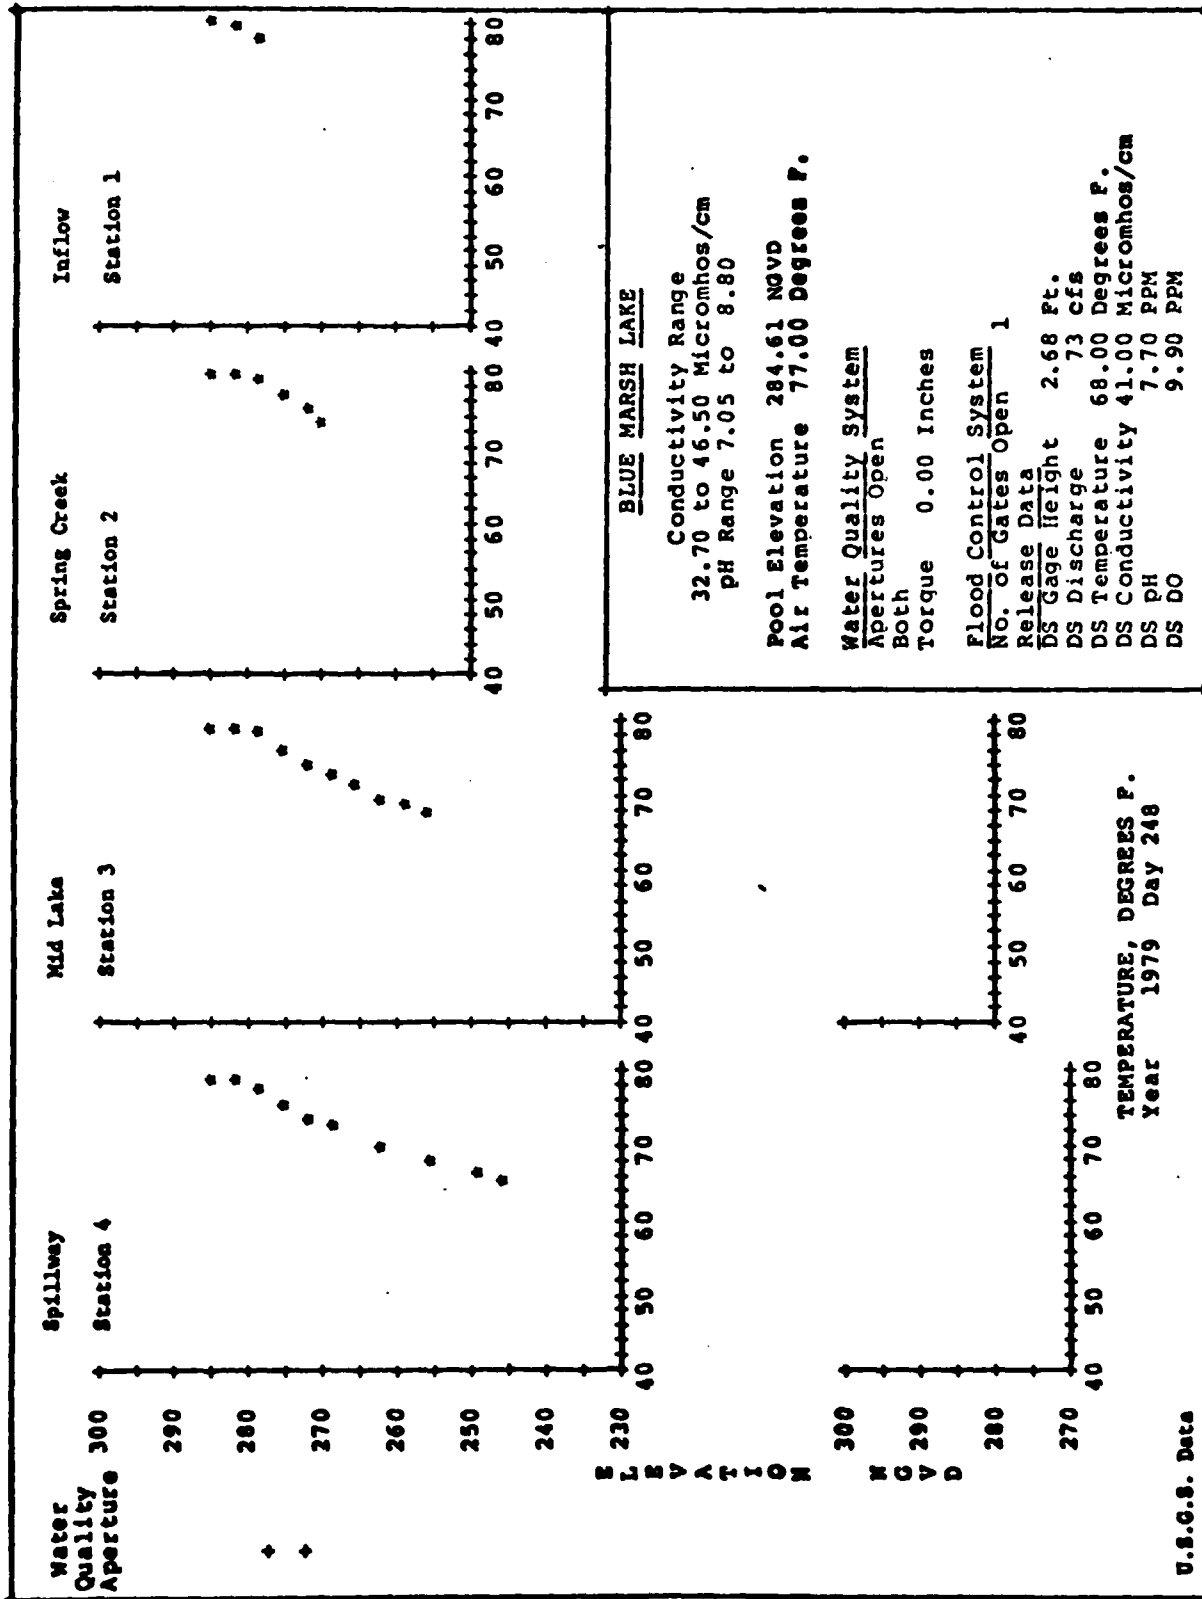

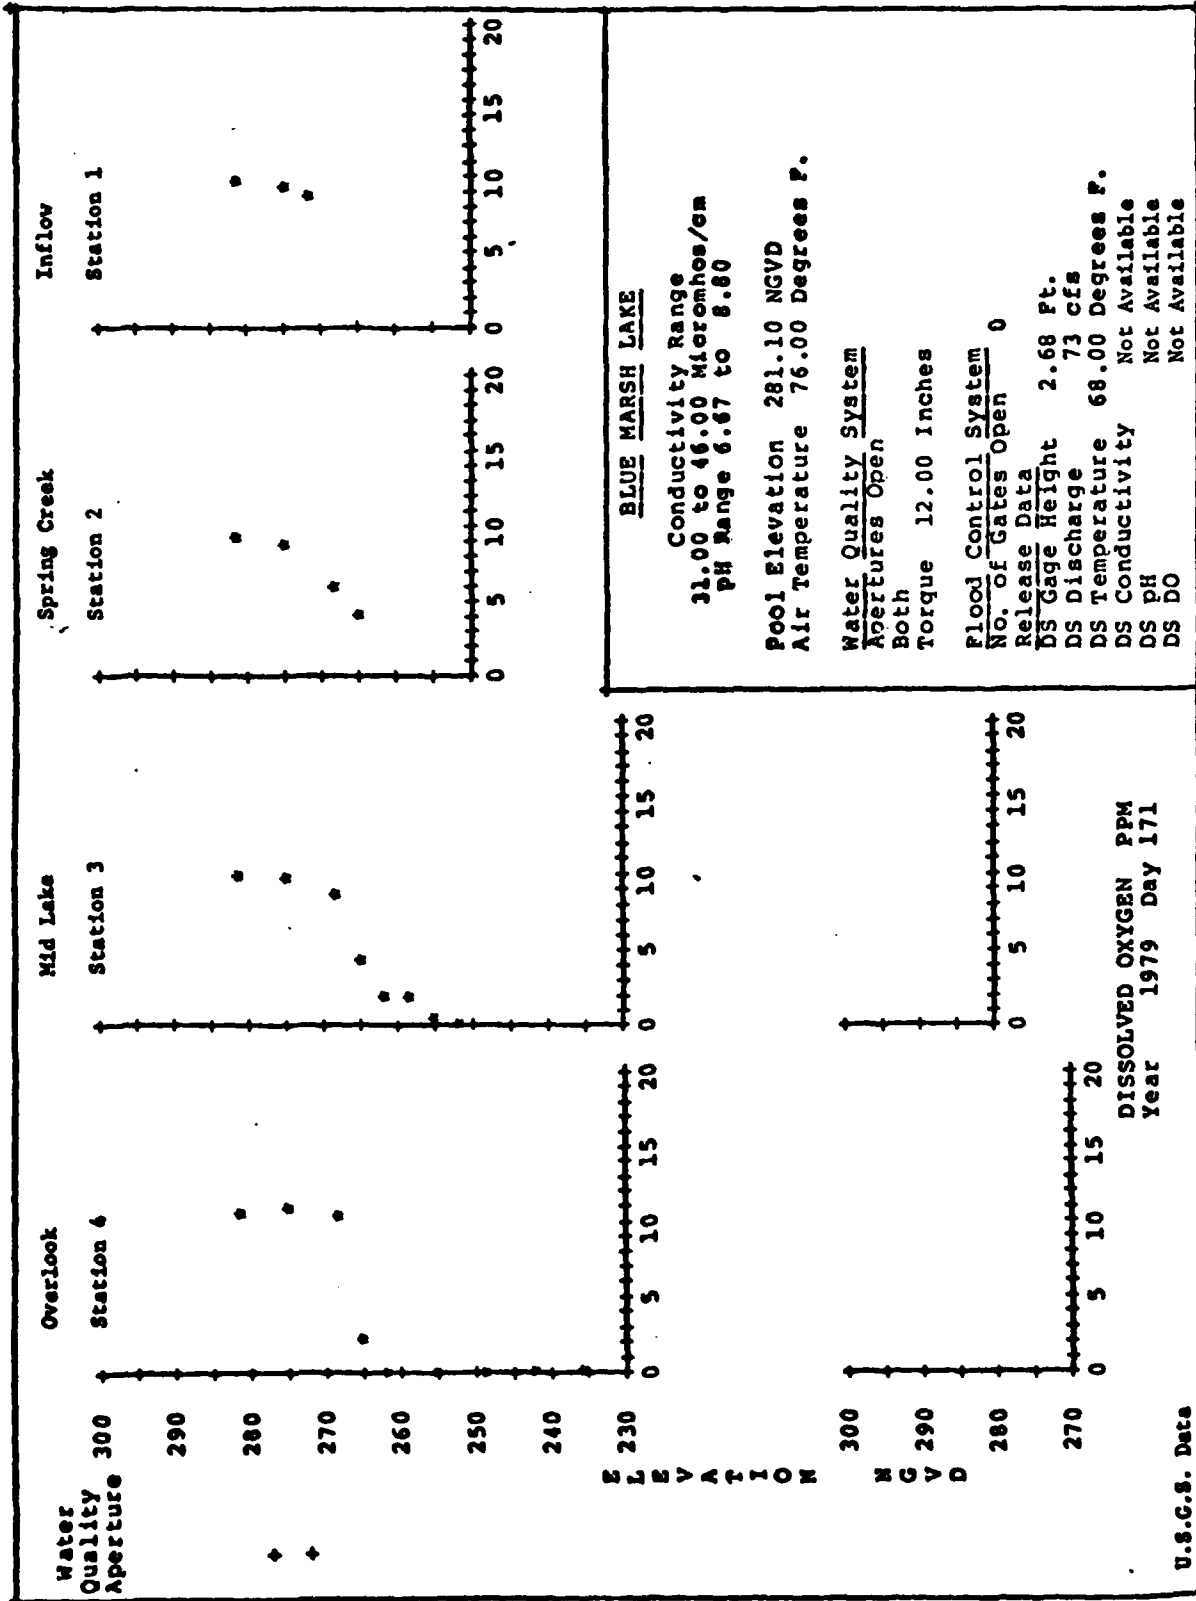

A 4

A-5

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH Party: Barker Lakatos

Station: 2 Location: SPRING CREEK

Date: 20 JUNE 79 Time: 1215 S.D. _____

Weather: *HOT, SUNNY*

Comments: _____

[illegible]

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH Party: JB, RB, JL.


Station: SITE 1 Location: 1300


Date: 20 JUNE Time: 1300 S.D.

Weather: HOT & SUNNY

Comments: Fecal coliform bacteria - 240/100 ml.

[illegible]

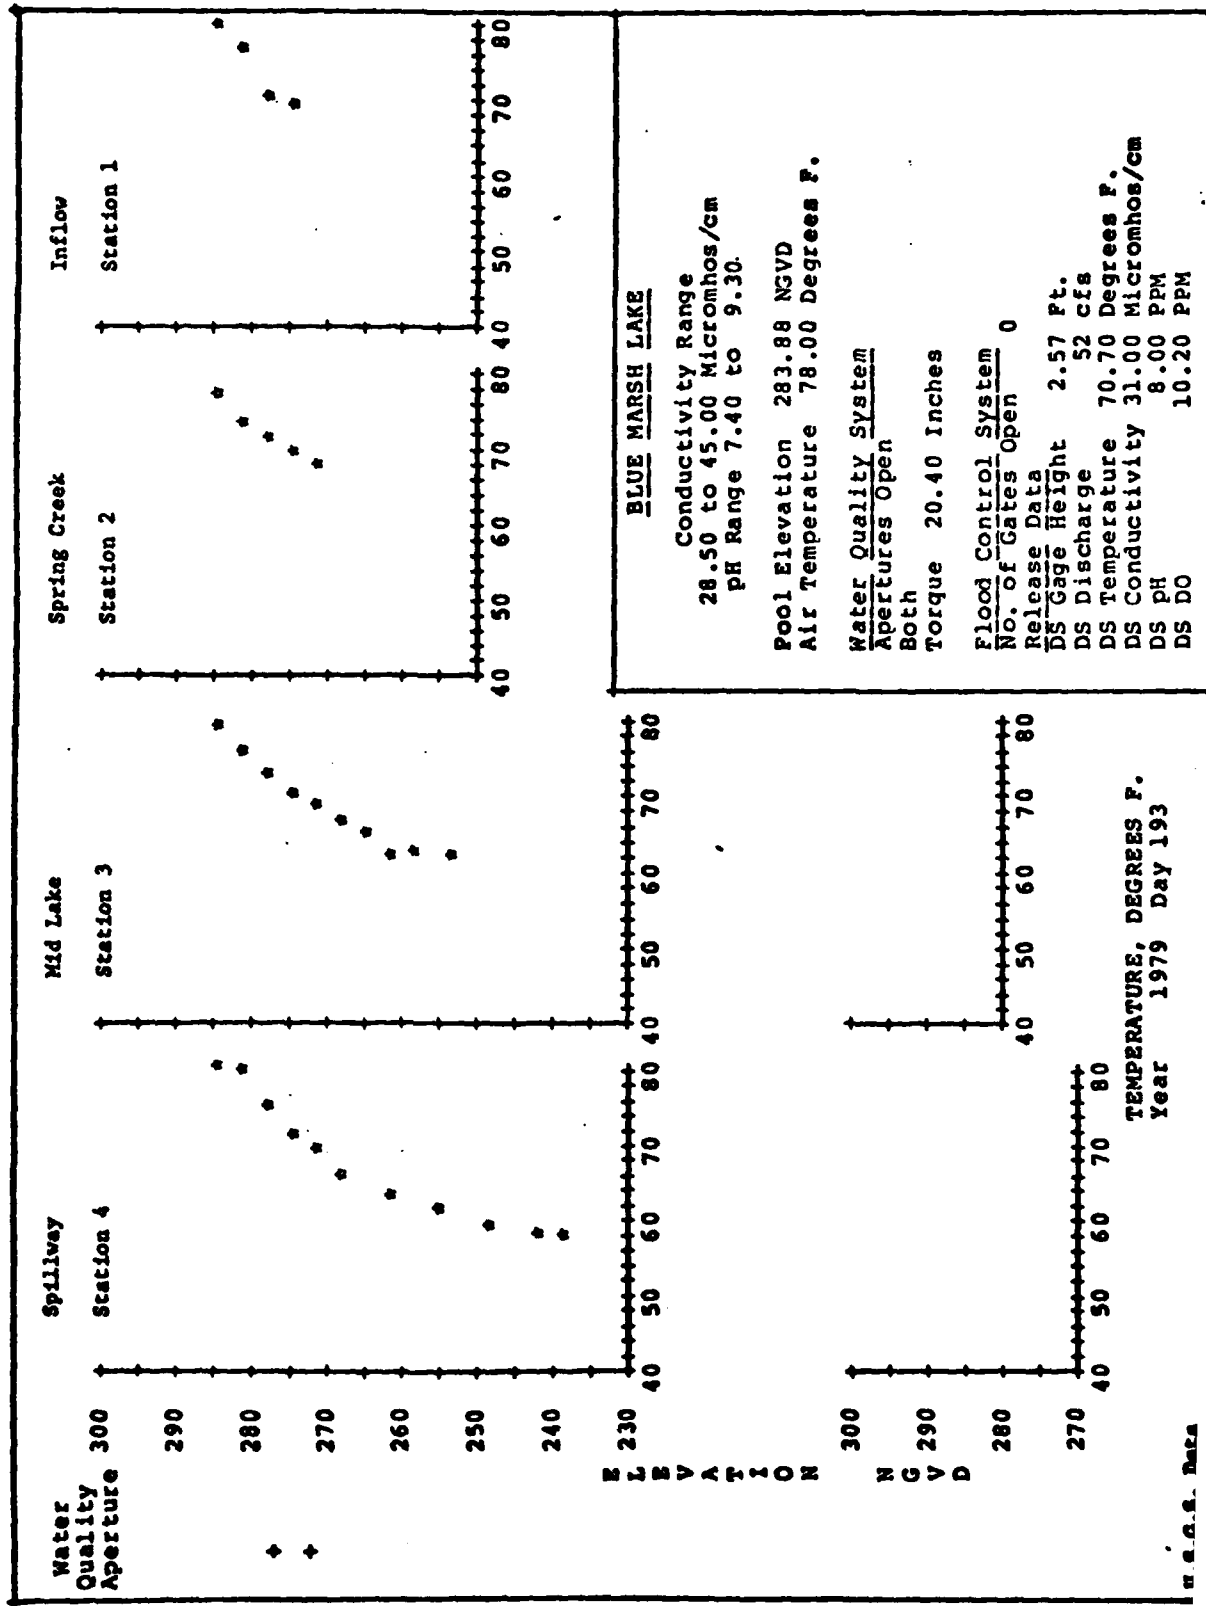

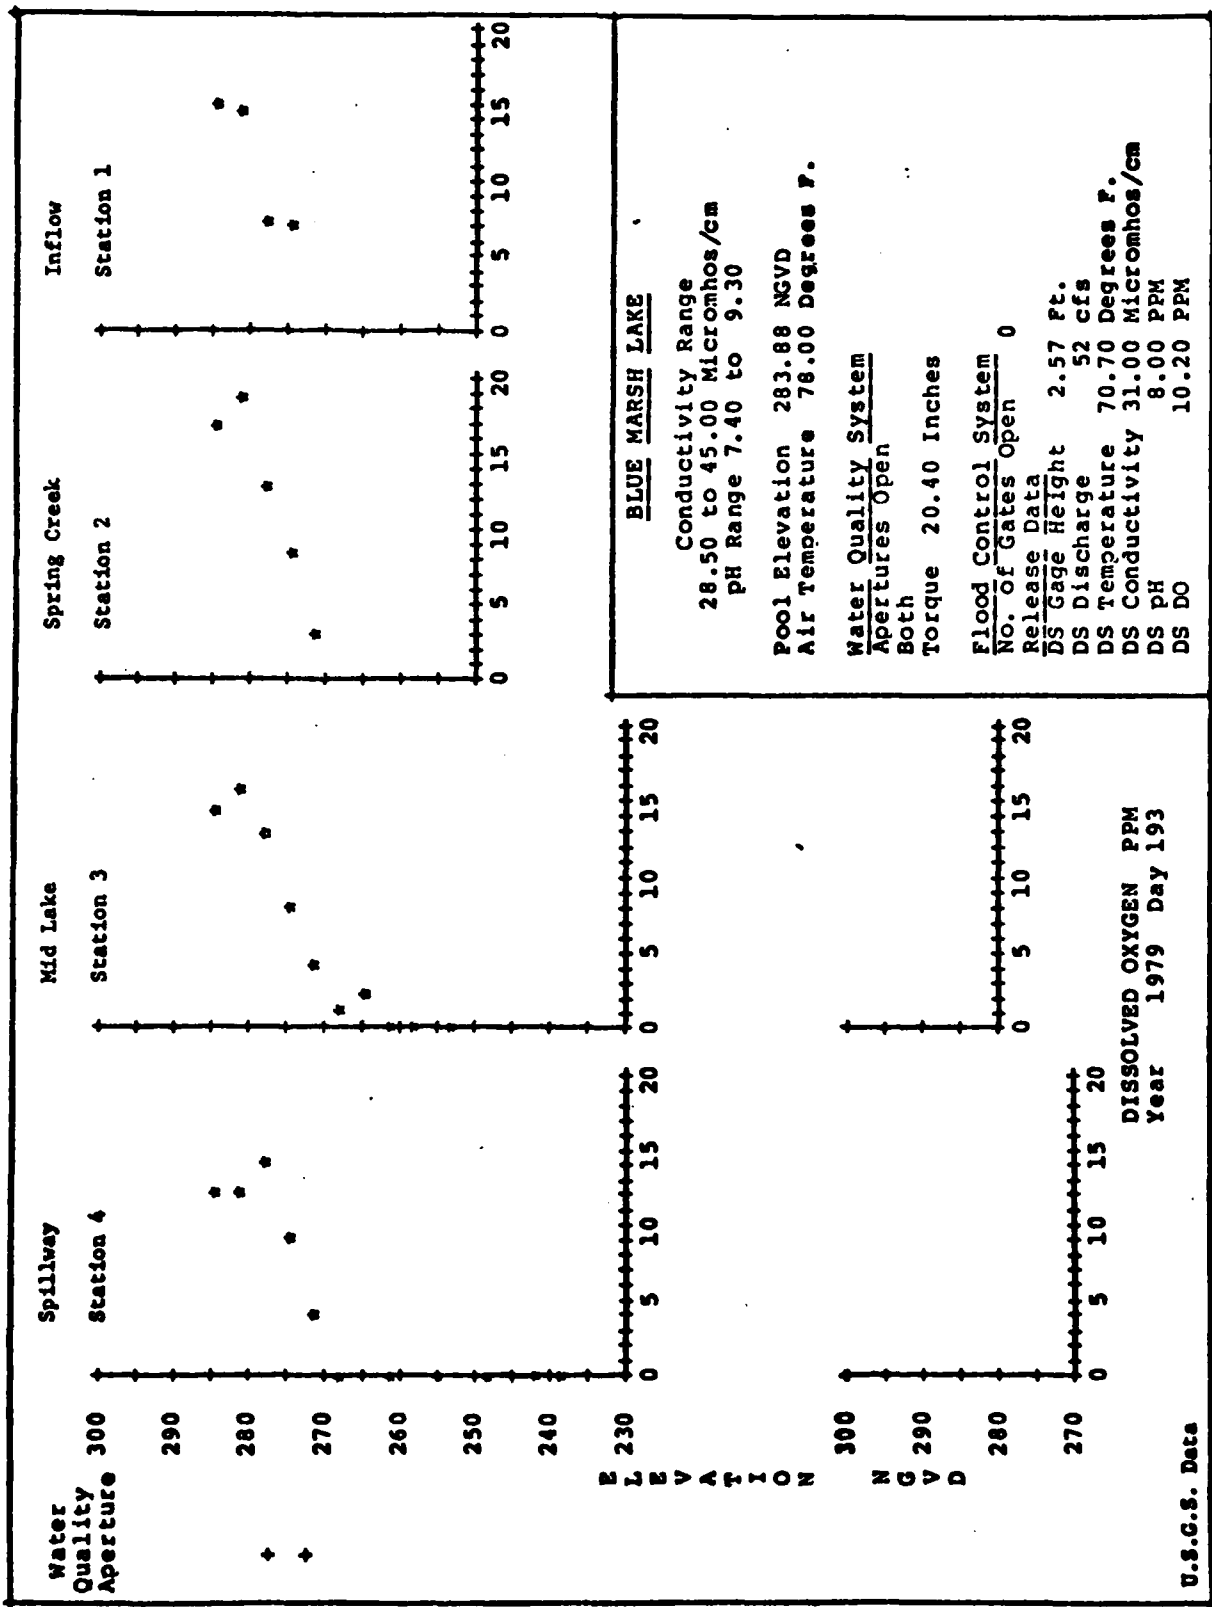

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH LAKE Party: Barker

Station: 4 Location: Spillway Pool

Date: 7-12-79 Time: 1500 S.D. 71"

Weather: _____

Comments: _____

Depth ft (m)	Temp °C	Cond mhos/cm	DO (mg/l)	pH	D.O. % Sat.	JTUS			
0	27.0	305	12.2	9.0	150				
1	26.7	305	12.2	9.2	150				
2	24.0	305	14.2	9.2	165±				
3	22.0	312	9.2	8.8	105				
4	21.0	340	4.0	7.9	44				
5	19.0	364	0.0	7.4	0				
7	17.5	360	0.0	7.6					
9	16.5	340	0.0	7.6					
11	15.3	349	0.0	7.6					
13	14.7	361	0.0	7.5					
14	14.5	365	0.0	7.6					

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH LAKE Party: Barker

Station: 3 Location: Mid-Lake

Date: 7-12-79 Time: 1430 S.D. 70°

Weather: _____

Comments: _____

Depth FT (A)	Temp °C	Cond mhos/cm	DO (mg/l)	pH	D.O. % Sat.	JTUS		
0	26.5	300	14.4	9.1	165 ±			
1	24.7	302	15.7	9.3	170 ±			
2	23.0	310	12.9	9.2	150			
3	21.5	327	8.0	8.5	90			
4	20.7	358	4.2	7.7	47			
5	19.5	387	1.2	7.6	12			
6	18.5	410	2.2	7.7	22			
7	17.0	385	0.0	7.55	0			
8	17.2	385	0.0	7.6	0			
9 1/2	17.0	385	0.0	7.55	0			

FIELD REPORT SHEET

Station Name Lake Mead G. & Blue Mesa Ridge

Station Identification No. 01470960 Y 79 M 07 D 12 Time 1600
 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32


Collected by PLS-L Incubation started _____ hrs.


Measurements				Observations*			
0 0 0 6 0 53.3 cfs		0 0 0 6 5 2.58 ft		0 1 3 4 5 0 0 0		0 1 3 4 0 0 0 0	
Discharge		Gage height		Floating debris		Dead fish	
0 0 0 2 0 °C		0 0 0 1 0 23.9 °C		0 1 3 1 0 0 0 0		0 1 3 3 0 0 0 0	
Temp.-Air		Temp.-Water		Gas bubbles		Atmospheric Odor	
0 0 4 0 0 8.0		0 0 0 9 5 30 μhos		0 1 3 3 5 0 0 0		0 1 3 5 0 0 0 0	
pH		Spec. Cond.		Floating sewage		Turbidity	
0 0 3 0 0 10.2 mg/l		3 1 5 0 1 col/100		0 1 3 2 5 0 0 0		0 1 3 0 5 0 0 0	
DO		Tot. Coliform		Algae mats		Detergent suds	
3 1 6 1 6 col/100				0 1 3 2 0 0 0 0		0 1 3 5 5 0 0 0	
Fecal Coliform				Floating garbage		Ice-floating or solid	
				0 1 3 0 0 0 0 0		0 1 3 1 5 0 0 0	
				Oil-grease		Fecal sludge	
				0 1 0 0 0		0 1 0 0 0	

*Coding for severity: 0 = None, 1 = Mild, 2 = Moderate, 3 = Serious, 4 = Extreme.

REMARKS: (More observations: color, weather, etc.)

es collected	Filt.	Unfilt.	Samples collected	Filt.	Unfi
allon			4 ounce		
irt			4 oz.-fixed (HCl ₂ , HCl, HNO ₃)		
-fixed (H ₂ SO ₄ , NaOH, H ₃ PO ₄ -CuSO ₄)			Sediment		
ice			Radiochemical		
ice-fixed (HCl ₂ , H ₂ SO ₄)			Pesticide		
TOTAL COLIFORM volume and count			FECAL COLIFORM volume and count		

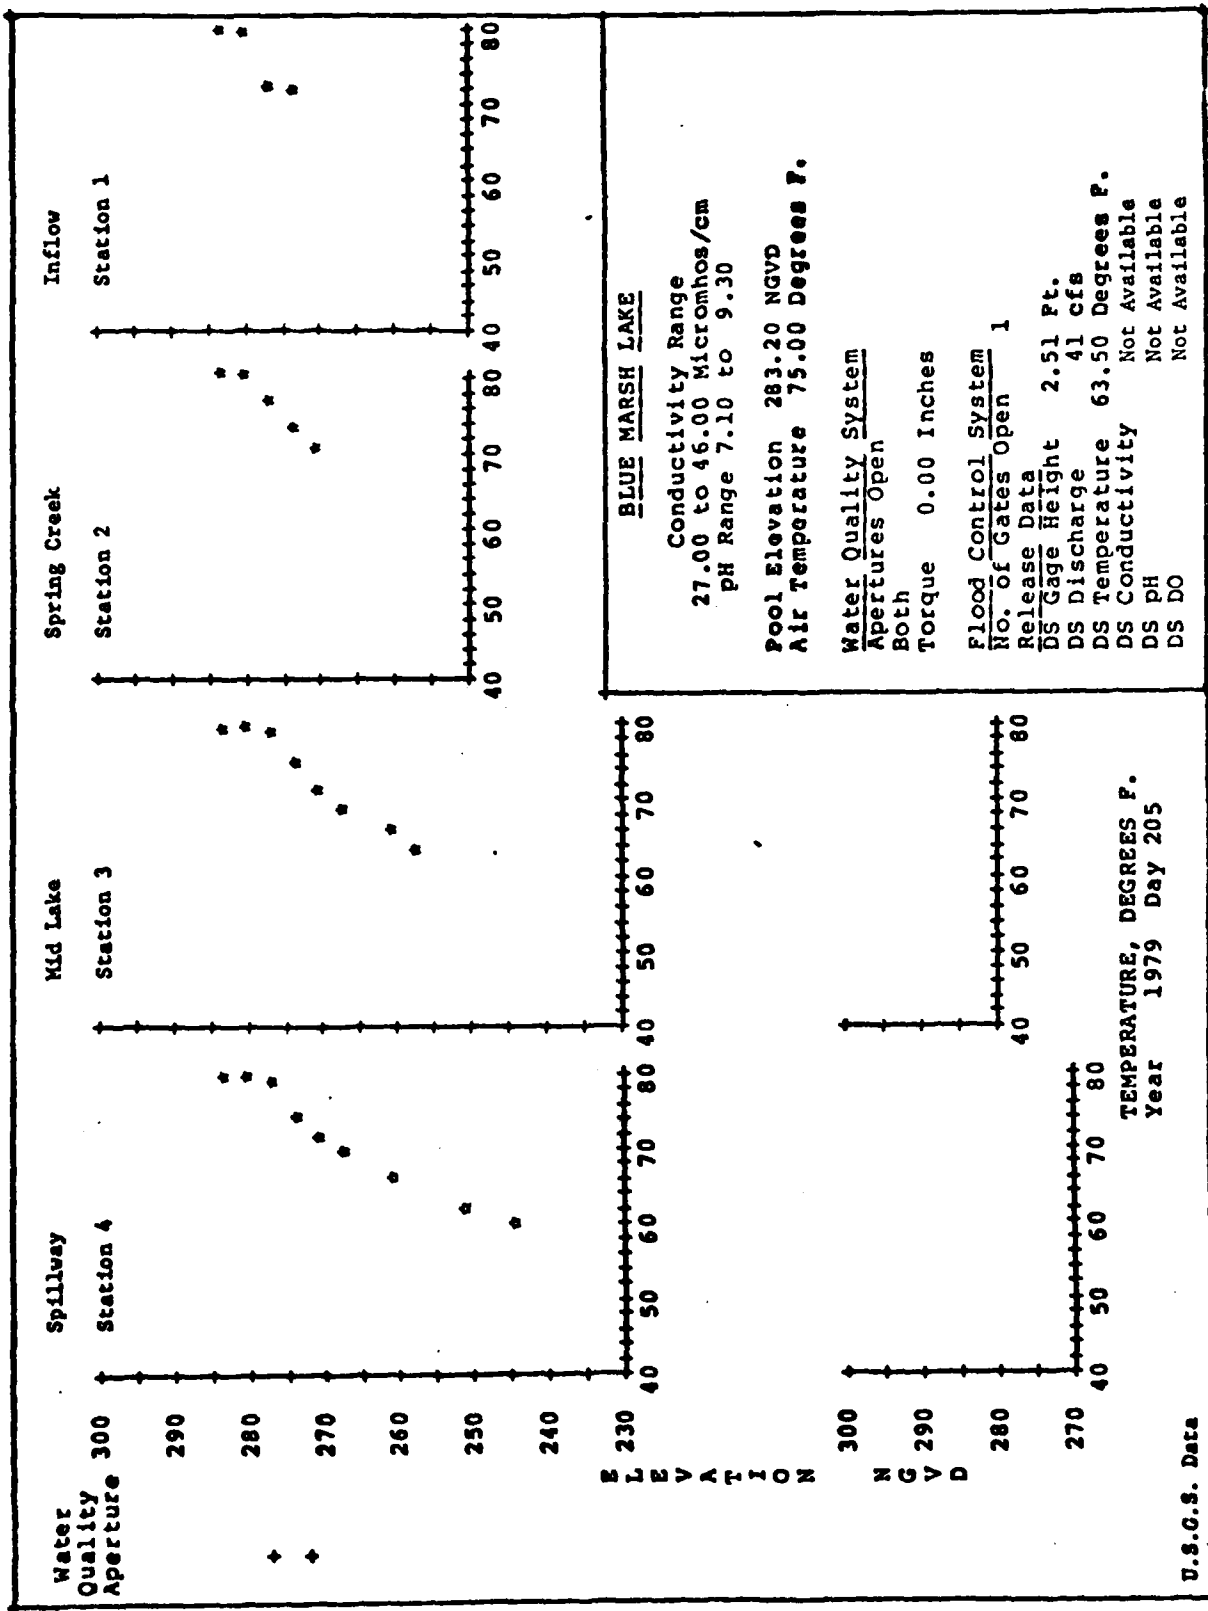

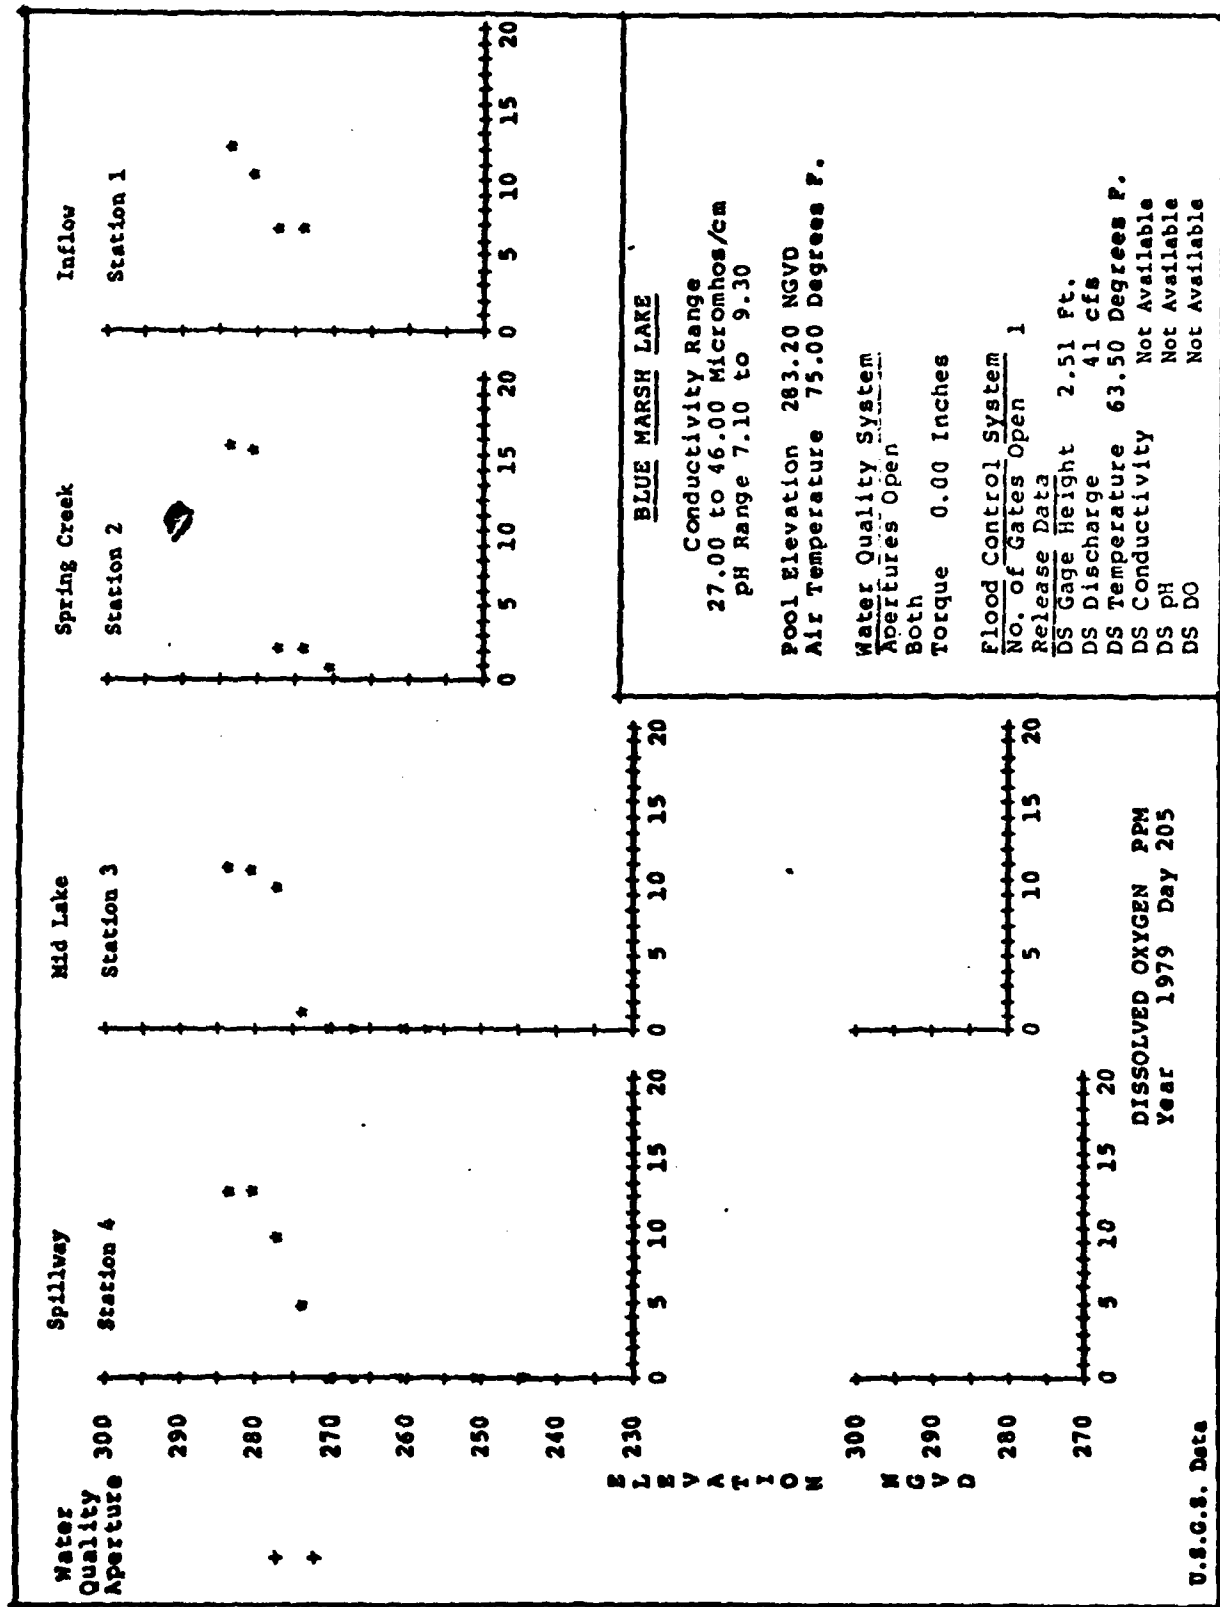

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH LAKE Party: JB & JL

Station: 4 Location: Spillway Pool

Date: 7/24/79 Time: 1001 S.D. 37"

Weather: overcast - fog

Comments: Pool EL. 283.20' Stream 2.47'

Depth FT- M	Temp °C	Cond mhos/cm	DO (mg/l)	pH				JTUS	
0	26.5	270	12.3	9.0				10.0	
1	26.5	272	12.3	9.0				9.6	
2	26.2	300	9.4	8.1				8.3	
3	23.5	345	4.9	7.6				8.4	
4	22.0	352	0.0	7.5				8.4	
5	21.0	370	}	7.5				6.2	
6								5.0	
7	19.0	390		7.45				4.5	
8								4.2	
9								5.0	
10	16.7	372		7.41				4.6	
11								5.3	
12	15.7	387		7.4				8.0	Disturbed Bottom
13									
Time	1530	outflow @ gage	2.47'	bottom gate open					
outflow	18.0	350	8.2	7.4	-			3	

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH LAKE Party: Barker & Lakatos

Station: 3 Location: Mid-Lake

Date: 7-24-79 Time: 10 36 S.D. 38"

Weather: over cast

Comments:

[illegible]

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH LAKE Party: JB, JL


Station: 2 Location: SPRING CREEK


Date: 7-24-79 Time: 1346 S.D. 24"

Weather: HAZY - OVCST.

Comments: _____

[illegible]

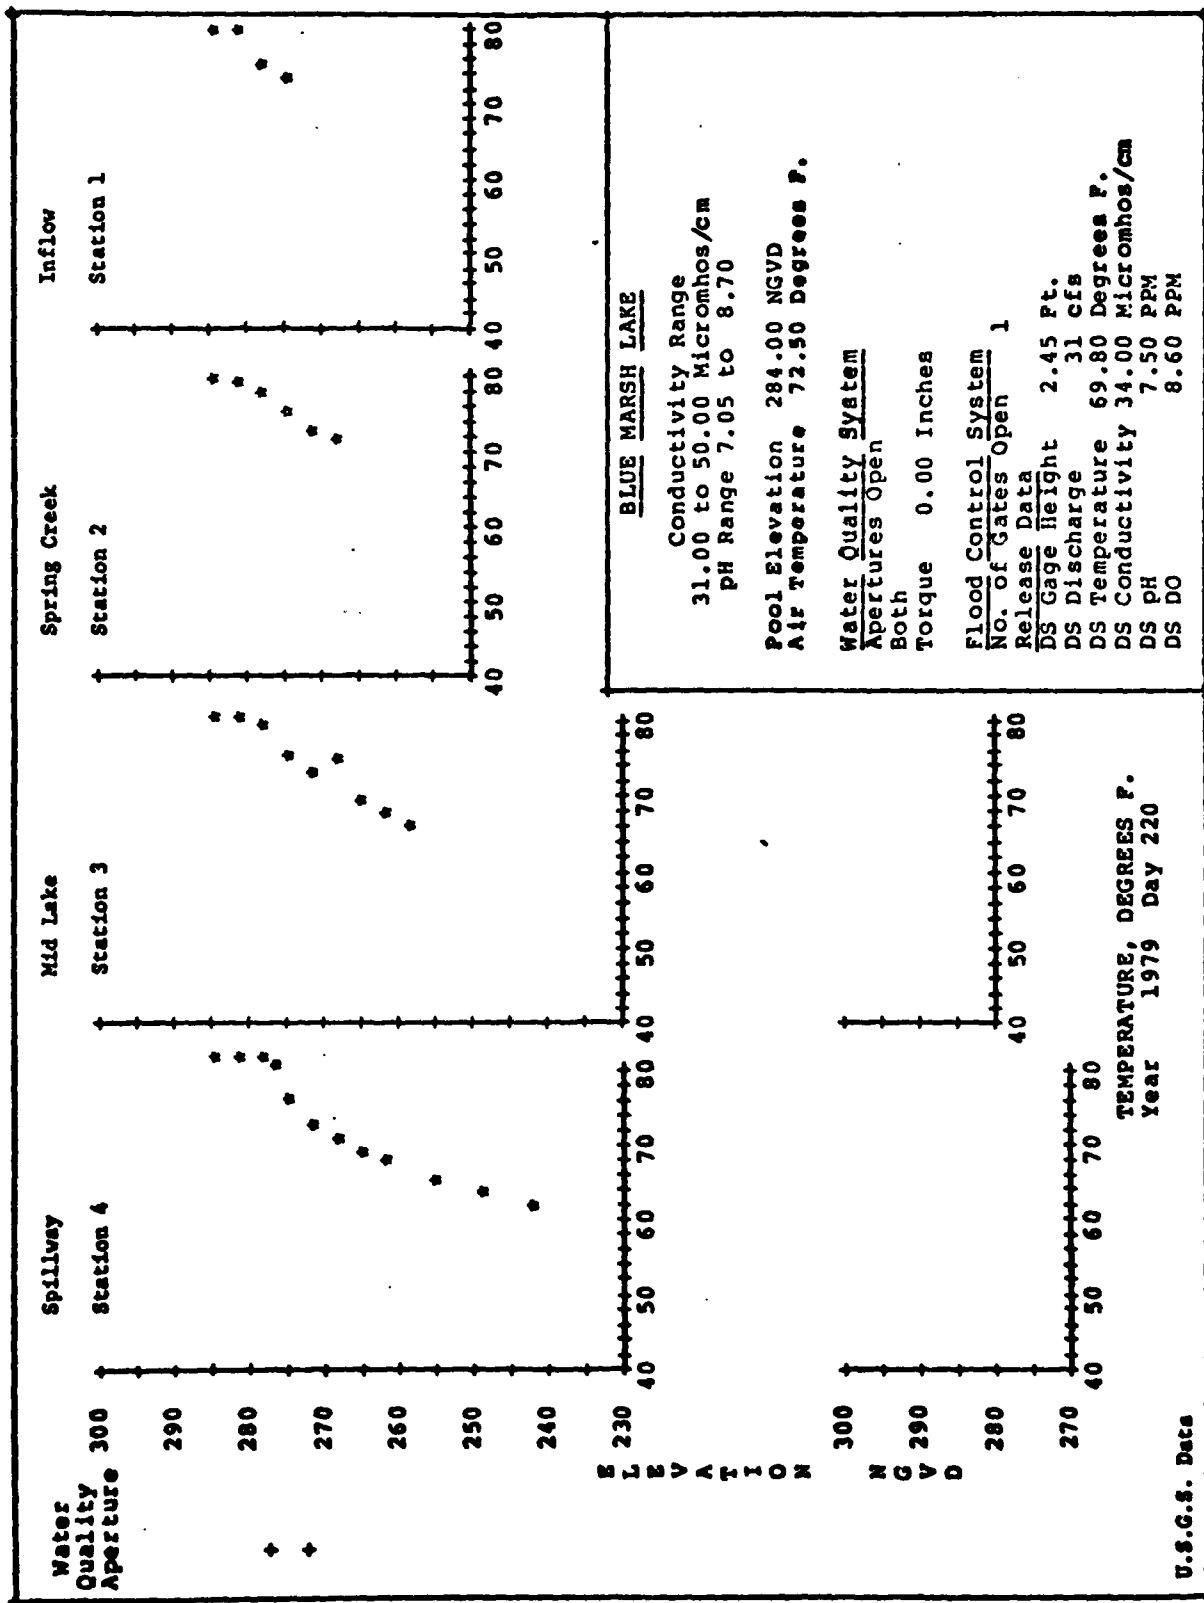

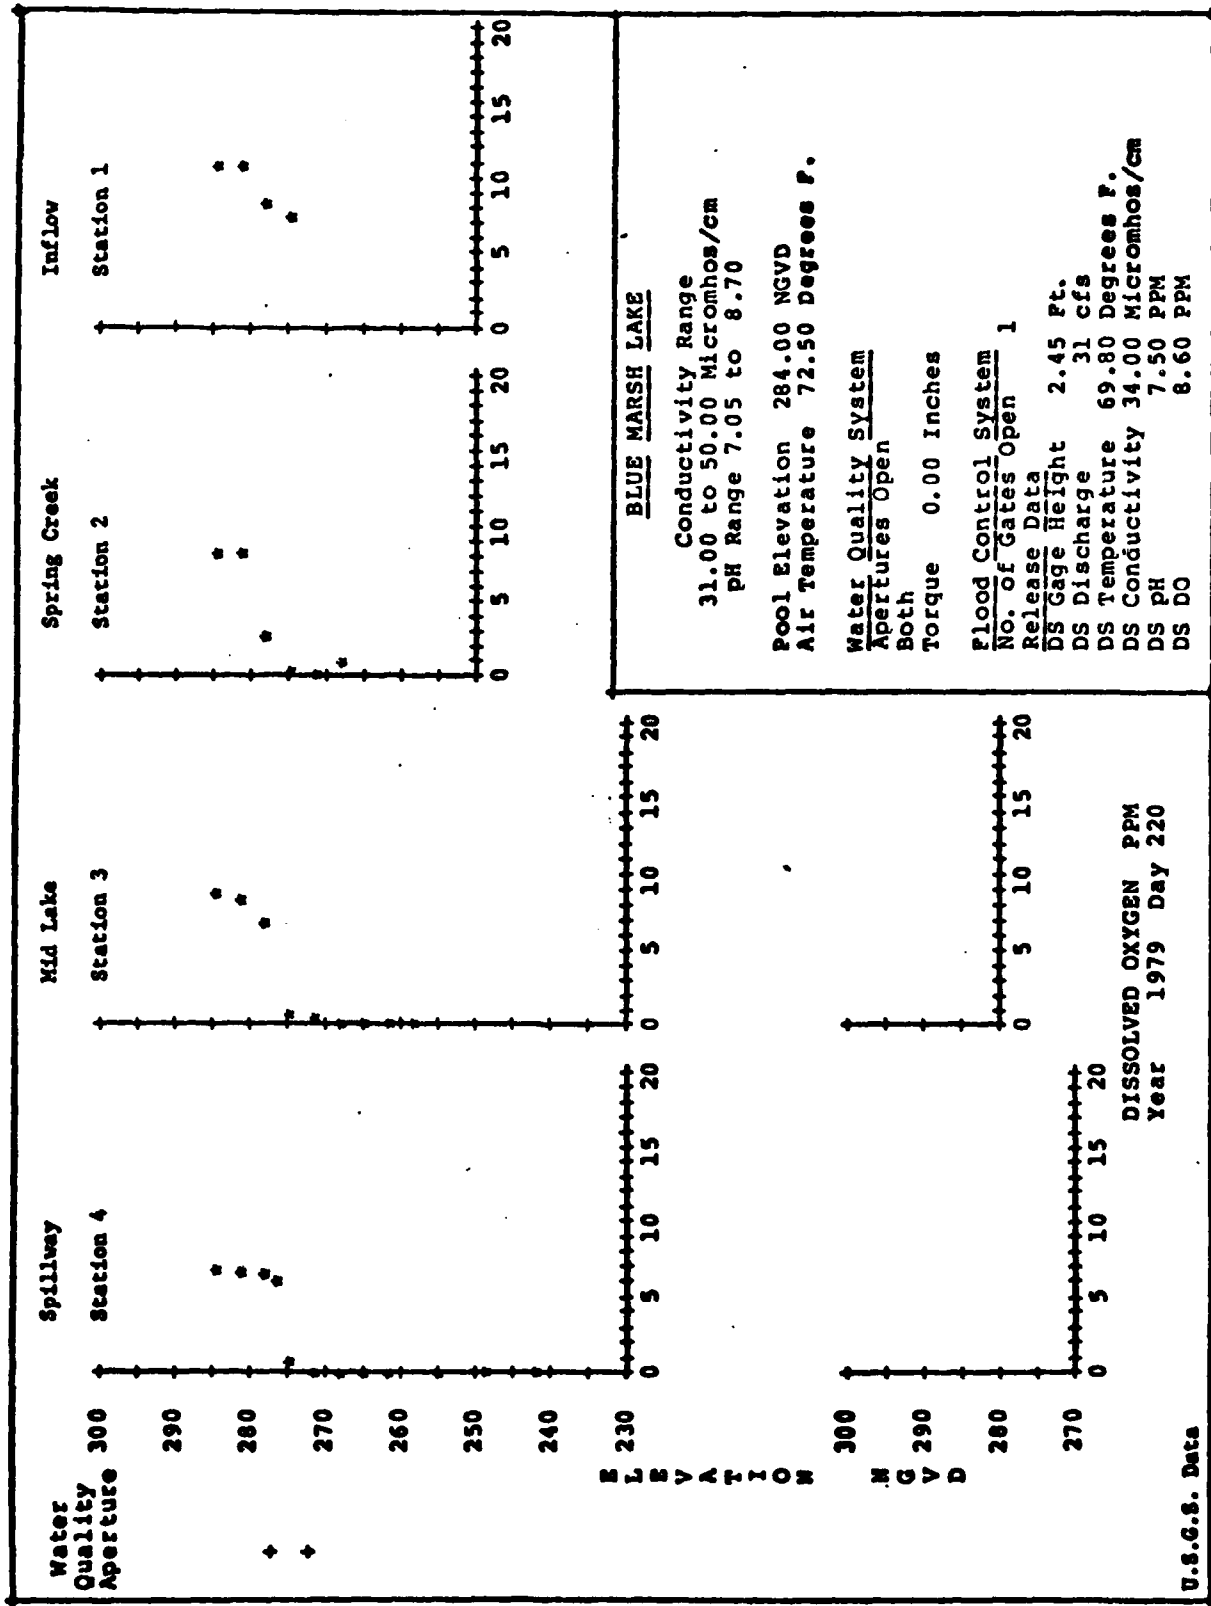

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH LAKE Party: L.B. & J.L.

Station: 4 Location: SPILLWAY

Date: 8-8-79 Time: 1325 S.D. 28'

Weather: _____

Comments: _____

Depth FT- M	Temp °C	Cond mhos/cm	DO (mg/l)	pH			JTUS		
0	27.5	313	6.7	8.35			6.0		
1	27.5	313	6.6	8.5			4.5		
2	27.5	313	6.5	8.45			4.0		
2½	27.0	320	6.0	8.4			3.0		
3	24.5	390	0.6	7.4			2.0		
4	22.5	408	0	7.4			2.0		
5	21.5	393		7.5			2.0		
6	20.5	395		7.5			2.0		
7	20.0	402		7.5			2.0		
9	18.5	429		7.45			1.7		
11	17.5	440		7.4			1.7		
13	16.5	475		7.4			4.5		

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH Party: Barker, S/L

Station: 2 Location: SPRING CREEK

Date: 8/8/79 Time: 1120 S.D. 29"

Weather: _____

Comments: _____

[illegible]

A-25

Comments: Lake El. 284.00'

[illegible]

FIELD REPORT SHEET

Station Name

De Paul Lake outflow

ne

Station Identification No.

01470960

Y M D

790808

Time

1500

2

9

16

17

Date

22

29

32

Collected by

P. VSL

Incubation started

hrs.


Measurements		Observations*	
0 0 0 6 0 31 cfs	0 0 0 6 5 2.45 ft	0 1 3 4 5 0 0 0	0 1 3 4 0 0 0 0
Discharge	Gage height	Floating debris	Dead fish
0 0 0 2 0 33.0 °C	0 0 0 1 0 25.0 °C	0 1 3 1 0 0 0 0	0 1 3 3 0 0 0 0
Temp.-Air	Temp.-Water	Gas bubbles	Atmospheric Odor
0 0 4 0 0 7.5	0 0 0 9 5 340 μ hos	0 1 3 3 5 0 0 0	0 1 3 5 0 0 0 0
pH	Spec. Cond.	Floating sewage	Turbidity
0 0 3 0 0 8.6 mg/l	3 1 5 0 1 col/100	0 1 3 2 5 0 0 0	0 1 3 0 5 0 0 0
DO <i>not</i>	Tot. Coliform	Algae mats	Detergent suds
3 1 6 1 6 col/100		0 1 3 2 0 0 0 0	0 1 3 5 5 0 0 0
Fecal Coliform		0 1 Floating garbage	0 1 Ice-floating or solid
		0 1 3 0 0 0 0 0	0 1 3 1 5 0 0 0
		0 1 Oil-grease	0 1 Floating sludge


*Coding for severity: 0 = None, 1 = Mild, 2 = Moderate, 3 = Serious, 4 = Extreme.

EMARKS: (More observations: color, weather, etc.)

DATA

es collected	Filt.	Unfilt	Samples collected	Filt.	Unfilt
allon			4 ounce		
rt			4 oz.-fixed (HgCl ₂ , HCl, HNO ₃)		
-fixed (H ₂ SO ₄ , NaOH, H ₂ NO ₃ , Cs ₂ S ₂)			Sediment		
ce			Radiochemical		
ce-fixed (HgCl ₂ , H ₂ SO ₄)			Pesticide		
TAL COLIFORM volume and count			FECAL COLIFORM volume and count		

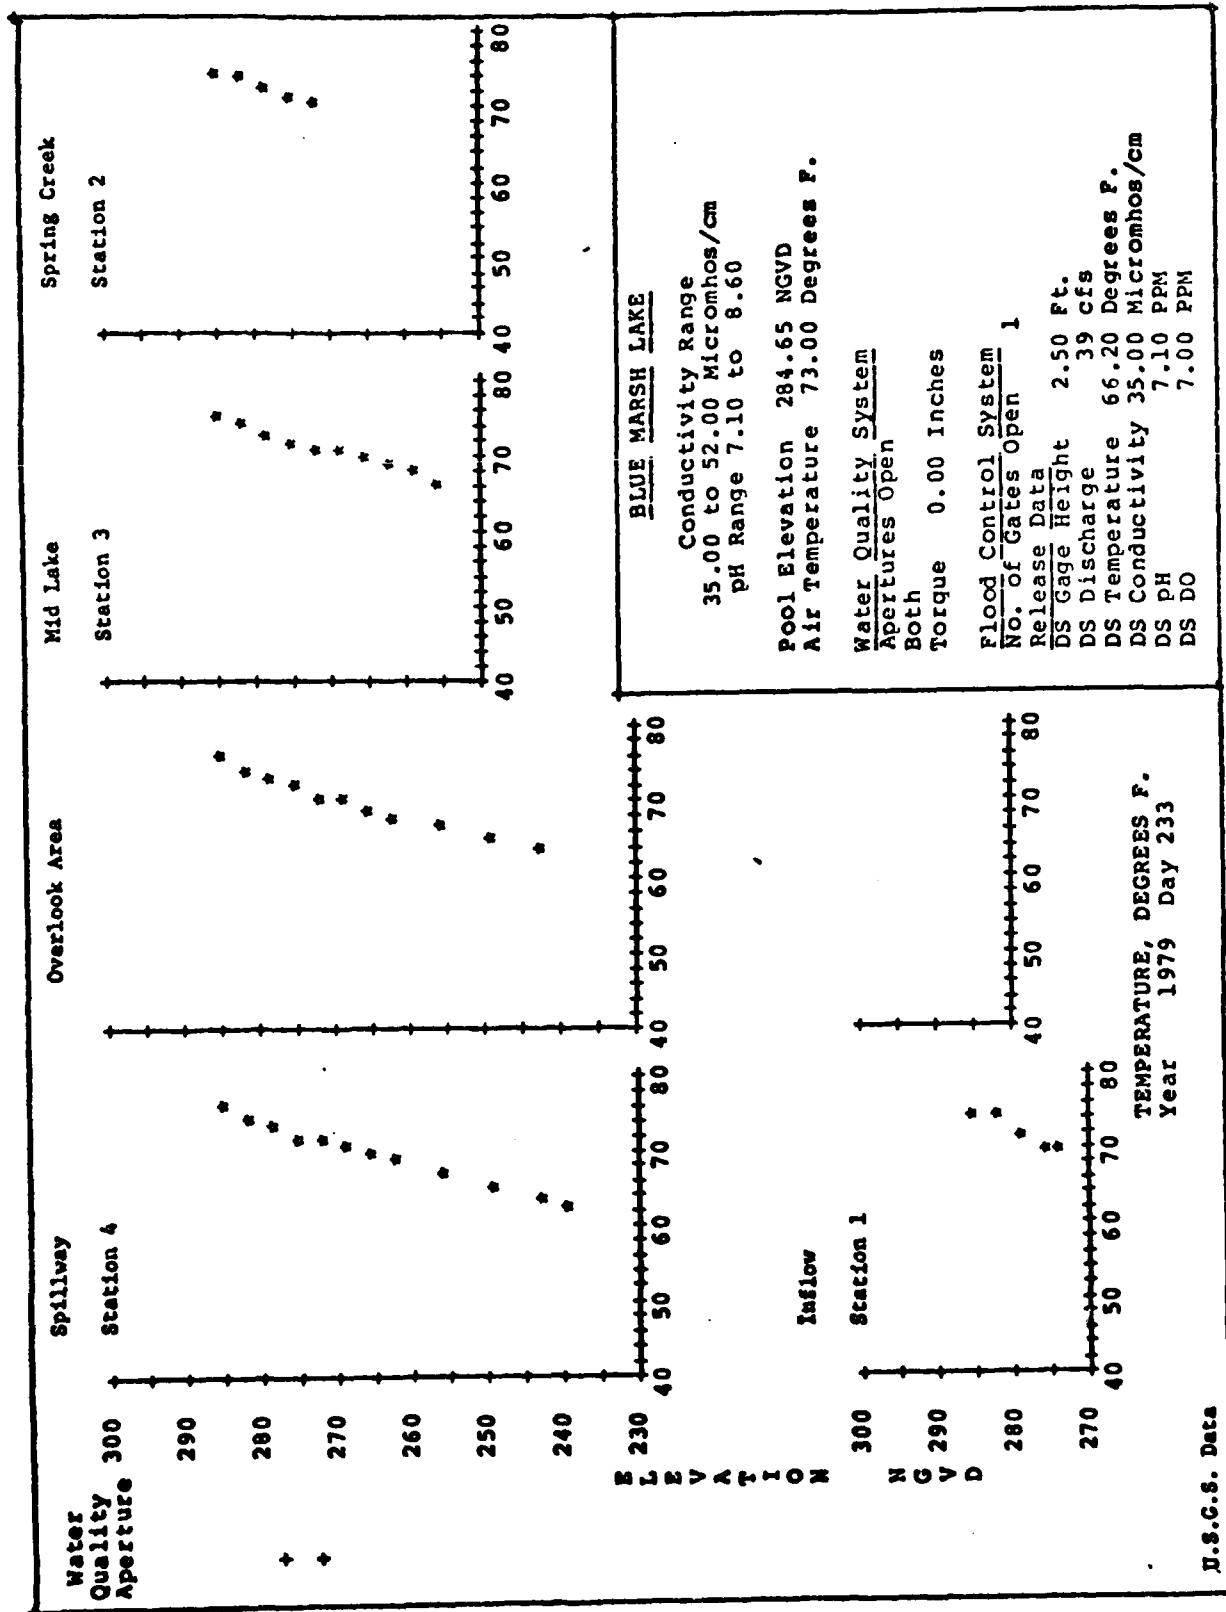

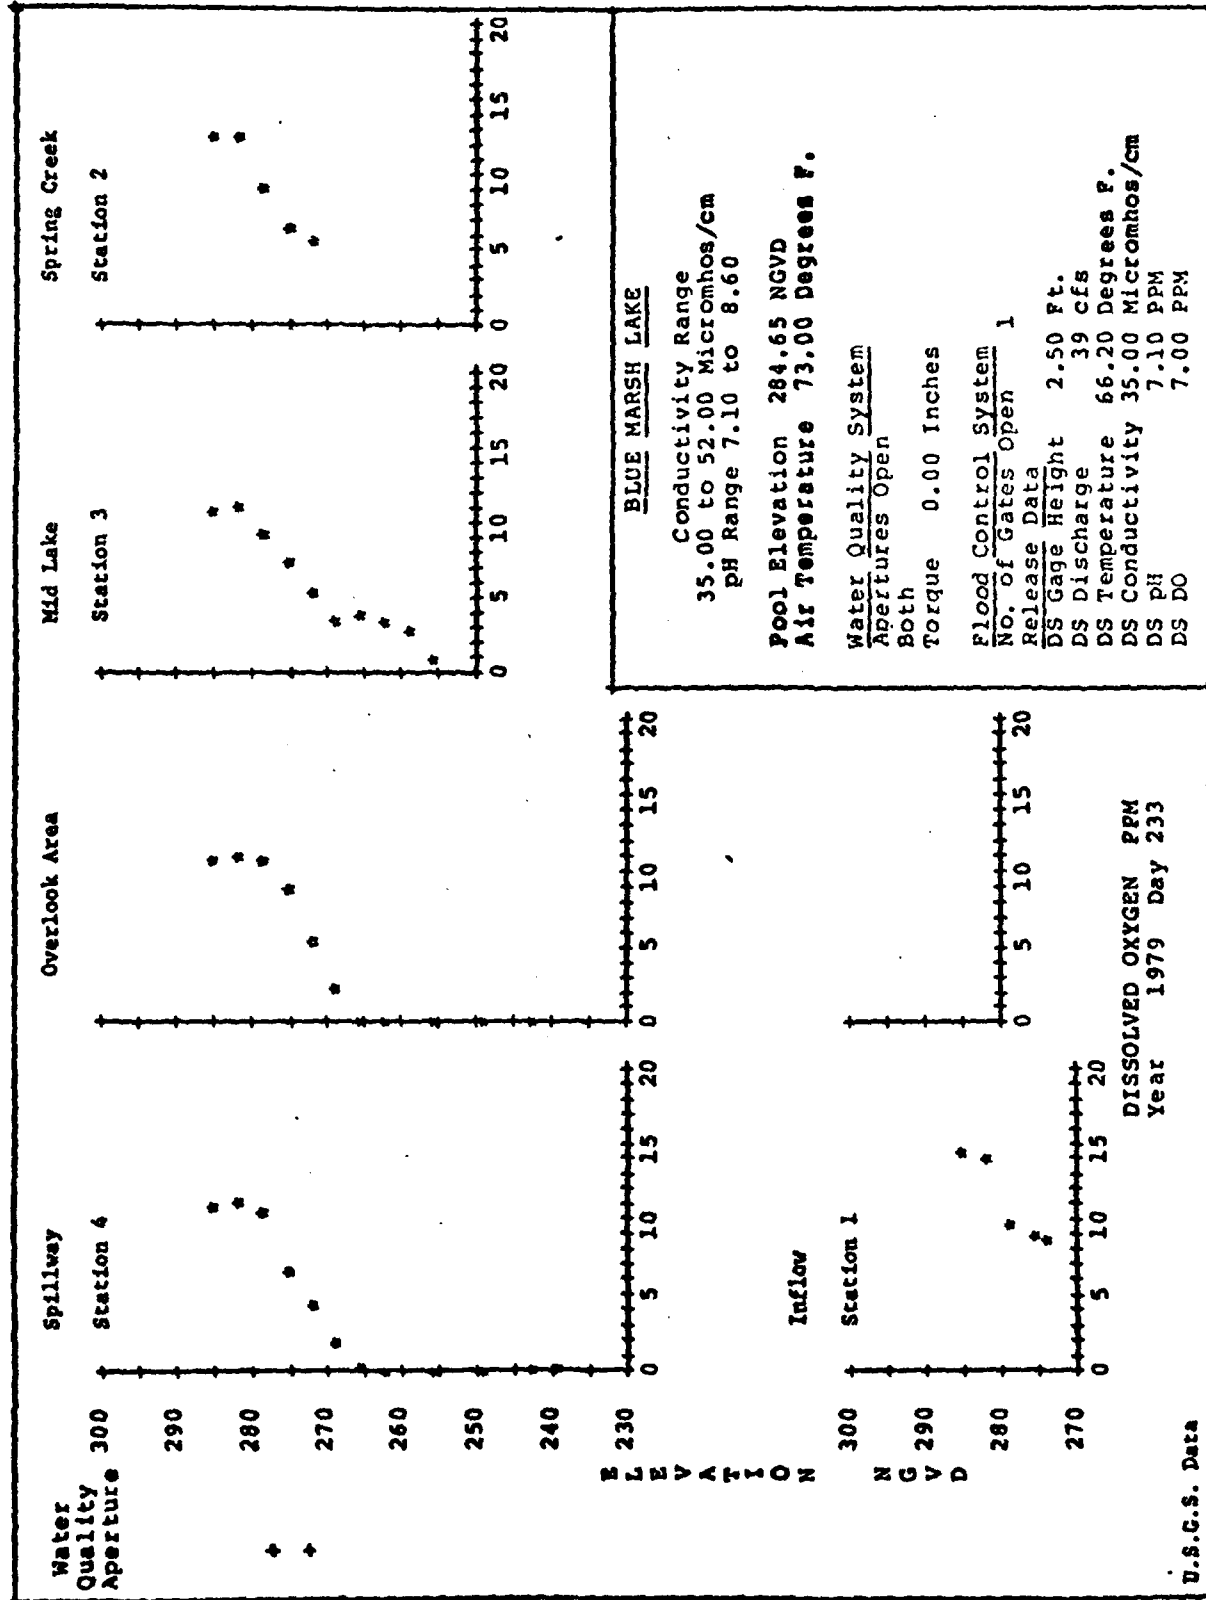

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH Party: JB & JL

Station: 1 Location: SPILLWAY

Date: 21 AUG. 79 Time: 1410 S.D. 72"

Weather: CLEAR, HOT, SUNNY

Comments: _____

Depth FT- (D)	Temp °C	Cond mhos/cm	DO (mg/l)	pH	%D.O. SAT	JTUS		
5	24.5	365	10.8	8.1	128			
1	23.5	365	11.2	8.2				
2	23.0	365	10.5	8.0				
3	22.0	370	6.6	7.55				
4	22.0	375	4.4	7.4				
5	21.5	390	1.8	7.2	19			
6	20.5	400	0.4	7.2				
7	20.5	420	0.0	7.12				
9	19.5	440	0.0	7.1				
11	18.5	452	0.0	7.1				
13	17.5	487	0.0	7.1				
14	17.0	520	0.0	7.2				

U. S. GEOLOGICAL SURVEY
WATER RESOURCES DIVISION

Project: BLUE MARSH Party: Barker, Lakatos

Station: Overlook Area Location: Overlook - 50' from shoreline

Date: 21 AUG. 79 Time: 1440 S.D. _____

Weather: SUNNY, HOT, HUMID

Comments: _____

Depth ft- (ft)	Temp °C	Cond µhos/cm	DO (mg/l)	pH	% D.O. Sat.	JTUS		
5	24.5	368	10.8	8.25	127			
1	23.5	364	10.9	8.3				
2	23.0	365	10.6	8.2				
3	22.5	368	8.8	7.8				
4	21.5	372	5.4	7.4				
5	21.5	382	2.2	7.3	24			
6	20.5	410	0.0	7.15				
7	20.0	422	}	7.15				
9	19.5	435		7.1				
11	18.5	448		7.1				
13	17.7	475		7.1				
13½	Bottom							

U. S. GEOLOGICAL SURVEY

Project: BLUE MARSH

Party: Barker La Katosh

Station: 2

Location: MID LAKE

Date: 21 AUG. 79

Time: 1330

S.D. 54"

Weather: SUNNY, WARM, PARTLY CLOUDY

Comments:

[illegible]

Project: *BLUE MARSH*

Party: JMEJL.

Station: *SPRING CREEK*

Location: *SPRING CREEK AREA*

Date: 21 AUG 79

Time: 1300

S. D.

46

Weather:

SUNNY - Partly Cldy - WARM

Comments:

[illegible]

Project: BLUE MARSH

Party: ³ S. L. & J.

Station: UPSTREAM

Location: INFLOW POOL

Date: 21 AUG 79

Time: 1210

S.D. 4611

Weather: Hot - humid - overcast

Comments: HYDRO LAB. Model 4

Depth H-M	Temp °C	Cond micro/cm	DO (mg/l)	pH	% DO SAT
SURFACE	23.5	352	14.4	8.6	170%
1	23.5	380	14.0	8.5	
2	22.0	470	9.6	8.1	
3	21.0	492	8.9	8.2	
3 1/2	21.0	490	8.6	8.2	95

Station Name

Twp. Creek & Blue Creek gage

Spec

Station Identification No.

3

01720950

Y

M

D

790821

Time

1010

1

2

9

16

17

Date

22

29

32

Collected by

B

Incubation started

hrs.


Measurements		Observations*	
0 0 0 5 0 39 cfs	0 0 0 6 5 2.50 ft	0 1 3 4 5 0 0 0 0 1 Floating debris	0 1 3 4 0 0 0 0 0 1 Dead fish
0 0 0 2 0 °C	0 0 0 1 0 19.0 °C	0 1 3 1 0 0 0 0 0 1 Gas bubbles	0 1 3 3 0 0 0 0 0 1 Atmospheric Odor
0 0 4 0 0 7.1	0 0 0 9 5 350 µhos	0 1 3 3 5 0 0 0 0 1 Floating sewage	0 1 3 5 0 0 0 0 0 1 Turbidity
0 0 3 0 0 7.0 mg/l	3 1 5 0 1 col/100	0 1 3 2 5 0 0 0 0 1 Algae mats	0 1 3 0 5 0 0 0 0 1 Detergent suds
3 1 5 1 6 col/100		0 1 3 2 0 0 0 0 0 1 Floating garbage	0 1 3 5 5 0 0 0 0 1 Ice-floating or solid
		0 1 3 0 0 0 0 0 0 1 Oil-grease	0 1 3 1 5 0 0 0 0 1 Floating sludge

*Coding for severity: 0 = None, 1 = Mild, 2 = Moderate, 3 = Serious, 4 = Extreme.

REMARKS: (More observations: color, weather, etc.)

284.65

es collected	Filt.	Unfilt	Samples collected	Filt.	Unfilt
allon			4 ounce		
Fixed (H ₂ SO ₄ , NaOH, H ₂ PO ₄ , CaCl ₂)			4 oz.-fixed (H ₂ Cl ₂ , HCl, HNO ₃)		
Fixed (H ₂ SO ₄ , NaOH, H ₂ PO ₄ , CaCl ₂)			Sediment		
Fixed (H ₂ SO ₄ , NaOH, H ₂ PO ₄ , CaCl ₂)			Radiochemical		
Fixed (H ₂ SO ₄ , NaOH, H ₂ PO ₄ , CaCl ₂)			Pesticide		
FECAL COLIFORM volume and count			FECAL COLIFORM volume and count		

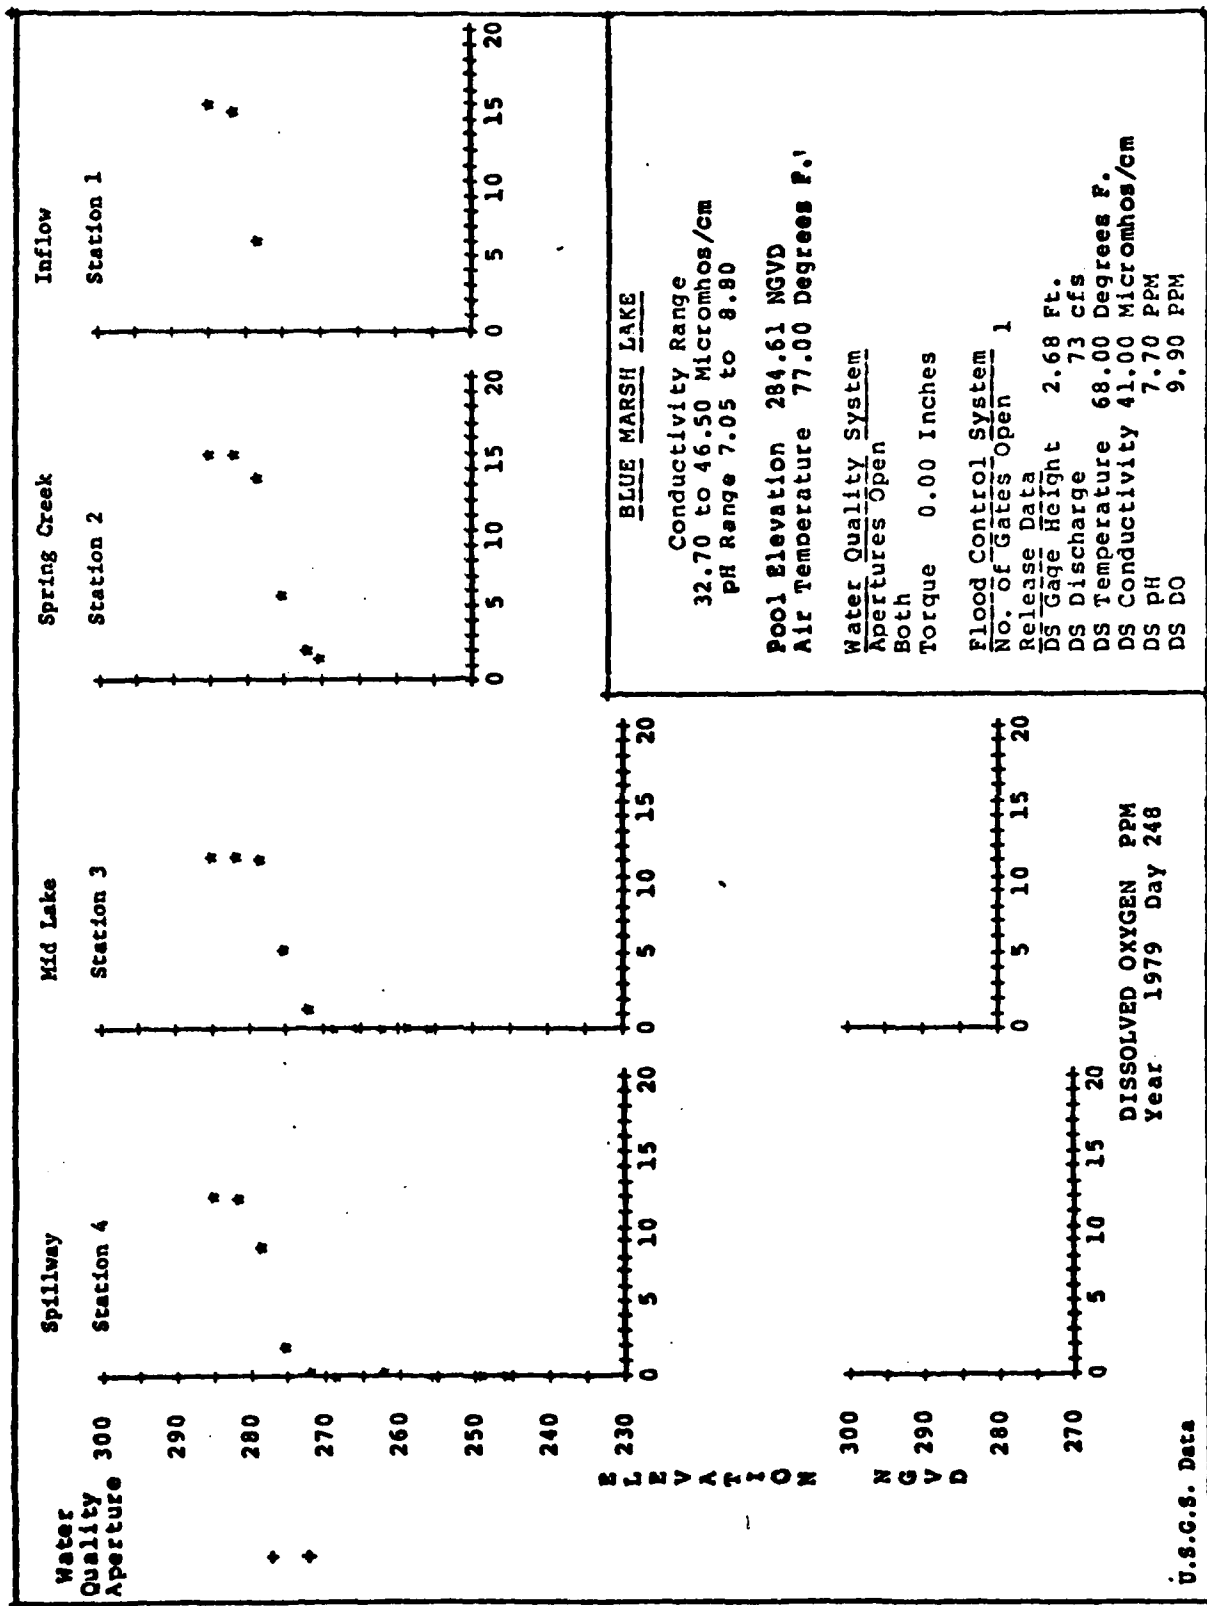

Party: JM & JL

4

Letter 100:

SPILLWAY

1948 002

5 SEPT 79

Tires:

1325

S.D.

44"

Weather:

OVERCAST

Contents:

9-37

BLUE MARSH

Stations:

3

Location:

MID - LAKE

D.11.02

5 SEPT 79

Time:

1150

S.D.

32"

Weather:

OVERCAST - WINDY COOL

Comments:

[illegible]

Party: JBS JL

5/11/1962

Date:

Deafness:

Depth F-M	Temp °C	Cond : mhos/cm	DO (mg/l)	pH
SURF	26.5	327	14.9	8.8
1	26.5	329	14.9	8.8
2	26.2	332	13.4	8.55
3	25.0	350	5.6	7.2
4	24.0	377	2.0	7.05
4½	23.0	382	1.4	7.05

Subject:

BLUE MARSH LAKE

Party: J, J¹, T¹

Stations:

UPSTREAM - 1

Location:

UPSTREAM

Date:

5 SEPT. 79

Time: 1120

S.V.

2.4"


Weather:


PARTLY CLOUDY- WARM & HUMID

Contents:

like also - 284.61'

[illegible]

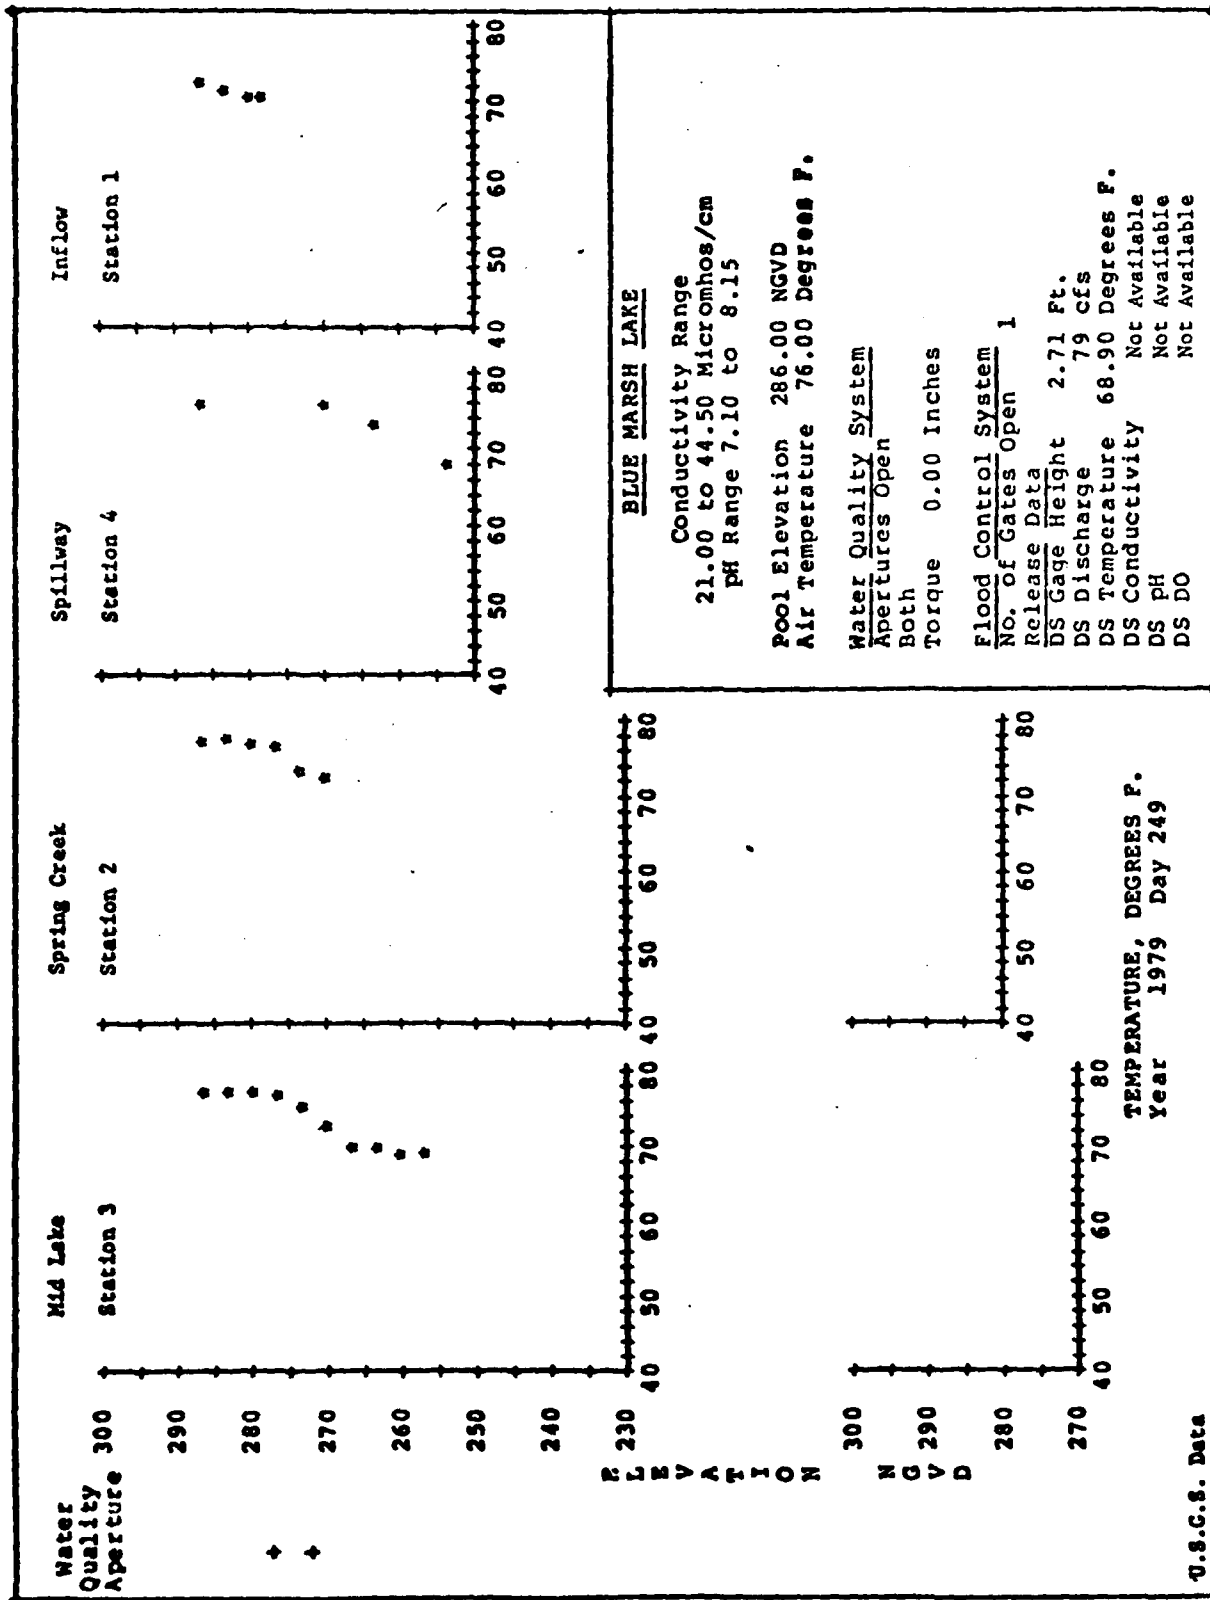

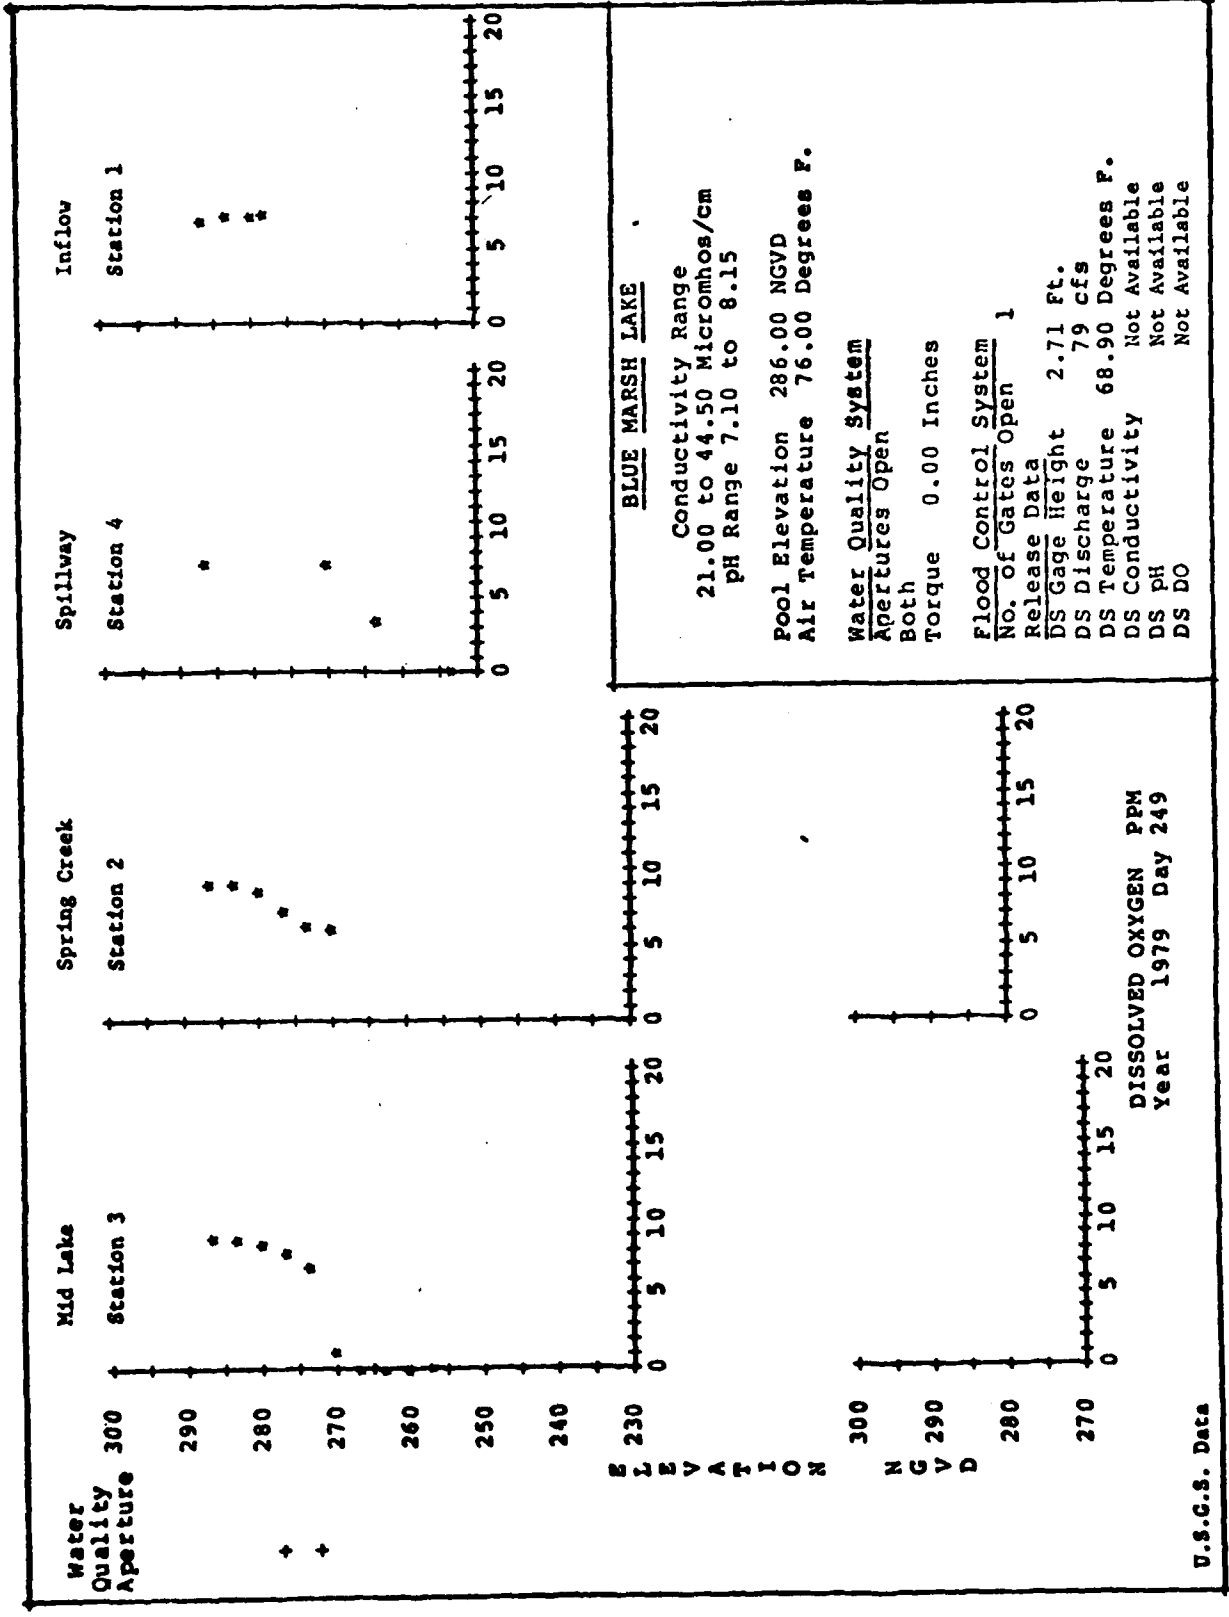

Project: 03 line - March _____ Party: JB

Station: _____ Location: Spring Creek

Date: 9-6-79 Time: 1230 S.D. _____

Weather: *Cloudy - windy*

Comments:

Depth FT	Temp °C	Cond : mhos/cm	DO (mg/l)	pH
S	25.2	340	9.0	8.1
1	25.4	340	9.0	8.1
2	25.0	342	8.5	7.9
3	24.9	342	7.3	7.6
4	23.0	257	6.2	7.2
5	22.5	249	6.0	7.2

A-45

Party: *JB*

Location:

Dates:

Time:

S.D.

Weather:

Contents:

Depth FT-M	Temp °C	Cond μhos/cm	DO (mg/l)	pH
5 1	24.5	350	7.2	8.0
5	24.5	360	7.1	7.9
7	23	370	3.3	7.5
10	20.0	430	0	7.1

A-46

Project: Blue Marsh Lake

Party: J

Stations:

Location: Jefferson

Dal e:

9-6-79

Times

1130

S.D.

Weather:


cloudy - windy, storm over

Comments:


Depth FT	Temp °C	Cond : mhos/cm	DO (mg/l)	pH
5	22.5	245	6.8	7.3
1	22.0	212	7.1	7.1
2	21.5	210	7.2	7.1
2.5	21.5	210	7.3	7.1

plunge pool @ 100 yds below bend
Robertson bridge

A-47

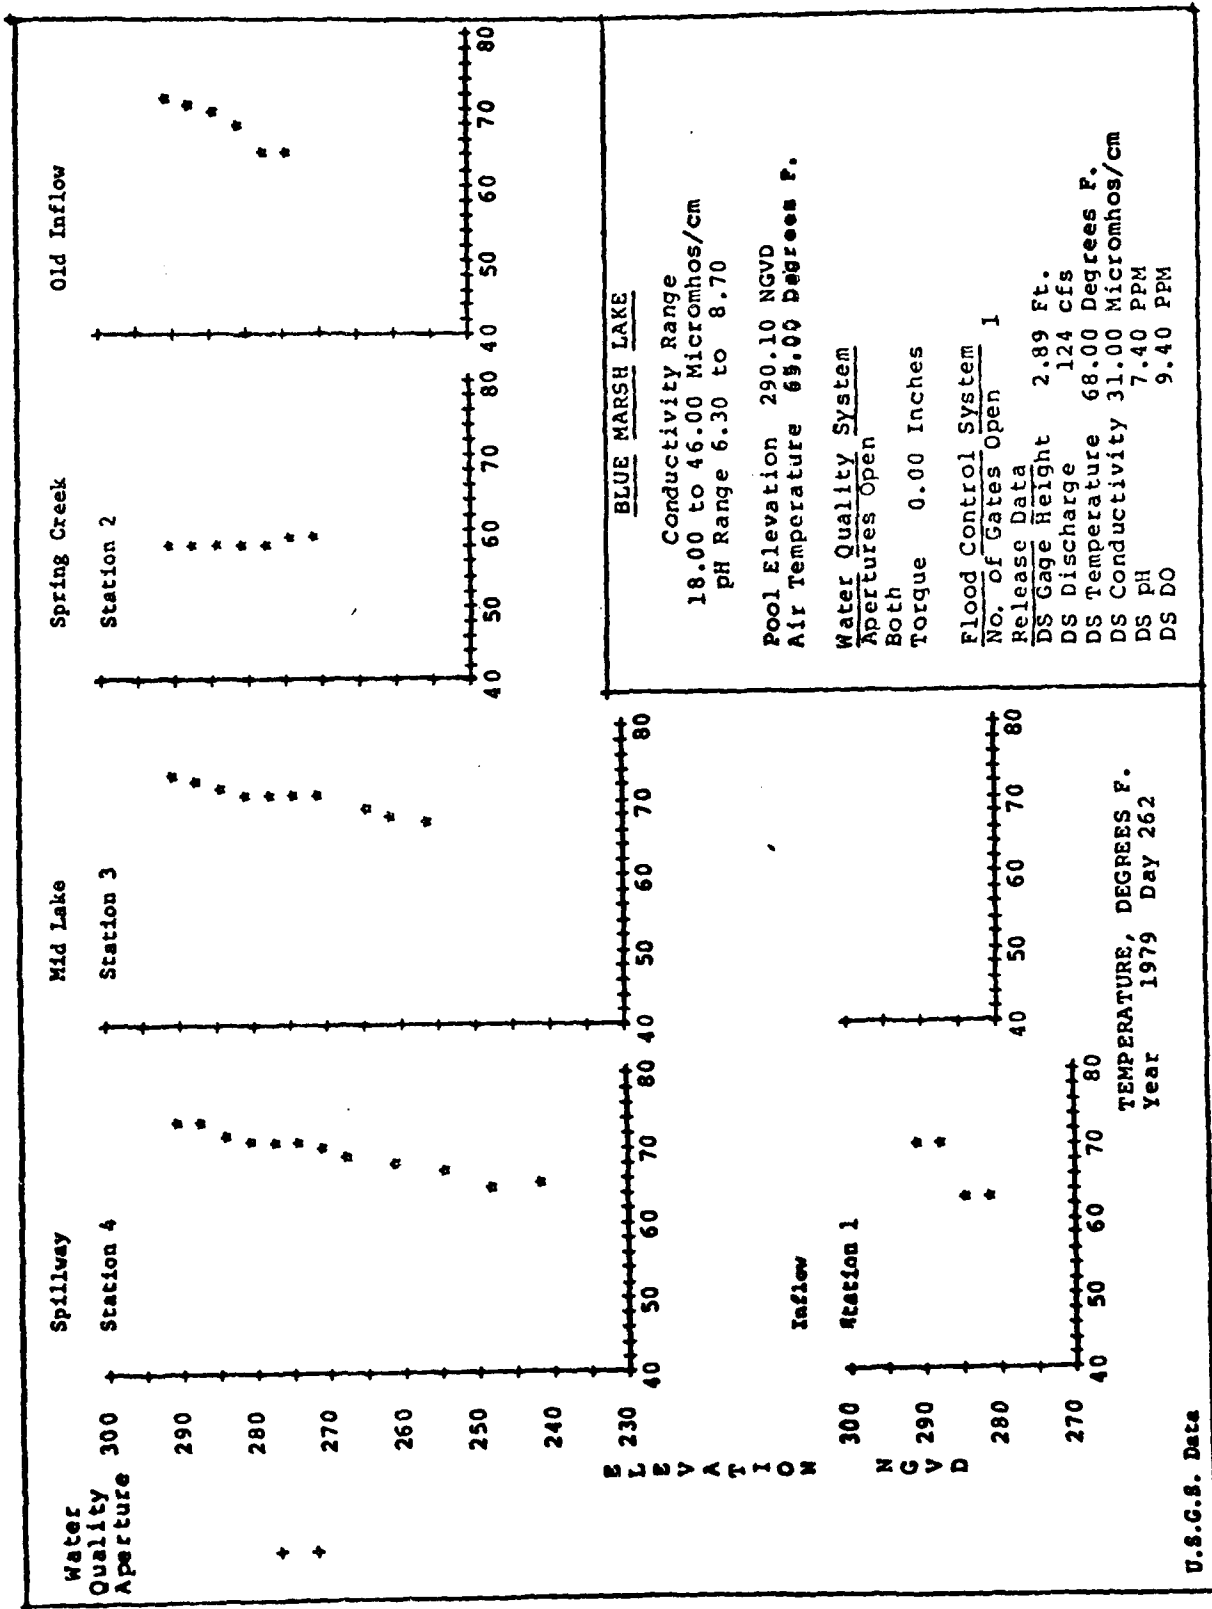

A-48

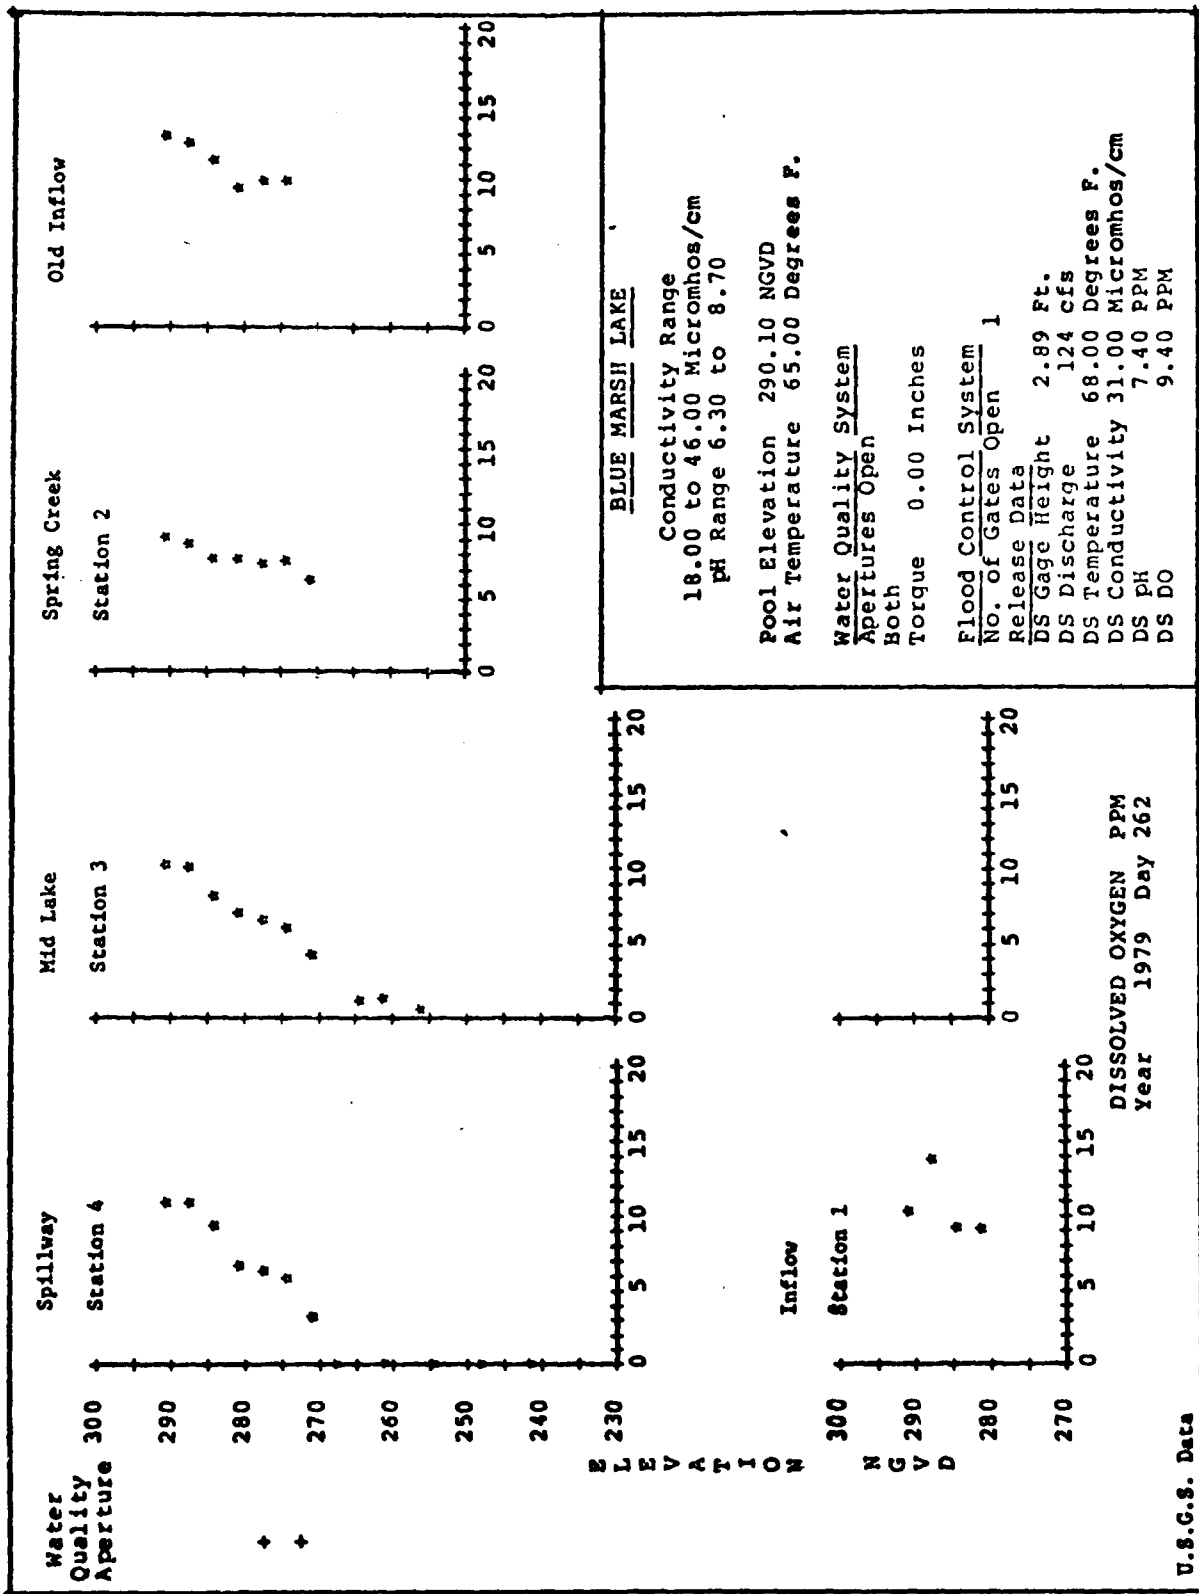

A-49

Project: Blue Marsh Lake Party: JRB

Station: _____ Location: inflow

Date: 9/18/79 Time: 1045 S.D. 27 in

Weather: clear large y-c-l in B 6-9" everywhere

Comments: Moved sta upstream to 1/4 mile head of lake pool

Depth FT-D	Temp °C	Cond : µhos/cm	DO (mg/l)	pH	Fe/100	FS/100		
5	21	330	10.2	8.7	43	44		
1	21	360	13.6	6.4				
2	17	450	9.0	8.2				
3	17	460	9.0	8.3				

Old inflow station

1/2	5	22	350	12.8	8.6			
	1	21.5	350	12.4	8.6	SD -	<u>31 in</u>	
	2	21	350	11.2	8.6			
	3	20	380	9.4	7.9			
	4	18	450	9.8	8.3			
	5m	18	480	9.8	8.4			

FIELD REPORT SHEET

Station Name

Triple Dam gage

type

Station Identification No.

Y M D

Time

3

01470960

790919

1530

1 2

16 17 Date 22

29 32

gauge - 290.28 00800

Collected by

J.B. + R.B.

Incubation started

hrs.

Measurements		Observations*	
0 0 0 6 0 <i>142</i> cfs	0 0 0 6 5 <i>2.95</i> ft	0 1 3 4 5 0 0 0	0 1 3 4 0 0 0 0
Discharge	Gage height	Floating debris	Dead fish
0 0 0 2 0 °C	0 0 0 1 0 <i>20.0</i> °C	0 1 3 1 0 0 0 0	0 1 3 3 0 0 0 0
Temp.-Air	Temp.-Water	Gas bubbles	Atmospheric Odor
0 0 4 0 0 <i>7.4</i>	0 0 0 9 5 <i>30</i> mhos	0 1 3 3 5 0 0 0	0 1 3 5 0 0 0 0
pH	Spec. Cond.	Floating sewage	Turbidity
0 0 3 0 0 <i>9.4</i> mg/l	3 1 5 0 1 col/100	0 1 3 2 5 0 0 0	0 1 3 0 5 0 0 0
DO	Tot. Coliform	Algae mats	Detergent suds
3 1 6 1 6 col/100		0 1 3 2 0 0 0 0	0 1 3 5 5 0 0 0
Fecal Coliform		0 1 Floating garbage	0 1 Ice-floating or solid
		0 1 3 0 0 0 0 0	0 1 3 1 5 0 0 0
		0 1 Oil-grease	0 1 Floating sludge

*Coding for severity: 0 = None, 1 = Mild, 2 = Moderate, 3 = Serious, 4 = Extreme.


REMARKS: (More observations: color, weather, etc.)


Collected Coliform & mhos

FC/100 = 77

FS/100 = 56

es collected	Filt.	infiltr	Samples collected	Filt.	U
allon			4 ounce		
rt			4 oz.-fixed (HCl, HNO3)		
-fixed (H2SO4, NaOH, H3PO4-CuSO4)			Sediment		
cc			Radiochemical		
cc-fixed (HCl, H2SO4)			Pesticide		
TAL COLIFORM volume and count			FECAL COLIFORM volume and count		

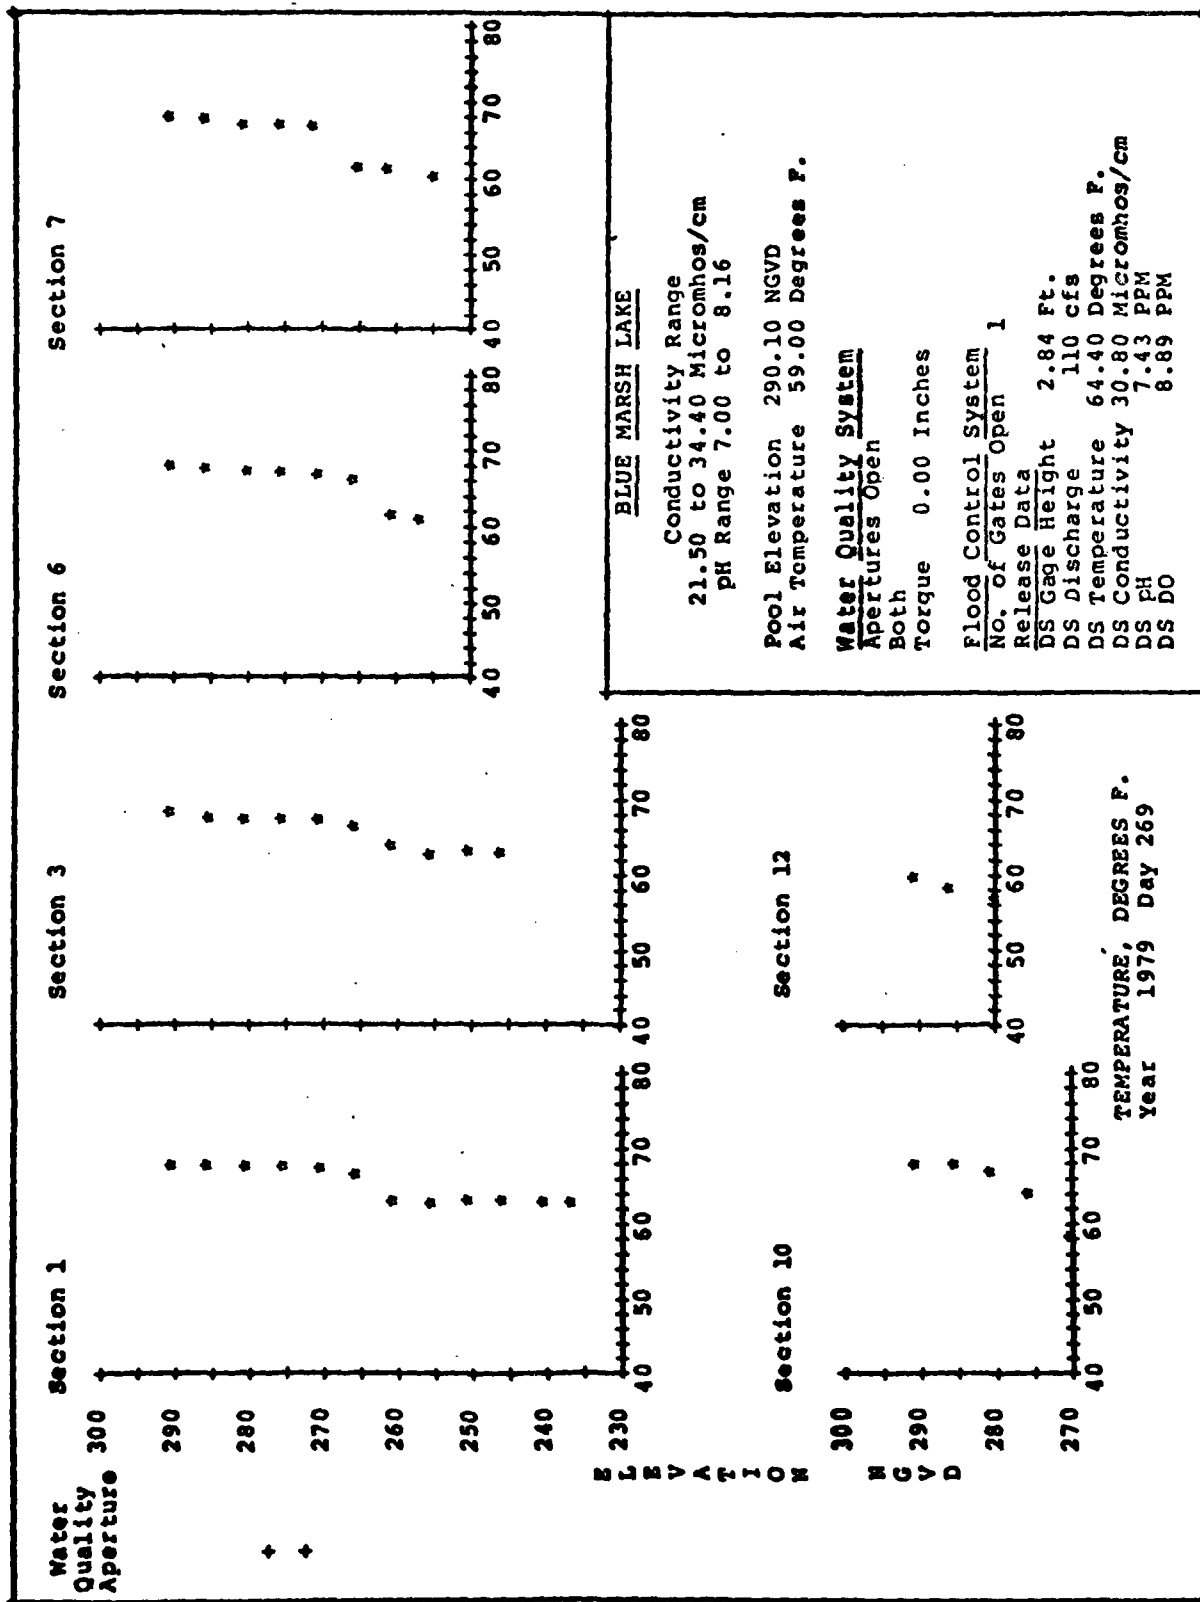

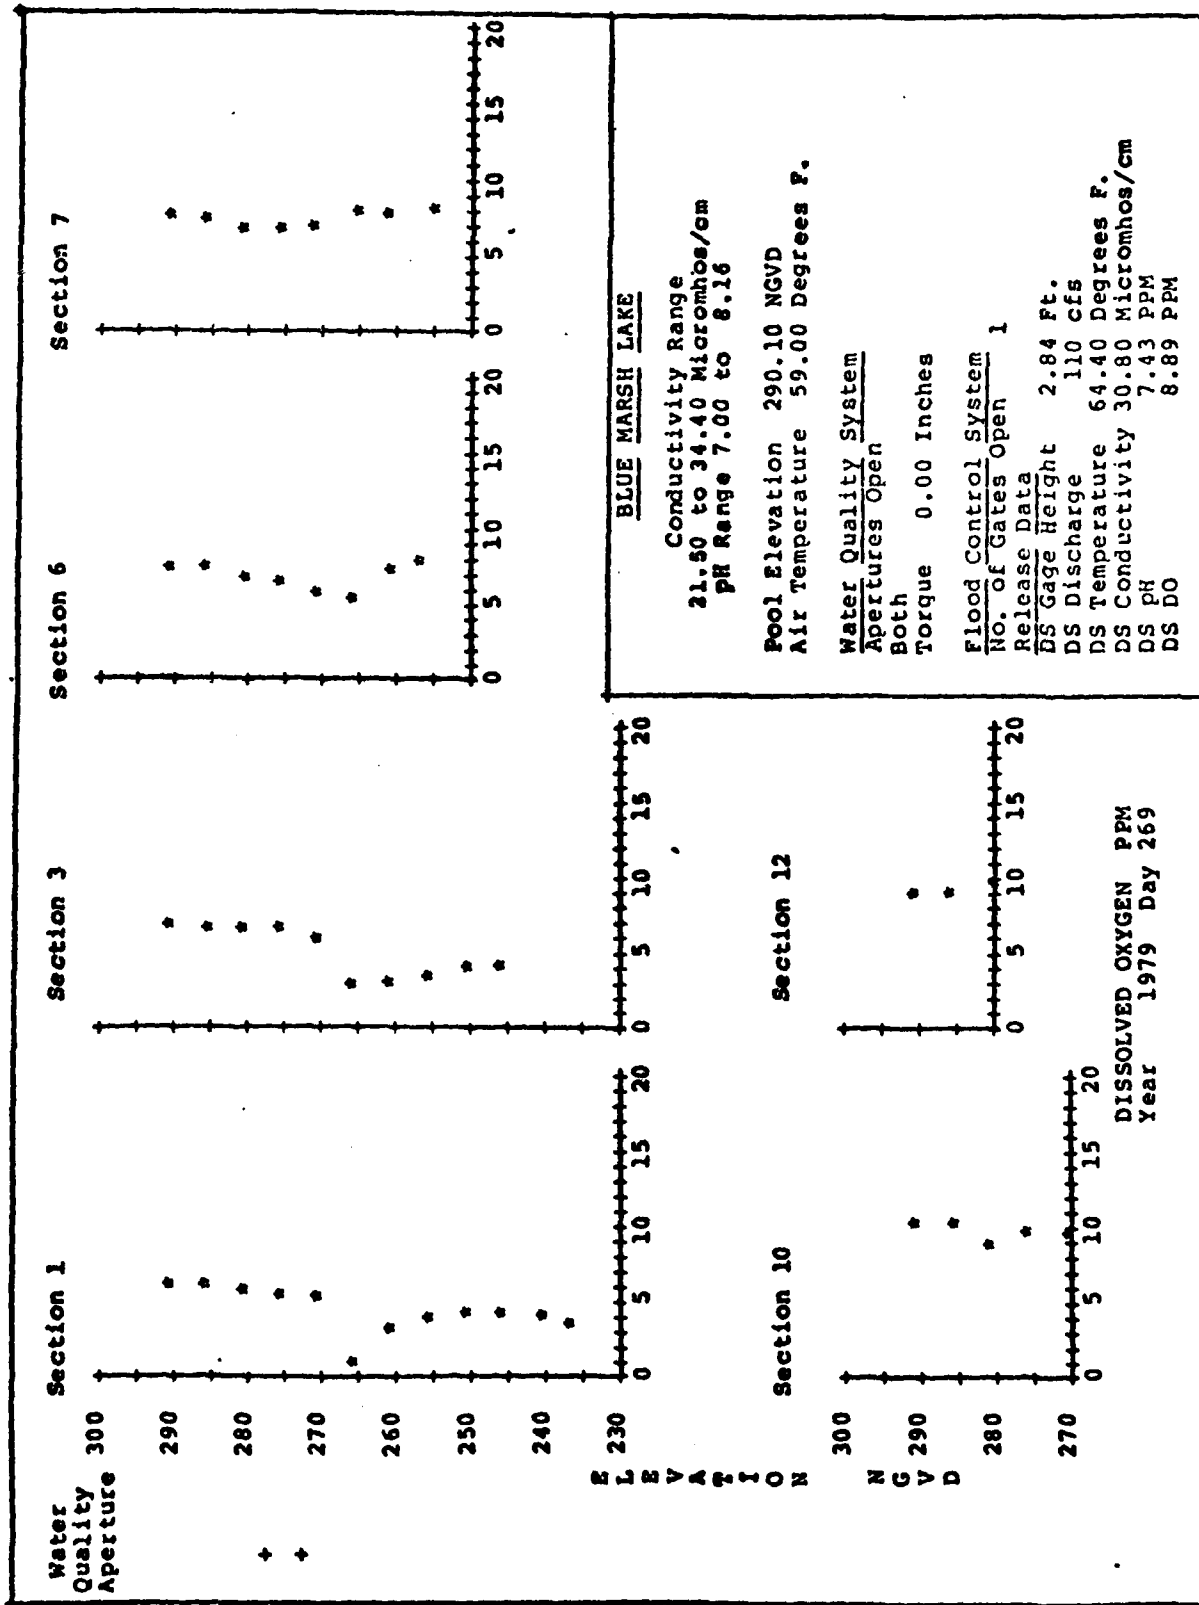

BLUE MOUNTAIN LAKE

STRATIFICATION MONITORING
DATA SHEET

DATE: 9/26/79

MONITORING PARTY: AL SMITH

JULIAN DAY 261

SUE REILLY

CLARE MIRABELLA

RESERVOIR DATA

Water Quality System

Portal Opening: 1. Closed ()
2. Open Full (x)
3. Top Open - Bottom Closed ()
4. Top Closed - Bottom Open ()

Torque Setting: 0 (Inches) (Feet)

Flood Control System

Gates Open: 0 (1) 6 (2) (None)

Gate Settings: .5 Ft. 6 Ft.

Pre-Monitoring Data

Time: 0800 Hrs.

Air Temp: 11.1 °C = 52 °F

Pool Elev: 290.10 Ft. SLD

Downstream Gate Data

(1) Stage: 2.84 Ft.

(2) Discharge: 110.3 CFS

(3) Water Temp: 18 °C = 64.4 °F

(4) D.O: _____ PPM

(5) pH: _____

(6) Cond: _____ Micromhos/CM

(7) ORP: _____ mV

Post Monitoring Data

Time: 1345 Hrs.

Air Temp: _____ °C = _____ °F

Pool Elev: 290.10 Ft. SLD

Downstream Gate Data

(1) Stage: _____ Ft.

(2) Discharge: _____ CFS

(3) Water Temp: 19.3 °C = 66.7 °F

(4) D.O: 8.89 PPM

(5) pH: 7.43

(6) Cond: .308 Micromhos/CM

(7) ORP: 313 mV

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 01 POOL ELEV: 290.10

DATE: 9/26/79 TIME: 0940

DEPTH FROM TOP (Feet)--(Meters)		TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	-- 39.6						
125	-- 38.1						
120	-- 36.6						
115	-- 35.1						
110	-- 33.5						
105	-- 32.0						
100	-- 30.5						
95	-- 29.0						
90	-- 27.4						
85	-- 25.9						
80	-- 24.4						
75	-- 22.9						
70	-- 21.3						
65	-- 19.8						
60	-- 18.3						
55	-- 16.8	16.5	17.1	.264	3.56	7.00	201
50	-- 15.2	15.3	17.1	.263	4.01	7.01	230
45	-- 13.7	13.6	17.2	.263	4.40	7.02	250
40	-- 12.2	12.2	17.2	.264	4.25	7.02	260
35	-- 10.7	10.7	17.1	.264	3.95	7.01	266
30	-- 9.1	9.1	17.3	.299	3.30	7.05	271
25	-- 7.6	7.6	19.1	.344	0.98	7.01	273
20	-- 6.1	6.1	19.6	.325	5.38	7.35	270
15	-- 4.6	4.6	19.7	.324	5.57	7.38	276
10	-- 3.1	3.1	19.7	.325	5.84	7.41	279
5	-- 1.5	1.5	19.8	.324	6.12	7.45	283
SURFACE		0.0	19.9	.322	6.19	7.47	287

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 03

POOL ELEV: 290.10

DATE: 9/26/79

TIME: 1005

DEPTH FROM TOP (Feet)--(Meters)			TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	--	39.6						
125	--	38.1						
120	--	36.6						
115	--	35.1						
110	--	33.5						
105	--	32.0						
100	--	30.5						
95	--	29.0						
90	--	27.4						
85	--	25.9						
80	--	24.4						
75	--	22.9						
70	--	21.3						
65	--	19.8						
60	--	18.3						
55	--	16.8						
50	--	15.2						
45	--	13.7	13.6	17.3	.270	4.20	7.06	192
40	--	12.2	12.3	17.3	.269	4.00	7.03	232
35	--	10.7	10.7	17.1	.279	3.57	7.03	244
30	--	9.1	9.1	17.7	.311	3.07	7.06	251
25	--	7.6	7.6	19.1	.331	2.88	7.11	254
20	--	6.1	6.1	19.6	.323	5.94	7.42	262
15	--	4.6	4.6	19.7	.320	6.68	7.51	266
10	--	3.1	3.1	19.7	.320	6.63	7.50	271
5	--	1.5	1.6	19.9	.321	6.66	7.53	275
SURFACE		0.0	20.1	.313	6.84	7.60	277	

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 06

POOL ELEV: 290.10

DATE: 9/26/79

TIME: 1030

DEPTH FROM TLP (Feet)--(Meters)			TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	--	39.6						
125	--	38.1						
120	--	36.6						
115	--	35.1						
110	--	33.5						
105	--	32.0						
100	--	30.5						
95	--	29.0						
90	--	27.4						
85	--	25.9						
80	--	24.4						
75	--	22.9						
70	--	21.3						
65	--	19.8						
60	--	18.3						
55	--	16.8						
50	--	15.2						
45	--	13.7						
40	--	12.2						
35	--	10.7	10.3	16.1	.299	7.89	7.39	211
30	--	9.1	9.2	16.5	.297	7.36	7.33	232
25	--	7.6	7.6	19.0	.307	5.35	7.26	246
20	--	6.1	6.1	19.4	.312	5.80	7.35	251
15	--	4.6	4.6	19.6	.318	6.55	7.48	256
10	--	3.1	3.2	19.7	.317	6.90	7.53	262
5	--	1.5	1.5	19.8	.317	7.54	7.63	263
SURFACE			0.0	20.0	.315	7.46	7.69	267

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 07

POOL ELEV: 290.10

DATE: 9/26/79

TIME: 1055

DEPTH FROM TGP (Feet)--(Meters)		TEMP °C	COND	D.O. (ppm)	pH	ORP	
130	-- 39.6						
125	-- 38.1						
120	-- 36.6						
115	-- 35.1						
110	-- 33.5						
105	-- 32.0						
100	-- 30.5						
95	-- 29.0						
90	-- 27.4						
85	-- 25.9						
80	-- 24.4						
75	-- 22.9						
70	-- 21.3						
65	-- 19.8						
60	-- 18.3						
55	-- 16.8						
50	-- 15.2						
45	-- 13.7						
40	-- 12.2						
35	-- 10.7	10.9	15.8	.306	8.13	7.49	237
30	-- 9.1	9.0	16.3	.304	7.81	7.50	259
25	-- 7.6	7.8	16.4	.303	7.98	7.44	274
20	-- 6.1	5.9	19.4	.313	6.92	7.47	208
15	-- 4.6	4.6	19.6	.316	6.79	7.48	239
10	-- 3.1	3.1	19.6	.316	6.90	7.50	290
5	-- 1.5	1.5	20.0	.316	7.56	7.62	288
SURFACE		0.0	20.1	.315	7.67	7.66	288

AD-A682 040

ARMY ENGINEER DISTRICT PHILADELPHIA PA
BLUE MARSH LAKE PROJECT, WATER QUALITY DATA REPORT (RCS-DAEN-CW-ETC(U)
SEP 79

F/G 8/8

UNCLASSIFIED

NL

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2

2+2


END

DATE

FILED

5-80

DTIC

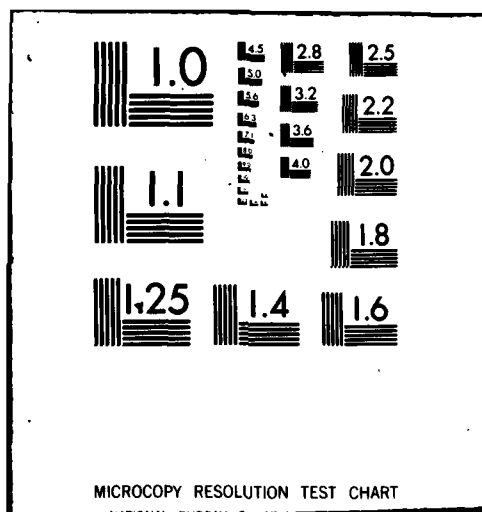

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 10

POOL ELEV: 290.10

DATE: 9/26/79

TIME: 1125

DEPTH FROM TOP (Feet)--(Meters)			TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	--	39.6						
125	--	38.1						
120	--	36.6						
115	--	35.1						
110	--	33.5						
105	--	32.0						
100	--	30.5						
95	--	29.0						
90	--	27.4						
85	--	25.9						
80	--	24.4						
75	--	22.9						
70	--	21.3						
65	--	19.8						
60	--	18.3						
55	--	16.8						
50	--	15.2						
45	--	13.7						
40	--	12.2						
35	--	10.7						
30	--	9.1						
25	--	7.6						
20	--	6.1	6.3	14.4	.321	9.63	7.67	242
15	--	4.6	4.6	17.6	.302	9.58	7.87	253
10	--	3.1	3.1	19.2	.309	8.67	7.79	281
5	--	1.5	1.6	19.8	.310	10.10	8.13	274
SURFACE			0.0	19.9	.309	10.17	8.16	276


WATER QUALITY TESTING


PROJECT: BLUE MARSH

STATION: 12 POOL ELEV: 290.10

DATE: 9/26/79 TIME: 1200

DEPTH FROM TOP (Feet)--(Meters)	TEMP °C	COND	D.O. (PPM)	pH	ORP
130 -- 39.6					
125 -- 38.1					
120 -- 36.6					
115 -- 35.1					
110 -- 33.5					
105 -- 32.0					
100 -- 30.5					
95 -- 29.0					
90 -- 27.4					
85 -- 25.9					
80 -- 24.4					
75 -- 22.9					
70 -- 21.3					
65 -- 19.8					
60 -- 18.3					
55 -- 16.8					
50 -- 15.2					
45 -- 13.7					
40 -- 12.2					
35 -- 10.7					
30 -- 9.1					
25 -- 7.6					
20 -- 6.1					
15 -- 4.6					
10 -- 3.1	3.3	13.7	9.59	7.87	233
5 -- 1.5	1.5	14.4	8.95	7.86	239
SURFACE	0.0	15.2	8.84	7.81	245

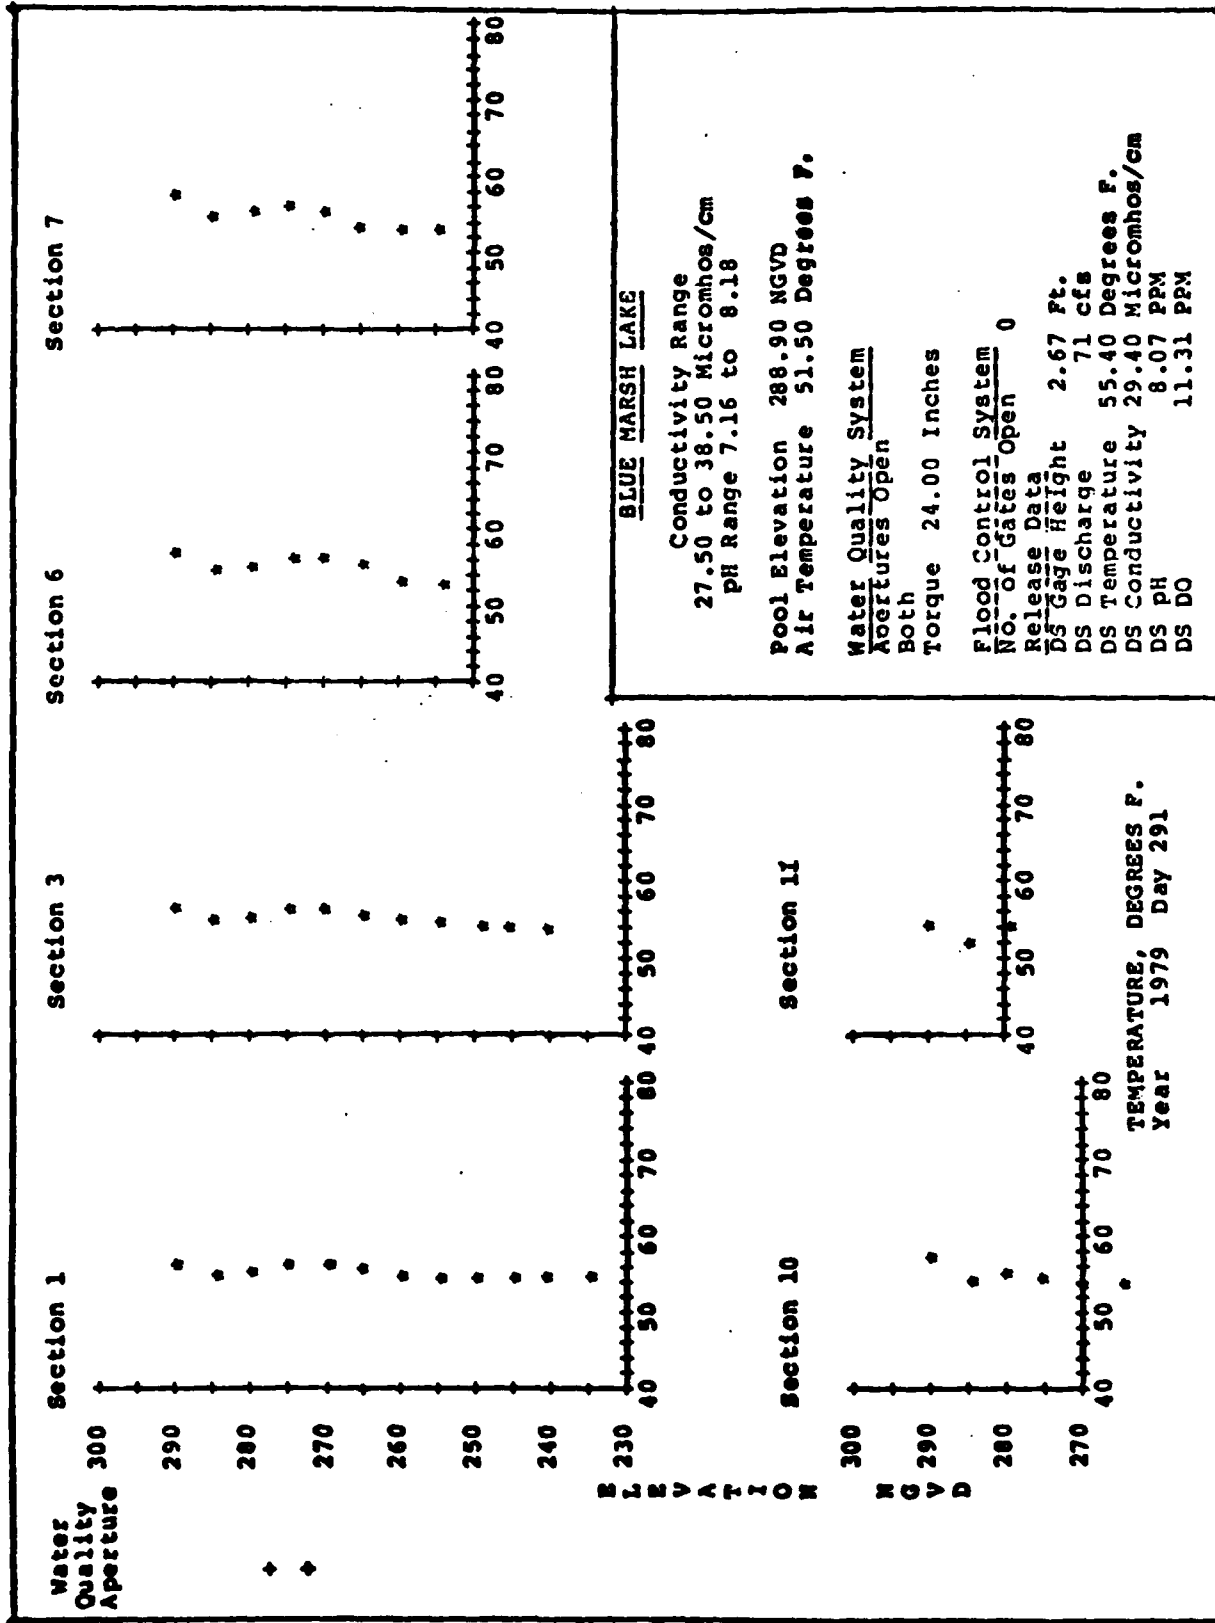

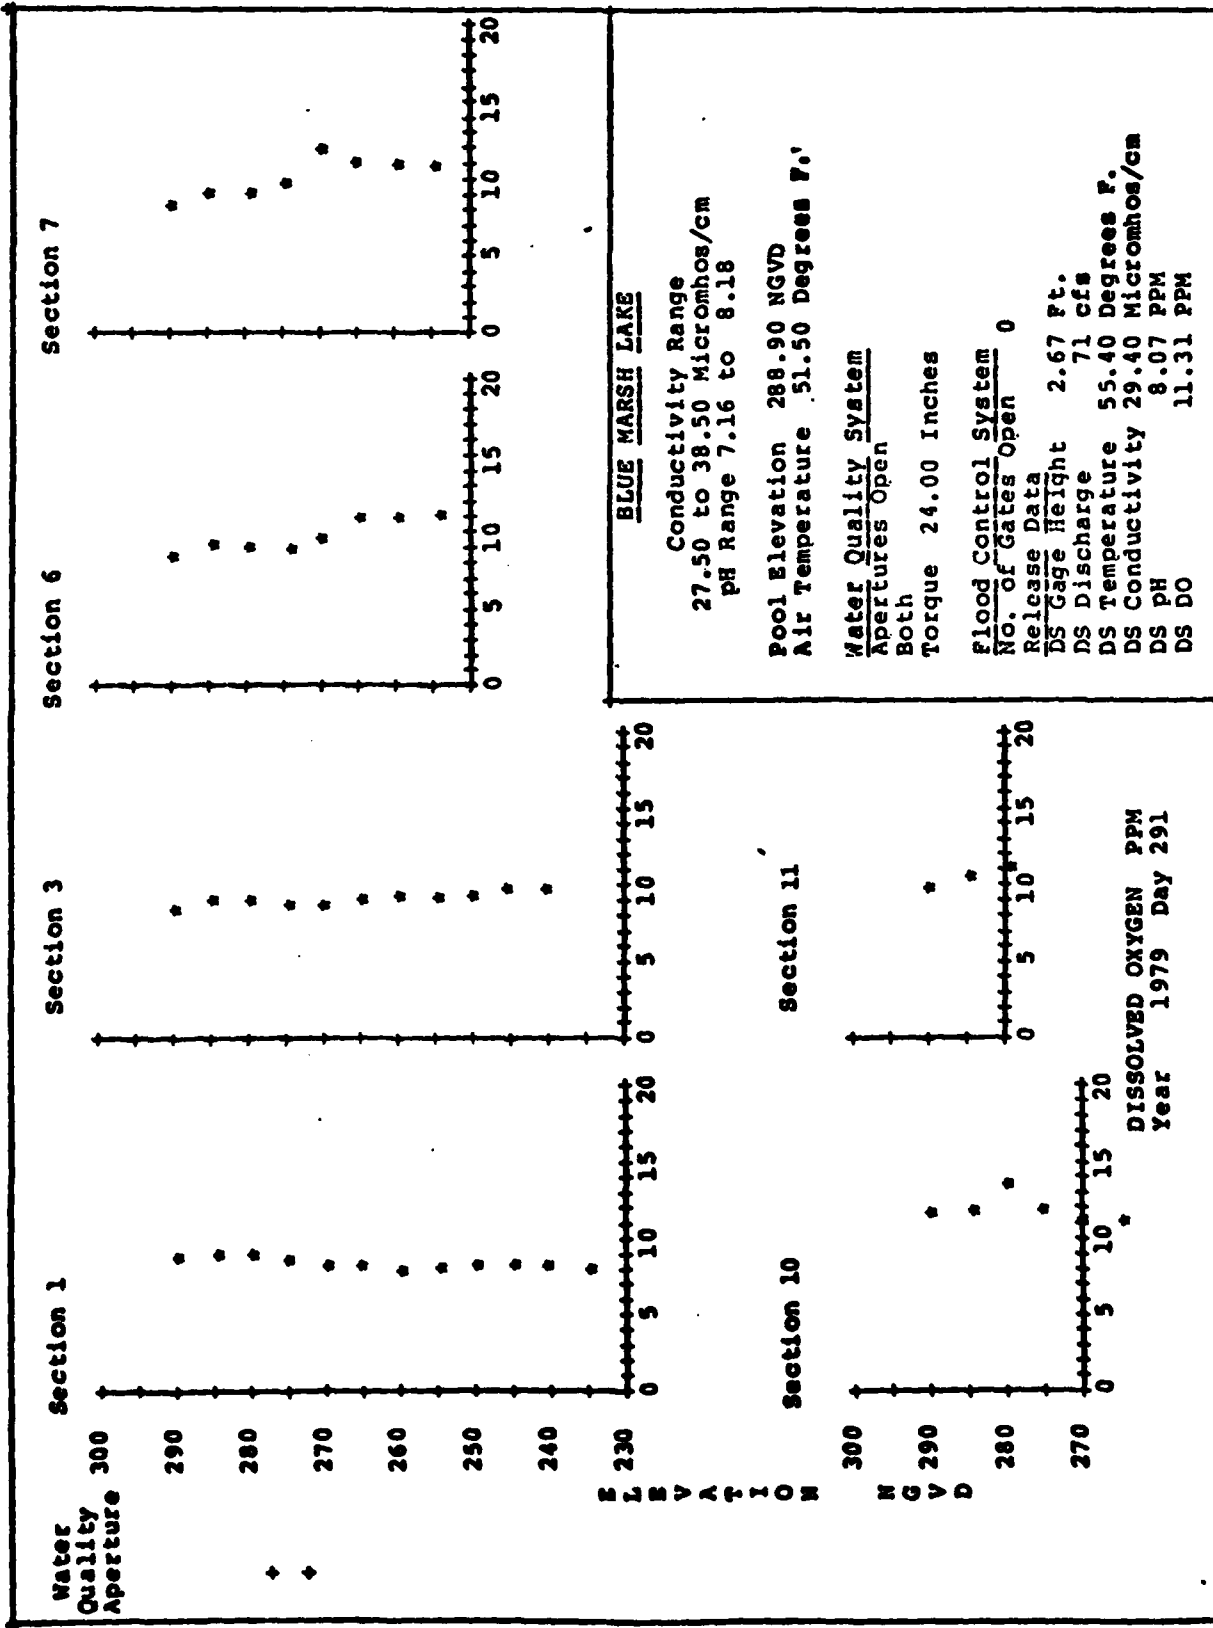

A-65

BLUE MARSH LAKE

STRATIFICATION MONITORING
DATA SHEET

DATE: 10/18/79

MONITORING PARTY: SUE REILLY
CLARE MIRABELLA

JULIAN DAY 291

RESERVOIR DATA

Water Quality System

Portal Opening: 1. Closed ()
2. Open Full (X)
3. Top Open - Bottom Closed ()
4. Top Closed - Bottom Open ()

SLIDE GATE - 2.0'

Torque Setting: — (Inches) (Feet)

Flood Control System

Gates Open: (1) (2) (None)

Gate Settings: 0 Ft. 0 Ft.

Pre-Monitoring Data

Time: 0800 Hrs.

Air Temp: 8.3 °C = 47 °F

Pool Elev: 288.90 Ft. SLD

Downstream Gate Data

(1) Stage: 2.67 Ft.

(2) Discharge: 70.9 CFS

(3) Water Temp: 13 °C = 55.4 °F

(4) D.O: — PPM

(5) pH: —

(6) Cond: — Micromhos/cm

(7) ORP: — mV

REEBERS BR. STA 40

Post Monitoring Data

Time: 1410 Hrs.

Air Temp: 19.7 °C = 67.5 °F

Pool Elev: 288.90 Ft. SLD

Downstream Gate Data

(1) Stage: — Ft.

(2) Discharge: — CFS

(3) Water Temp: 14.8 °C = 58.6 °F

(4) D.O: 11.31 PPM

(5) pH: 8.07

(6) Cond: .294 Micromhos/cm

(7) ORP: 281 mV

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 01 - 21

POOL ELEV: 288.90

DATE: 10/18/79

TIME: 1015

DEPTH FROM TOP (Feet)--(Meters)			TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	--	39.6						
125	--	38.1						
120	--	36.6						
115	--	35.1						
110	--	33.5						
105	--	32.0						
100	--	30.5						
95	--	29.0						
90	--	27.4						
85	--	25.9						
80	--	24.4						
75	--	22.9						
70	--	21.3						
65	--	19.8						
60	--	18.3						
55	--	16.8	16.8	12.5	.322	7.99	7.20	297
50	--	15.2	15.0	12.5	.320	8.09	7.22	305
45	--	13.7	13.7	12.5	.314	8.37	7.24	309
40	--	12.2	12.2	12.5	.313	8.31	7.24	313
35	--	10.7	10.7	12.5	.319	8.19	7.23	316
30	--	9.1	9.1	12.7	.315	7.97	7.20	320
25	--	7.6	7.5	13.2	.306	8.27	7.22	322
20	--	6.1	6.1	13.6	.294	8.25	7.25	325
15	--	4.6	4.5	13.6	.277	8.70	7.33	326
10	--	3.1	3.0	12.9	.286	9.04	7.41	327
5	--	1.5	1.6	12.7	.262	9.04	7.43	328
SURFACE			SURFACE	13.6	.283	8.77	7.55	327

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 03 - 23 POOL ELEV: 288.90

DATE: 10/18/79 TIME: 1035

DEPTH FROM TOP (Feet)--(Meters)			TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	--	39.6						
125	--	38.1						
120	--	36.6						
115	--	35.1						
110	--	33.5						
105	--	32.0						
100	--	30.5						
95	--	29.0						
90	--	27.4						
85	--	25.9						
80	--	24.4						
75	--	22.9						
70	--	21.3						
65	--	19.8						
60	--	18.3						
55	--	16.8						
50	--	15.2	15.1	12.2	.321	9.91	7.45	273
45	--	13.7	13.5	12.3	.315	9.19	7.43	280
40	--	12.2	12.1	12.4	.313	9.27	7.36	286
35	--	10.7	10.7	12.5	.321	9.33	7.35	293
30	--	9.1	9.1	12.7	.303	9.41	7.33	296
25	--	7.6	7.6	13.1	.295	9.09	7.29	301
20	--	6.1	6.0	13.6	.279	8.89	7.30	303
15	--	4.6	4.6	13.6	.281	8.86	7.37	303
10	--	3.1	3.0	12.9	.284	9.14	7.16	304
5	--	1.5	1.5	12.7	.282	9.15	7.48	306
SURFACE			SURFACE	13.7	.282	8.46	7.52	307

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 06 - 26

POOL ELEV: 288.90

DATE: 10/18/79

TIME: 1100

DEPTH FROM TOP (Feet)--(Meters)		TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	-- 39.6						
125	-- 38.1						
120	-- 36.6						
115	-- 35.1						
110	-- 33.5						
105	-- 32.0						
100	-- 30.5						
95	-- 29.0						
90	-- 27.4						
85	-- 25.9						
80	-- 24.4						
75	-- 22.9						
70	-- 21.3						
65	-- 19.8						
60	-- 18.3						
55	-- 16.8						
50	-- 15.2						
45	-- 13.7						
40	-- 12.2						
35	-- 10.7	10.9	11.7	.342	11.18	7.73	241
30	-- 9.1	9.2	11.9	.323	10.99	7.65	253
25	-- 7.6	7.6	13.1	.291	10.95	7.57	265
20	-- 6.1	6.0	13.6	.272	9.73	7.44	275
15	-- 4.6	4.8	13.6	.278	8.97	7.39	281
10	-- 3.1	3.1	12.9	.279	9.12	7.46	287
5	-- 1.5	1.6	12.7	.278	9.30	7.50	290
SURFACE		SURFACE	13.9	.279	8.52	7.55	292

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 07 - 27 POOL ELEV: 288.90

DATE: 10/18/79 TIME: 1125

DEPTH FROM TOP (Feet)--(Meters)		TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	-- 39.5						
125	-- 38.1						
120	-- 36.5						
115	-- 35.1						
110	-- 33.5						
105	-- 32.0						
100	-- 30.5						
95	-- 29.0						
90	-- 27.4						
85	-- 25.9						
80	-- 24.4						
75	-- 22.9						
70	-- 21.3						
65	-- 19.8						
60	-- 18.5						
55	-- 16.8						
50	-- 15.2						
45	-- 13.7						
40	-- 12.2						
35	-- 10.7	10.7	11.6	.348	10.90	7.70	272
30	-- 9.1	9.2	11.6	.347	10.96	7.70	277
25	-- 7.6	7.5	11.8	.341	11.16	7.75	278
20	-- 6.1	6.1	13.0	.294	11.93	7.79	278
15	-- 4.6	4.6	13.5	.275	9.70	7.44	294
10	-- 3.1	3.2	13.0	.279	9.13	7.44	298
5	-- 1.5	1.5	12.6	.278	9.16	7.47	300
SURFACE		SURFACE	14.2	.279	8.33	7.52	302

WATER QUALITY TESTING

PROJECT: BLUE MARSH

STATION: 10 30

POOL ELEV: 288.90

DATE: 10/18/79

TIME: 1210

DEPTH FROM TOP (Feet)--(Meters)		TEMP °C	COND	D.O. (PPM)	pH	ORP	
130	-- 39.6						
125	-- 38.1						
120	-- 36.6						
115	-- 35.1						
110	-- 33.5						
105	-- 32.0						
100	-- 30.5						
95	-- 29.0						
90	-- 27.4						
85	-- 25.9						
80	-- 24.4						
75	-- 22.9						
70	-- 21.3						
65	-- 19.8						
60	-- 18.3						
55	-- 16.8						
50	-- 15.2						
45	-- 13.7						
40	-- 12.2						
35	-- 10.7						
30	-- 9.1						
25	-- 7.6	7.8	11.9	.368	10.95	7.76	250
20	-- 6.1	6.1	11.8	.368	11.01	7.76	253
15	-- 4.6	4.5	12.3	.354	11.67	7.90	254
10	-- 3.1	3.0	12.6	.291	13.41	8.18	251
5	-- 1.5	1.7	12.1	.280	11.69	7.93	263
SURFACE		SURFACE	13.9	.275	11.45	8.14	262

WATER QUALITY TESTING

PROJECT: BLUE MARSH


STATION: 11 - 31


POOL ELEV: 288.90

DATE: 10/18/79

TIME: 1240

DEPTH FROM TOP (Feet)--(Meters)	TEMP °C	COND	D.O. (PPM)	pH	ORP	
130 -- 39.6						
125 -- 38.1						
120 -- 36.6						
115 -- 35.1						
110 -- 33.5						
105 -- 32.0						
100 -- 30.5						
95 -- 29.0						
90 -- 27.4						
85 -- 25.9						
80 -- 24.4						
75 -- 22.9						
70 -- 21.3						
65 -- 19.8						
60 -- 18.3						
55 -- 16.8						
50 -- 15.2						
45 -- 13.7						
40 -- 12.2						
35 -- 10.7						
30 -- 9.1						
25 -- 7.6						
20 -- 6.1						
15 -- 4.6						
10 -- 3.1	3.3	12.2	.382	10.92	7.88	223
5 -- 1.5	1.6	11.0	.385	10.53	7.91	231
SURFACE	SURFACE	12.4	.380	9.63	7.90	239

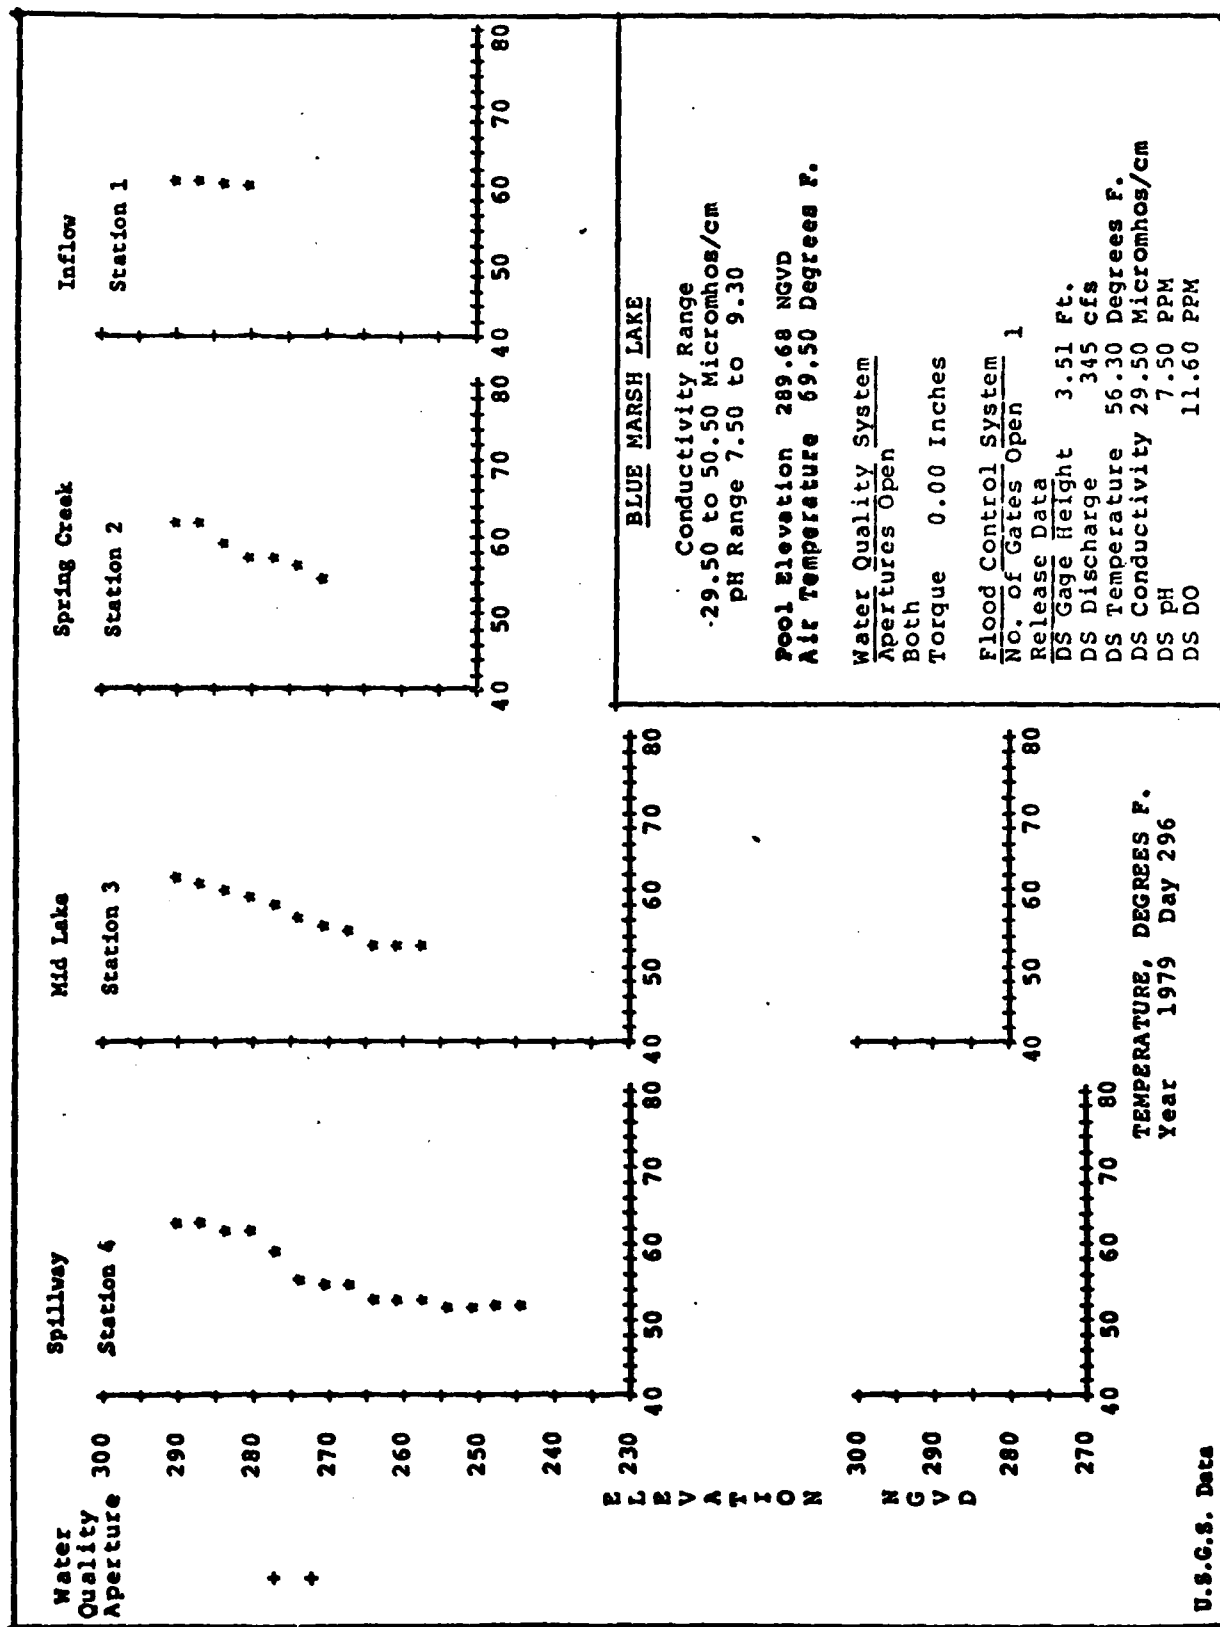

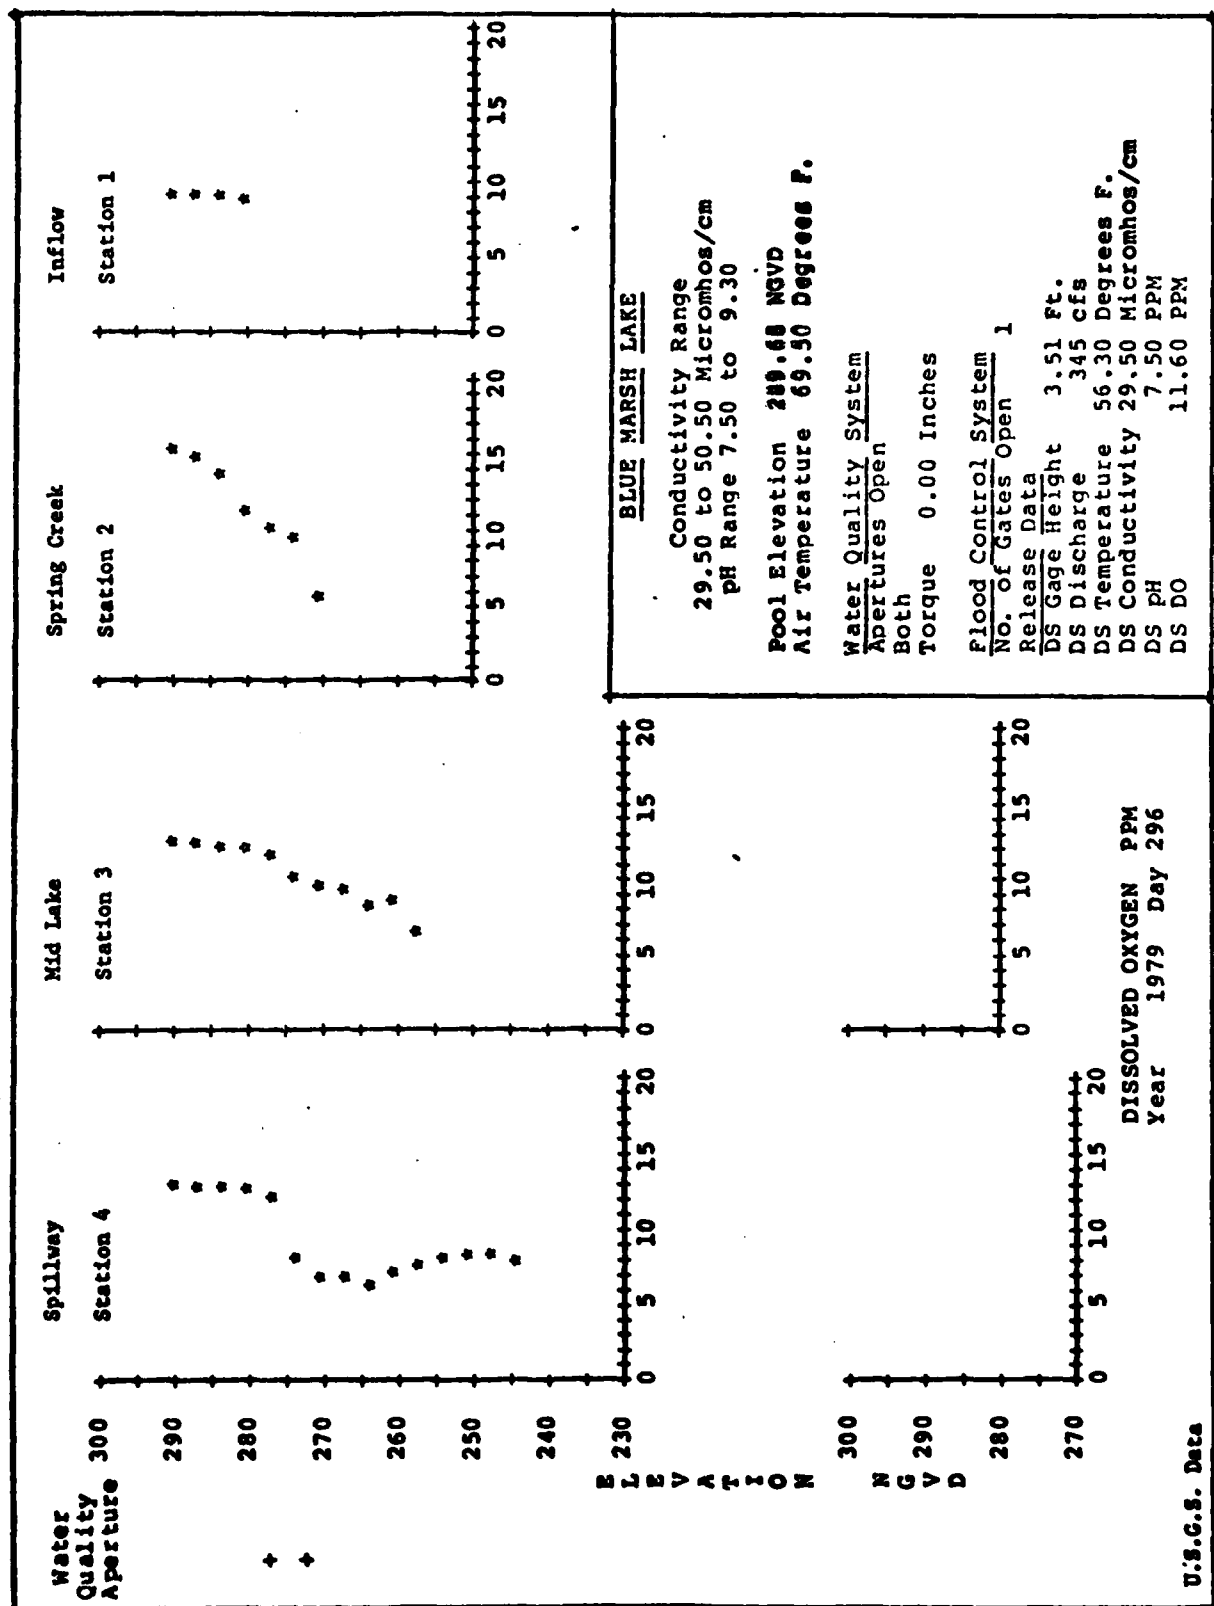

A-74

Party: JB & JL

Location: SPILLWAY

Time: 1245

S.D.

26'

Weather: CLEARING - BROKEN CLOUDS - SUNNY & WINDY

Comments:

1300

134!

[illegible]

Party: JB & JL

MID LAKE

72."

CLOUDS SCATTERED. PARTIALLY SUNNY - COOL

1230

[illegible]

Project:

BLUE MARSH

Party: JB+JL

Stations:

2

Location:

SPRING CREEK

Date:

23 OCT. 79.

Time:

1120

S.D.

76."

Weather:

OVERCAST - SCATTERED CLOUDS

1130

Contents:

1131

A-77

APPENDIX B

BLUE MARSH LAKE SECCHI DISC READINGS

BLUE MARSH LAKE

SECOCHI DISC READINGS*

APPENDIX B

DEPTH

DATE	WEATHER	TIME	LOCATION	DOWN	UP	AVERAGE
12 JULY 79	SUNNY - WARM	1315	1/			3' 2"
"	"	1400	2/			3' 3"
"	"	1430	3/			5' 10"
"	"	1500	4/			5' 11"
24 JULY 79	OVERCAST - FOG	1155	1/			2' 0"
"	"	1345	2/			2' 0"
"	"	1035	3/			3' 2"
"	"	1000	4/			3' 1"
8 AUG. 79	CLEAR	1040	1/			2' 2"
"	"	1120	2/			2' 5"
"	"	1220	3/			2' 2"
"	"	1325	4/			2' 4"

*Data by U. S. Army Corps of Engineers, Philadelphia District & U. S. Geological Surveys

Location Key: 1/ Inlet End of Lake - near U.S.G.S. Gage

2/ Midway of Spring Creek Arm

3/ Center of Lake West of Beach Area.

4/ Approximately 250' in Front of Tower.

APPENDIX B

BLUE MARSH LAKE

SECHI DISC READINGS*

APPENDIX B

DATE	WEATHER	TIME	LOCATION	DEPTH	
				DOWN	UP
21 AUG 79	CLEAR, HOT, SUNNY	1210	1/		3' 10"
"	" " "	1300	2/		3' 10"
"	" " "	1330	3/		4' 6"
"	" " "	1410	4/		6' 0"
5 SEPT 79	OVERCAST - WINDY - COOL	1120	1/		2' 0"
"	" " "	1230	2/		3' 0"
"	" " "	1150	3/		2' 8"
"	" " "	1325	4/		3' 8"
18 SEPT 79	CLEAR, CLOUDS MOVING IN	1045	1/		2' 3"
"	" " "	1200	2/		3' 4"
"	" " "	1300	3/		4' 0"
"	" " "	1345	4/		4' 0"

* Data by U. S. Army Corps of Engineers, Philadelphia District & U. S. Geological Surveys

Location: 1/ Blue Mar of Lake - near U.S.G.S. Gage

2/ Midway of Lake, Creek Area

3/ Center of Lake West of Beach Area.

4/ Approximately 250' in front of Tower.

BLUE MARSH LAKE
SECCHI DISC READINGS*
APPENDIX - B

DATE	WEATHER	TIME	LOCATION		DEPTH	
			DOWN	UP	AVERAGE	
23 OCT. 79	BROKEN CLOUDS - SUNNY & WINDY	1030	1/		4' 0"	
"	"	1120	2/		6' 4"	
"	"	1210	3/		6' 0"	
"	"	1300	4/		7' 2"	
			2/			
			2/			
			2/			
			4/			
			2/			
			2/			
			2/			
			4/			
			2/			
			2/			
			4/			

*Data by U. S. Army Corps of Engineers, Philadelphia District & U. S. Geological Surveys
Location Key: 1/ Inlet End of Lake - near U.S.G.S. Gage
2/ Halfway up Spring Creek Arm
3/ Center of Lake West of Beach Area.
4/ Approximately 250' in Front of Tower.

PLATE 1

BLUE MARSH DAM AND RESERVOIR
LOCATION


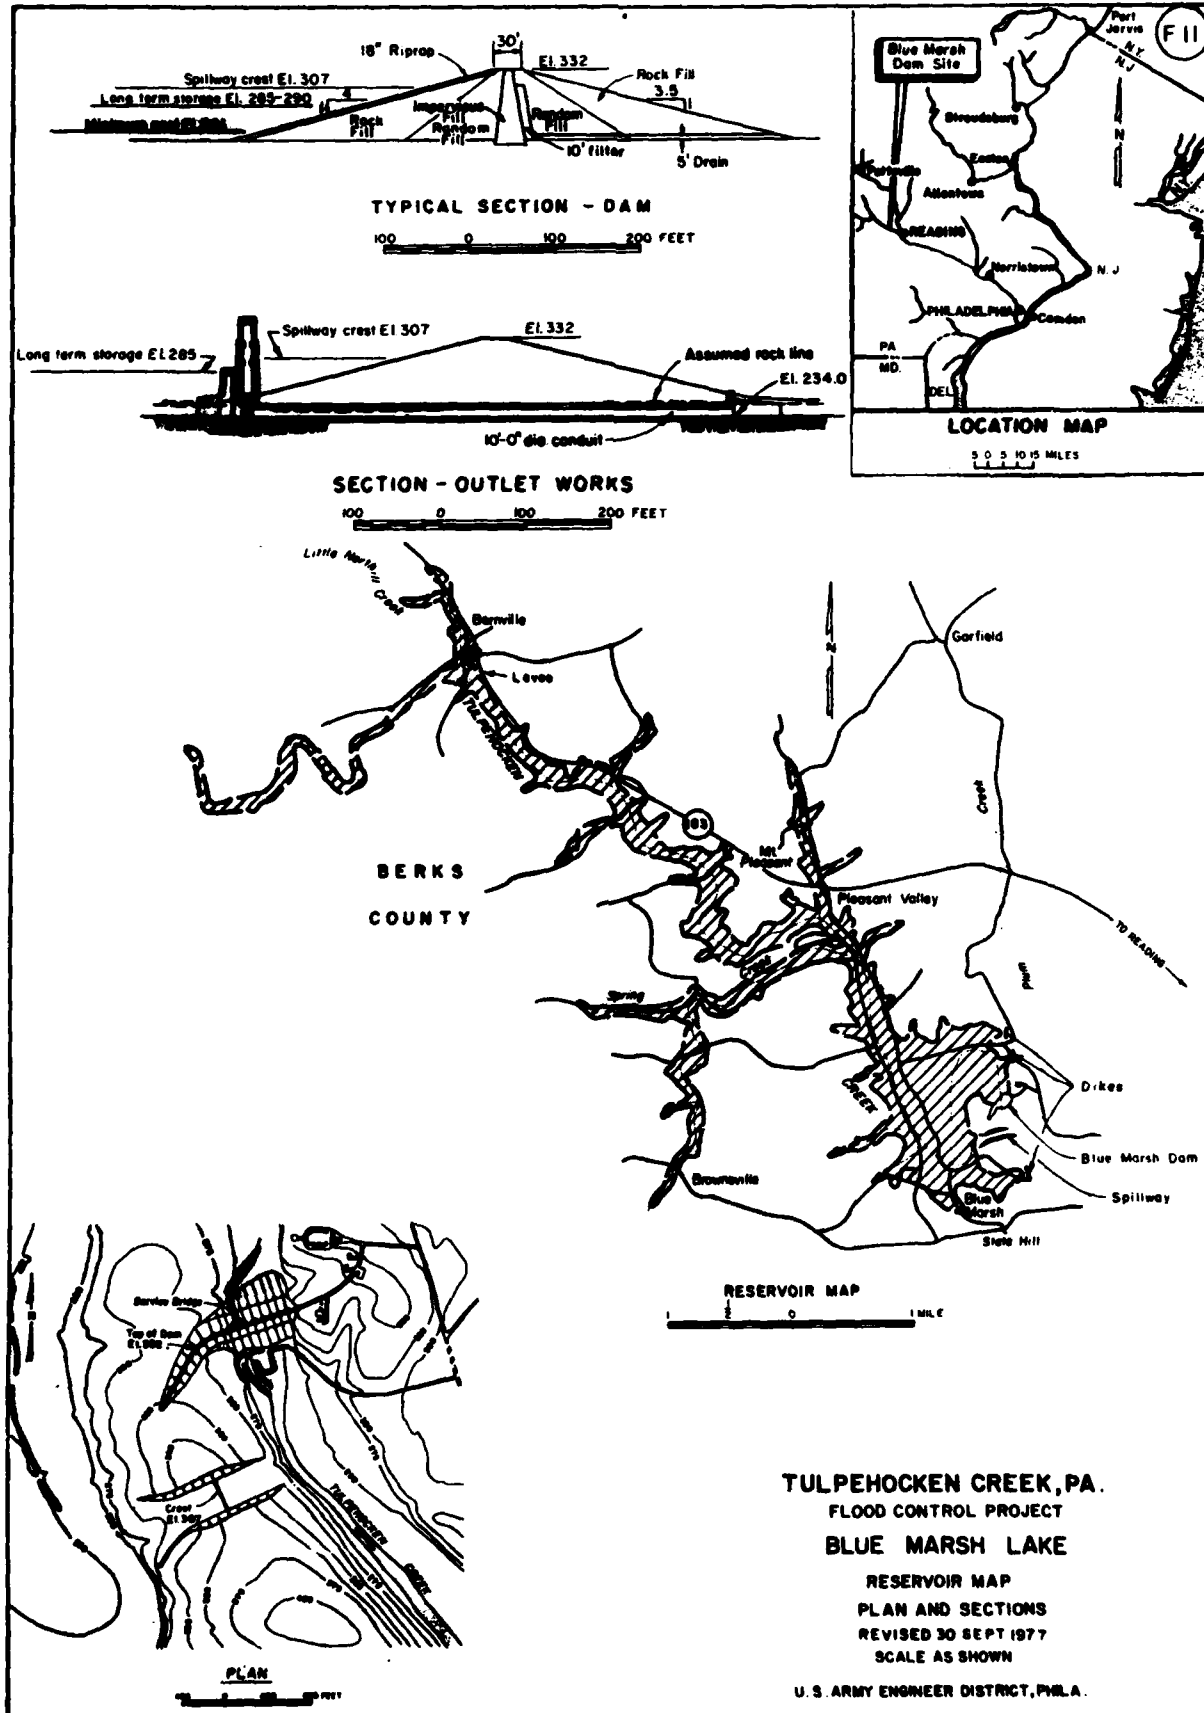


PLATE 2

BLUE MARSH LAKE SAMPLING POINTS

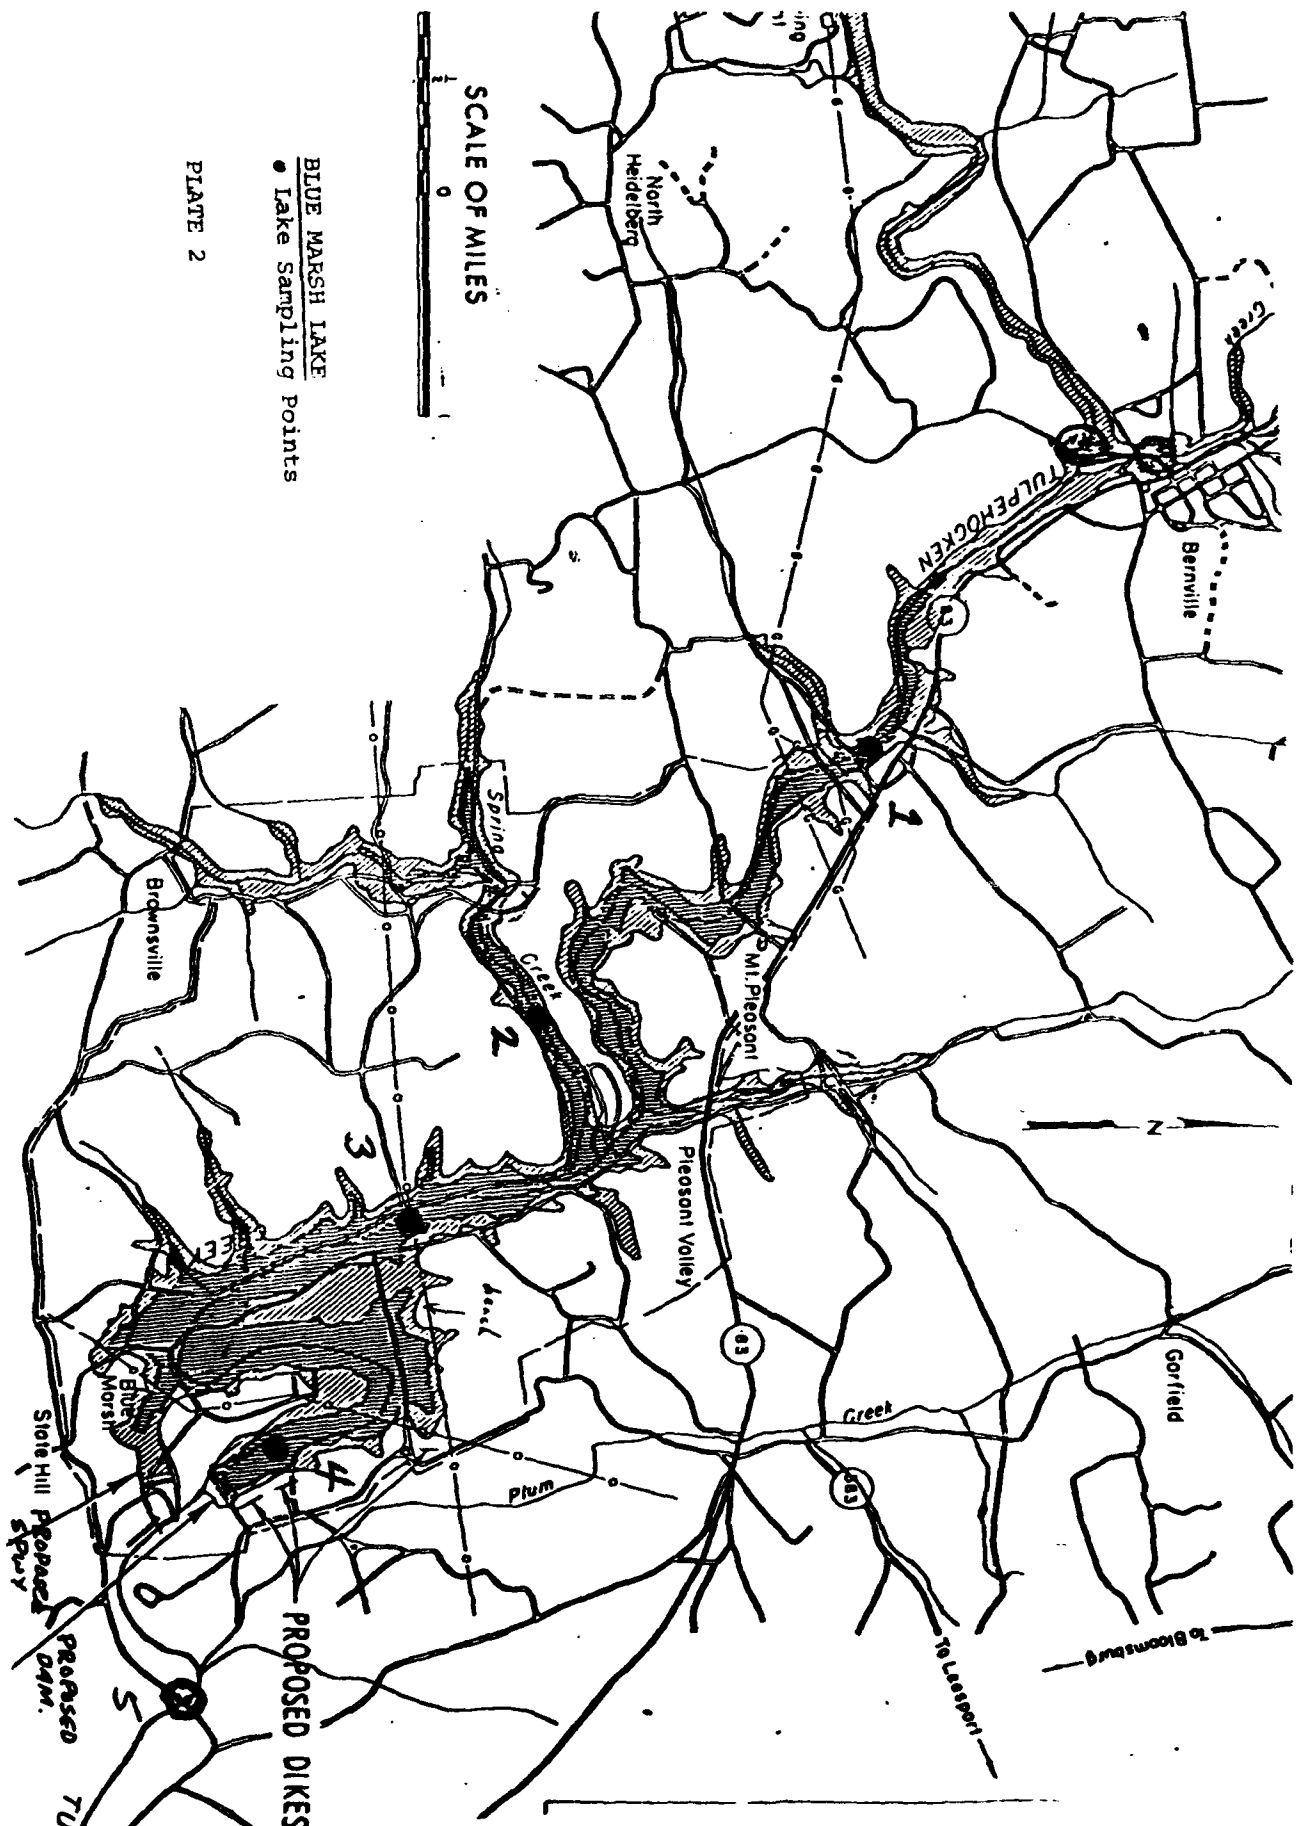

SCALE OF MILES

BLUE MARSH LAKE

• Lake Sampling Points

PLATE 2

PROPOSED DIKES

TABLE 1
CLIMATOLOGICAL DATA

TABLE 1
BLUE MARSH LAKE
CLIMATOLOGICAL DATA^{1/} - JAN - SEPT. 1979

MONTH	Precp. (inches)	Total Snow (inches)	Avg. Temp. (°F)	Highest Temp. (°F)	Lowest Temp. (°F)	Days With Precp.
JAN	10.27	9.1	27.6	61	6	21
FEB	5.01	4.2	20.5	49	-8	11
MAR	1.94	T	42.8	79	13	6
APR	4.12	0	49.5	79	26	11
MAY	5.04	0	62.1	91	34	14
JUNE	4.32	0	67.7	88	42	9
JULY	3.06	0	73.2	93	47	10
AUG	2.11	0	72.8	93	43	8
SEPT	6.30	0	64.7	89	38	10

^{1/} Extracted from the Monthly Summary Report- NOAA - Data collected at the Reading Station.

FIGURES 1 THROUGH 5

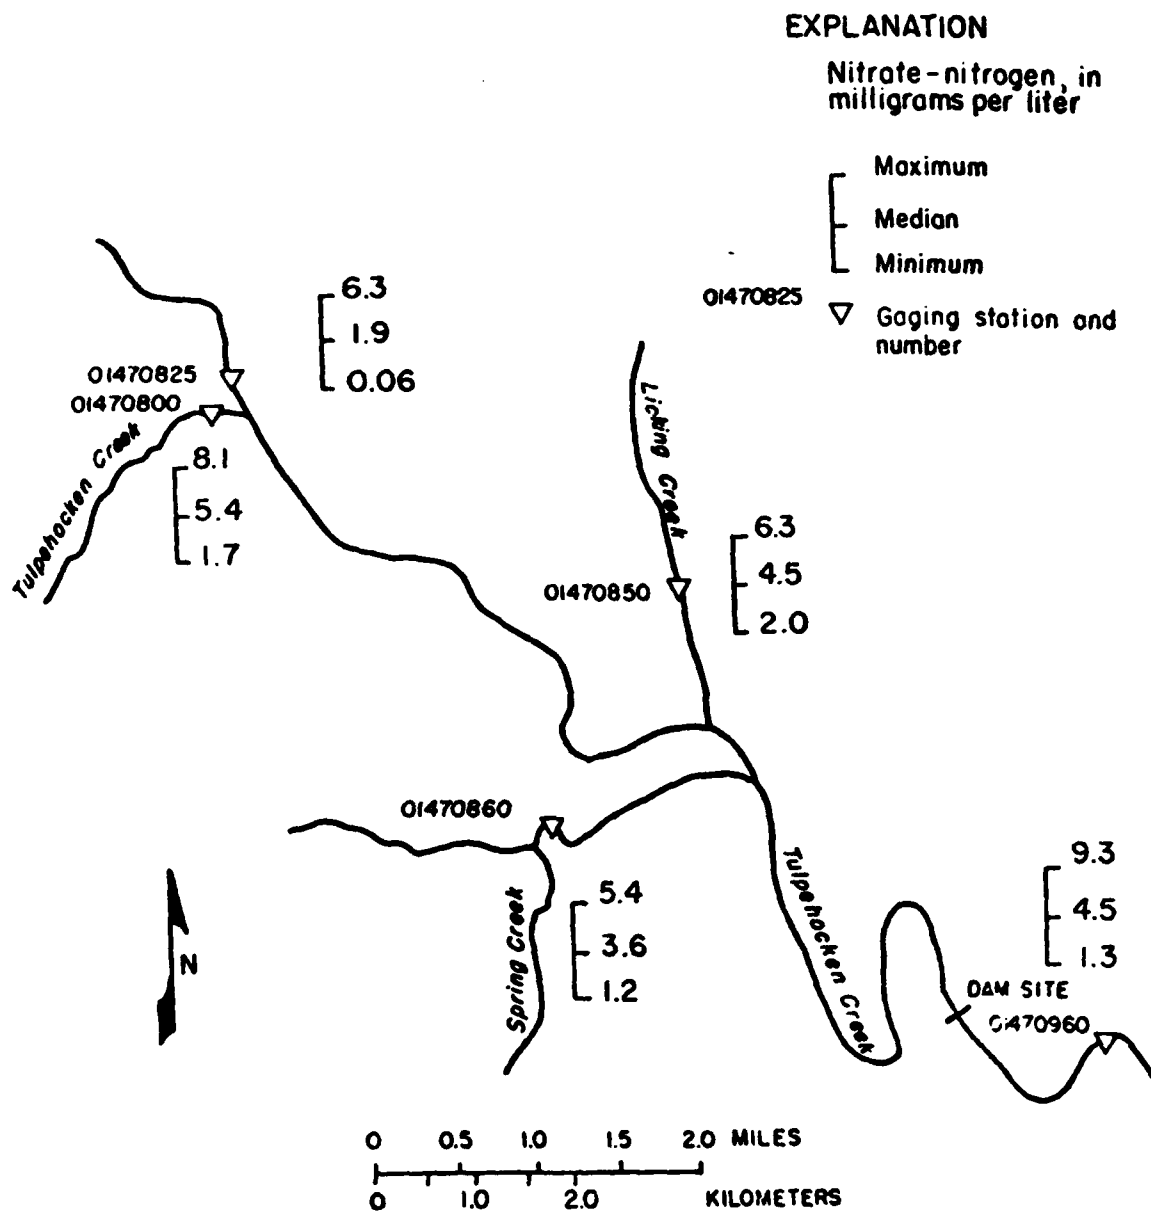


Figure 1.--Map showing nitrate-nitrogen concentrations in the Tulpehocken Creek basin.

EXPLANATION

Total phosphorous, in
milligrams per liter

Maximum

Median

Minimum

▽ Gaging station and
number

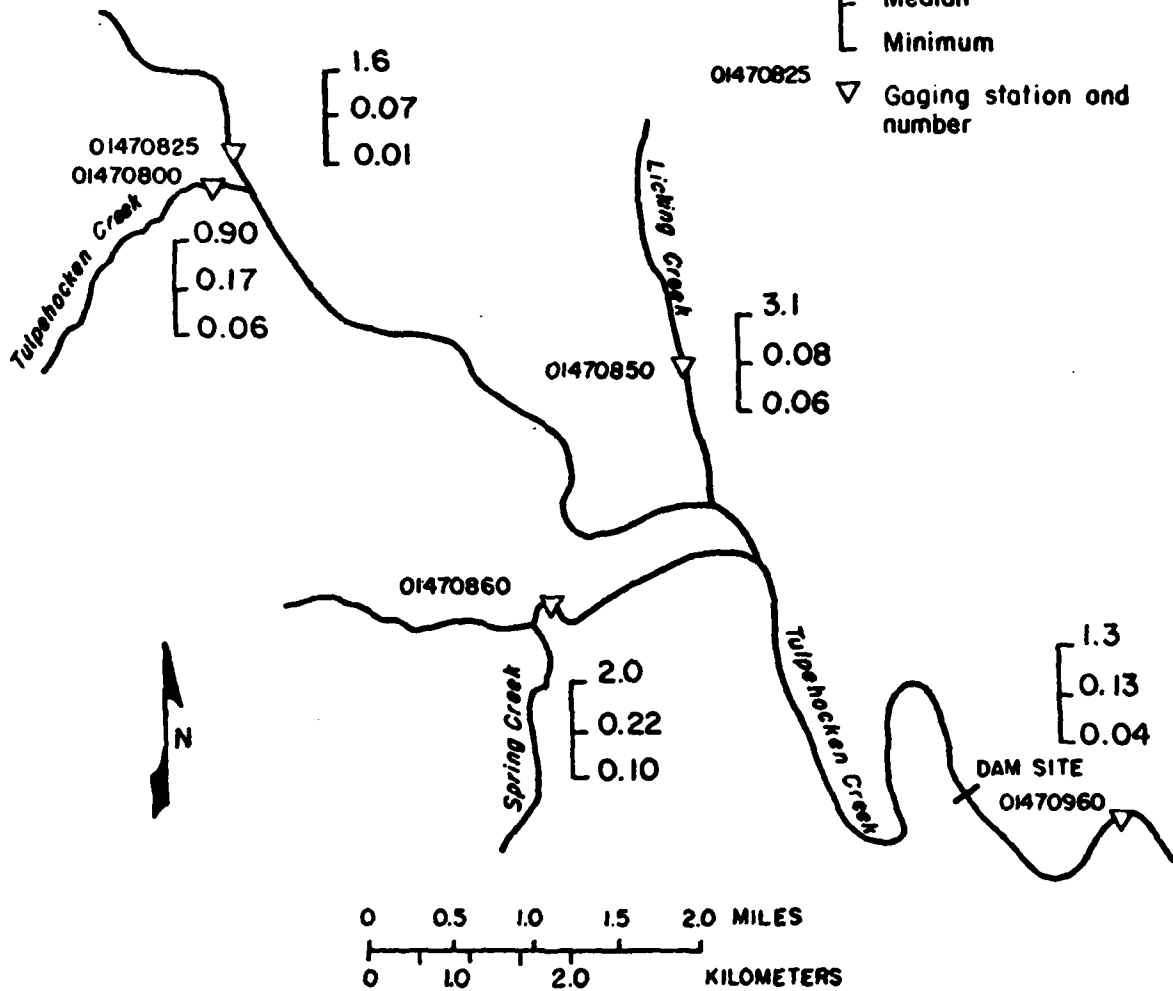


Figure 2.--Map showing total phosphorus concentrations in Tulpehocken Creek basin.

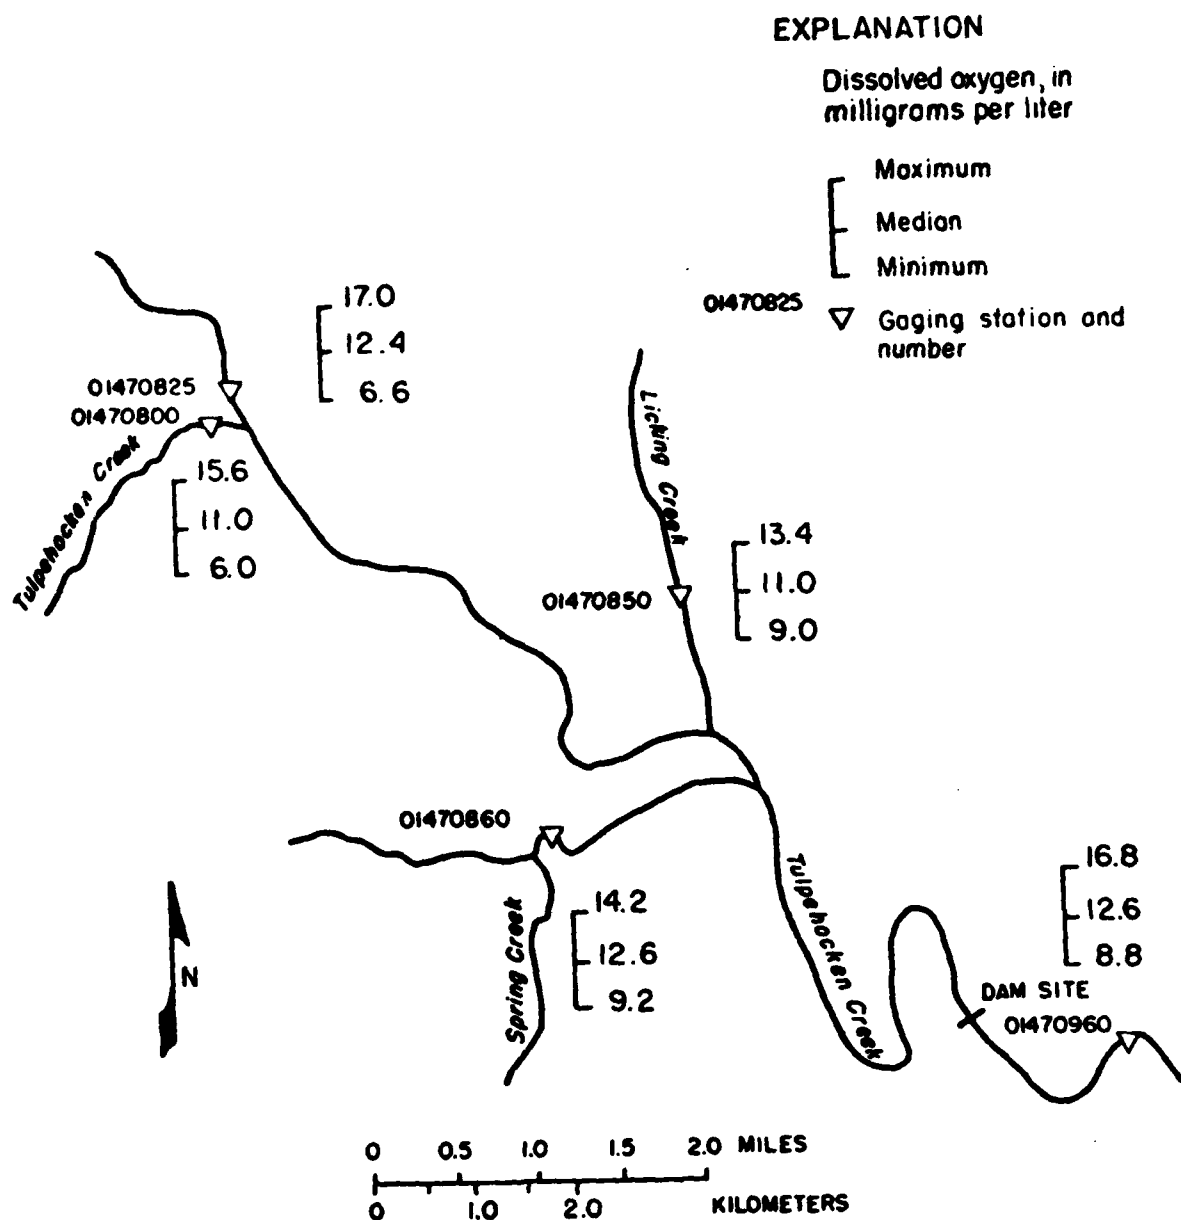


Figure 4.--Map showing dissolved oxygen concentrations in the Tulpehocken Creek basin.

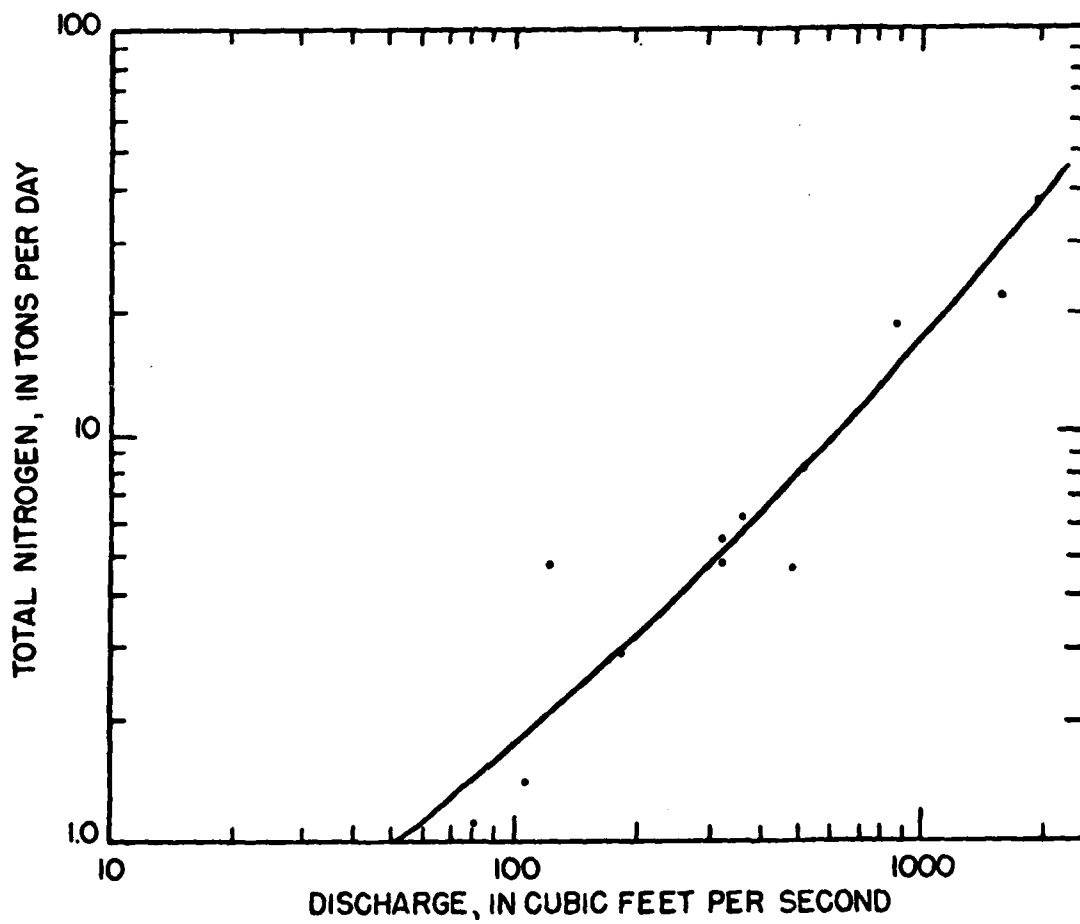


Figure 3.--Graph showing relation between discharge and total nitrogen in Tulpehocken Creek basin near Blue Marsh Dam site.

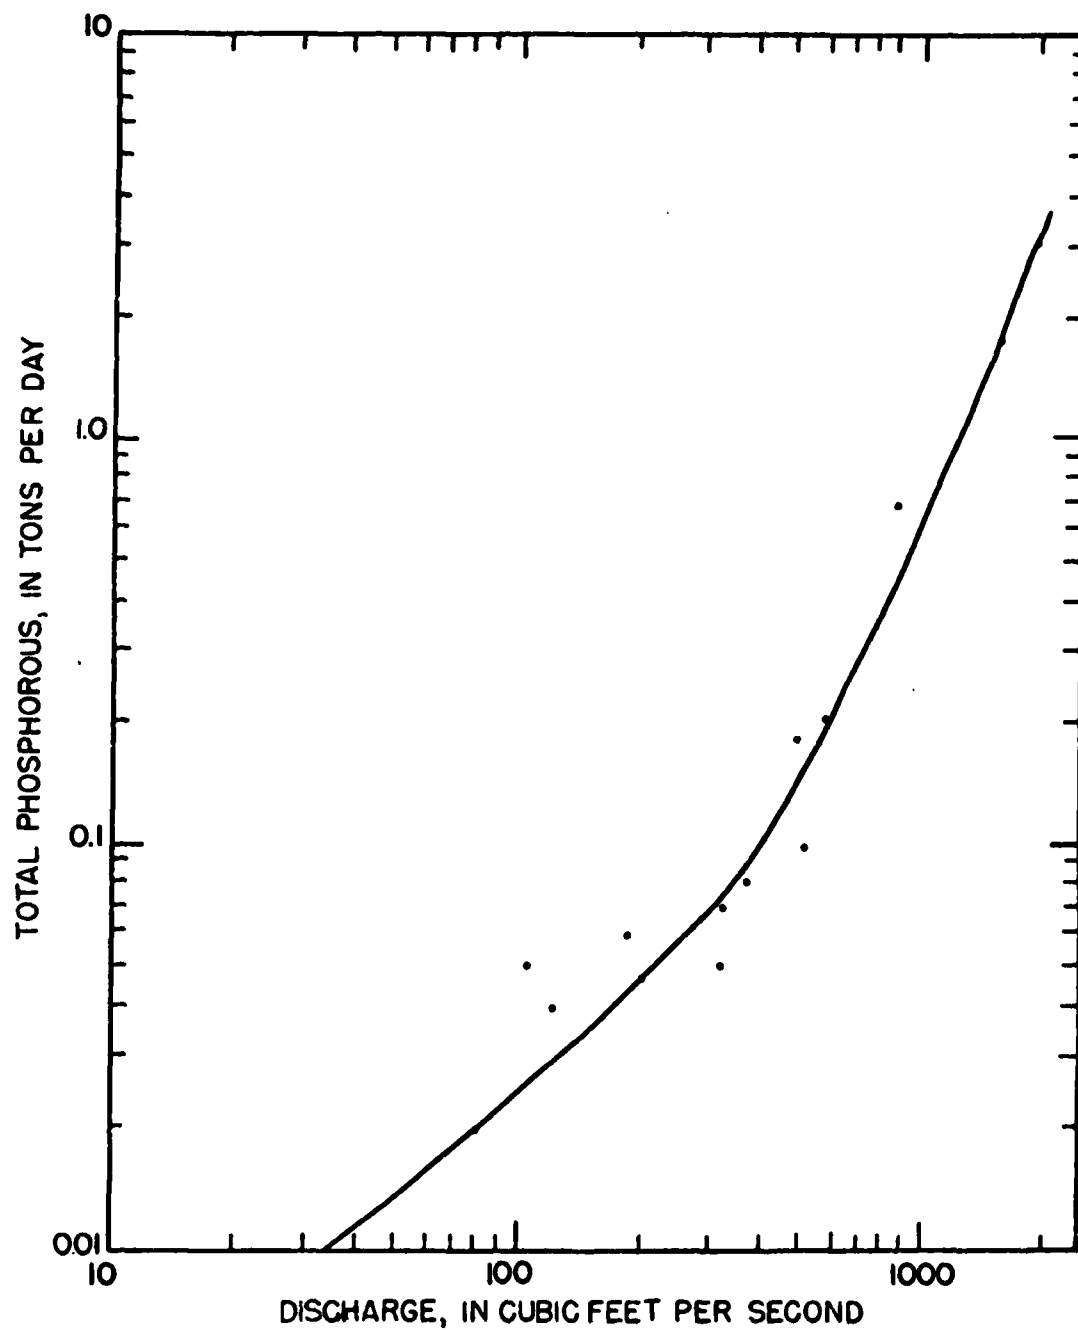


Figure 5'.--Graph showing relation between discharge and total phosphorus in Tulpehocken Creek basin near Blue Marsh Dam site.